


DESIGN SUITABLE FOR USE IN
LEVEL GROUND WITH 2.5M MINIMUM
POLE EMBEDMENT

DESCRIPTION		FOR ISSUE			
REV	DATE	BY	CHKD	APPD	PP
3	26/07/07	JR	GS	PP	

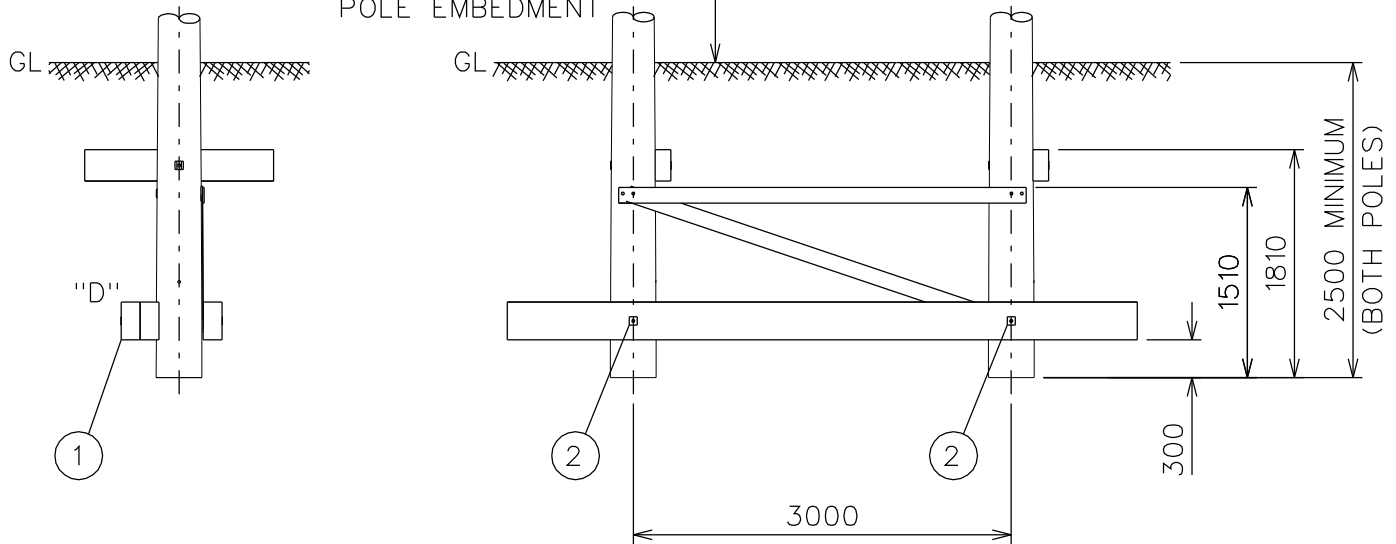

SIDE VIEW

FRONT ELEVATION

ITEM	DESCRIPTION	REFERENCE No.	QTY REQ'D	WEIGHT EACH (Kg)	REMARKS
1	"H" Pole Timber Baulk	LSTC/STD/PAR/738	1	192.5	Timber Baulk "D" in addition to LSTC/STD/GNA/514
2	M20 Bolts x Length To Suit Pole Diameter	LSTC/STD/GNA/555	2	2.0	M20 Bolts to attach additional Timber Baulk "D" to Foundation
3					
4					
5					
6					
7					
8					
Total Additional Calculated Weight = 197Kg					

GENERAL NOTES:

- ALL STEELWORK TO BE PROTOTYPE CHECK ERECTED PRIOR TO MASS PRODUCTION.
- ALL DIMENSIONS ARE IN MILLIMETRES.
- MATERIAL LIST INDICATES ADDITIONAL ITEMS REQUIRED WHEN "POOR" SOIL CONDITIONS ARE ENCOUNTERED.
THESE FOUNDATIONS CAN ONLY BE INSTALLED IN LEVEL GROUND.
TO BE READ IN CONJUNCTION WITH:
LSTC/STD/GNA/514: 0° SECTION UPTO 120M
LSTC/STD/GNA/516: MATERIAL LIST
LSTC/STD/GNA/555: BOLT LENGTH DETERMINATION
- IMPORTANT: REFER TO LSTC/STD/GNA/779 SHEETS 1 TO 4 FOR FOUNDATION DESIGN CRITERIA.

SHT 1 : SOIL CLASSIFICATIONS & POLE EMBEDMENT DETAILS.
SHT 2 : FOUNDATION DETAILS / STRUCTURE TYPES.
SHT 3 : FACTORS OF SAFETY.
SHT 4 : OUTLINE DESIGN FOR "VERY POOR" SOIL FOUNDATIONS.



CLIENT	PowerSystems	TITLE	ADDITIONAL MATERIAL - 0° SECTION UPTO 120M POOR SOIL CONDITIONS	SCALE 1:60 (UNLESS OTHERWISE STATED)	ORIGINAL SIZE A4	LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617
SPECIFICATION	OHL-03-132			DATE 16/05/05	CHECKED GS	
				DRAWN R.F.	APPROVED PP	
				DRAWING NUMBER LSTC/STD/GNA/801	REV 3	

