


DESCRIPTION		FOR ISSUE			
REV	DATE	BY	CHKD	APPD	
2	04/07/07	JR	GS	PP	

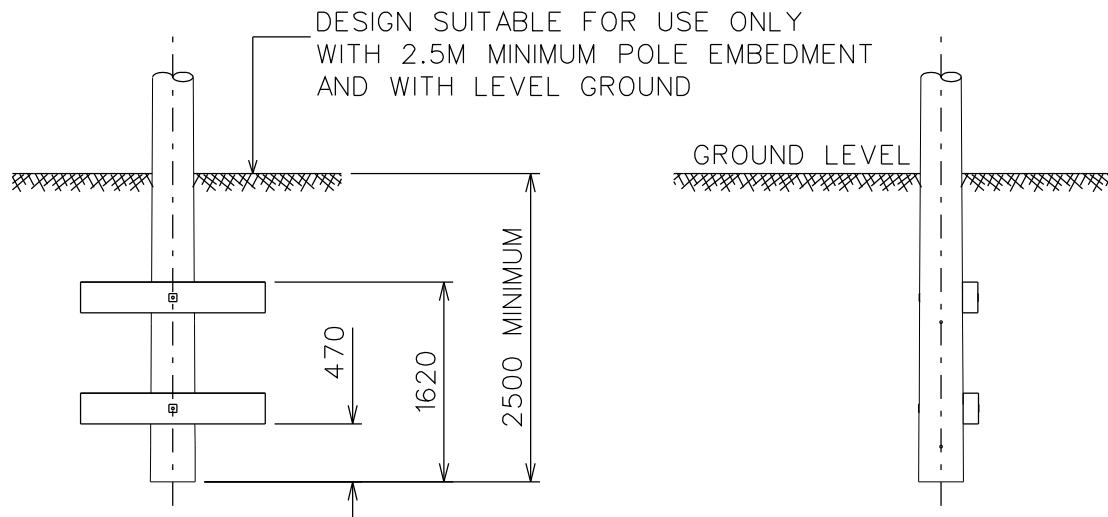

LONGITUDINAL FACE

TRANSVERSE FACE

GENERAL NOTES:

1. ALL STEELWORK TO BE PROTOTYPE CHECK ERECTED PRIOR TO MASS PRODUCTION.
2. ALL DIMENSIONS ARE IN MILLIMETRES.
3. NO ADDITIONAL ITEMS REQUIRED WHEN "POOR" SOIL CONDITIONS ARE ENCOUNTERED. FOUNDATIONS TO BE PLACED IN LEVEL GROUND AND HAVE MINIMUM EMBEDMENT DEPTH OF 2.5M.
TO BE READ IN CONJUNCTION WITH:
LSTC/STD/GNA/520: SINGLE POLE INTERMEDIATE
LSTC/STD/GNA/521: MATERIAL LIST
LSTC/STD/GNA/555: BOLT LENGTH DETERMINATION
4. IMPORTANT: REFER TO LSTC/STD/GNA/779 SHEETS 1 TO 4 FOR FOUNDATION DESIGN CRITERIA.

- SHT 1 : SOIL CLASSIFICATIONS & POLE EMBEDMENT DETAILS.
 SHT 2 : FOUNDATION DETAILS / STRUCTURE TYPES.
 SHT 3 : FACTORS OF SAFETY.
 SHT 4 : OUTLINE DESIGN FOR "VERY POOR" SOIL FOUNDATIONS.



CLIENT	TITLE	SCALE 1:60 (UNLESS OTHERWISE STATED)	ORIGINAL SIZE A4	 LSTC North Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA Tel 01377 253617 Fax 01377 259555 LSTC South: Bourne House Office 21 475 Godstone Road Weybridge Surrey CR3 0BL Tel 01883 621114
PowerSystems	ADDITIONAL MATERIAL - SINGLE POLE INTERMEDIATE STRUCTURE POOR SOIL CONDITIONS	DATE 04/07/07	CHECKED GS	
SPECIFICATION		DRAWN JR	APPROVED PP	
OHL-03-132		DRAWING NUMBER LSTC/STD/GNA/809		