


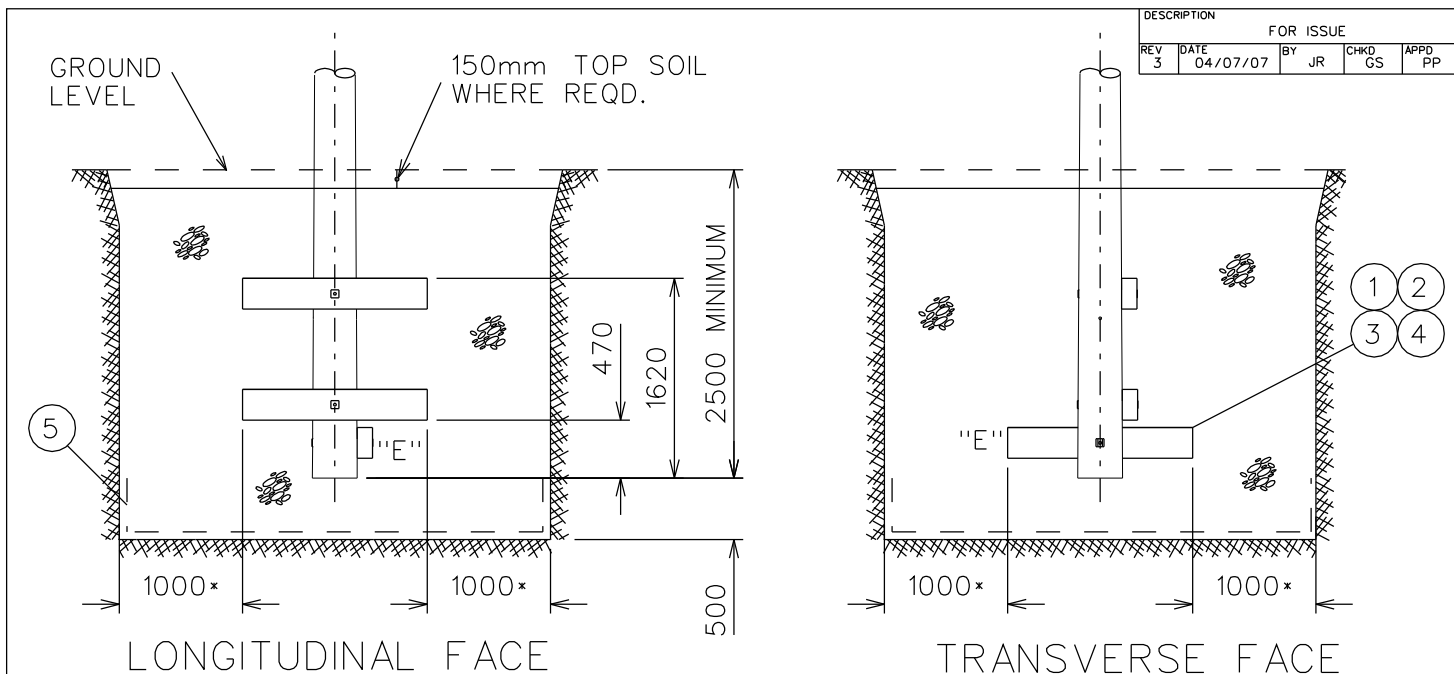

* MINIMUM DISTANCE BETWEEN FACE OF
EXCAVATION & STRUCTURE TO ALLOW
ACCESS TO PLACE GRANULAR FILL & COMPACT

	ITEM - DESCRIPTION	REFERENCE No.	QTY REQ'D	WEIGHT EACH (Kg)	REMARKS
1	Foundation Block	LSTC/STD/PAR/602	1	40	Foundation Block "E" in addition to LSTC/STD/GNA/520
2	M20 Bolts x Length To Suit Pole Diameter	LSTC/STD/GNA/555	1	0.5	M20 Bolts to attach additional Foundation Block "E"
3	Square Flat Washer	LSTC/STD/PAR/619	1	0.1	
4	Square Curved Washer	LSTC/STD/PAR/620	1	0.2	
5	Geotextile Membrane		--	--	Place in Bottom of Excavation Prior to Granular Backfill

Total Additional Calculated Weight = 41Kg

GENERAL NOTES:

- ALL STEELWORK TO BE PROTOTYPE CHECK ERECTED PRIOR TO MASS PRODUCTION.
- ALL DIMENSIONS ARE IN MILLIMETRES.
- MATERIAL LIST INDICATES ADDITIONAL ITEMS REQUIRED WHEN "VERY POOR" SOIL CONDITIONS ARE ENCOUNTERED.
FOUNDATIONS TO HAVE MINIMUM EMBEDMENT DEPTH OF 2.5M.
TO BE READ IN CONJUNCTION WITH:
LSTC/STD/GNA/520: SINGLE POLE INTERMEDIATE
LSTC/STD/GNA/521: MATERIAL LIST
LSTC/STD/GNA/555: BOLT LENGTH DETERMINATION
- IMPORTANT: REFER TO LSTC/STD/GNA/779 SHEETS 1 TO 4 FOR FOUNDATION DESIGN CRITERIA.

SHT 1 : SOIL CLASSIFICATIONS & POLE EMBEDMENT DETAILS.
SHT 2 : FOUNDATION DETAILS / STRUCTURE TYPES.
SHT 3 : FACTORS OF SAFETY.
SHT 4 : OUTLINE DESIGN FOR "VERY POOR" SOIL FOUNDATIONS.



CLIENT PowerSystems	TITLE ADDITIONAL MATERIAL - SINGLE POLE INTERMEDIATE STRUCTURE VERY POOR SOIL CONDITIONS	SCALE 1:60 (UNLESS OTHERWISE STATED)	ORIGINAL SIZE A4	 LSTC Norths Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA Tel 01377 253617 Fax 01377 259555 LSTC Souths Bourne House Office 21 475 Godstone Road Whyteleafe Surrey CR3 0BL Tel 01883 621114	
		DATE 04/07/07	CHECKED GS		
SPECIFICATION OHL-03-132		DRAWN JR	APPROVED PP		
		DRAWING NUMBER LSTC/STD/GNA/810			REV 3