


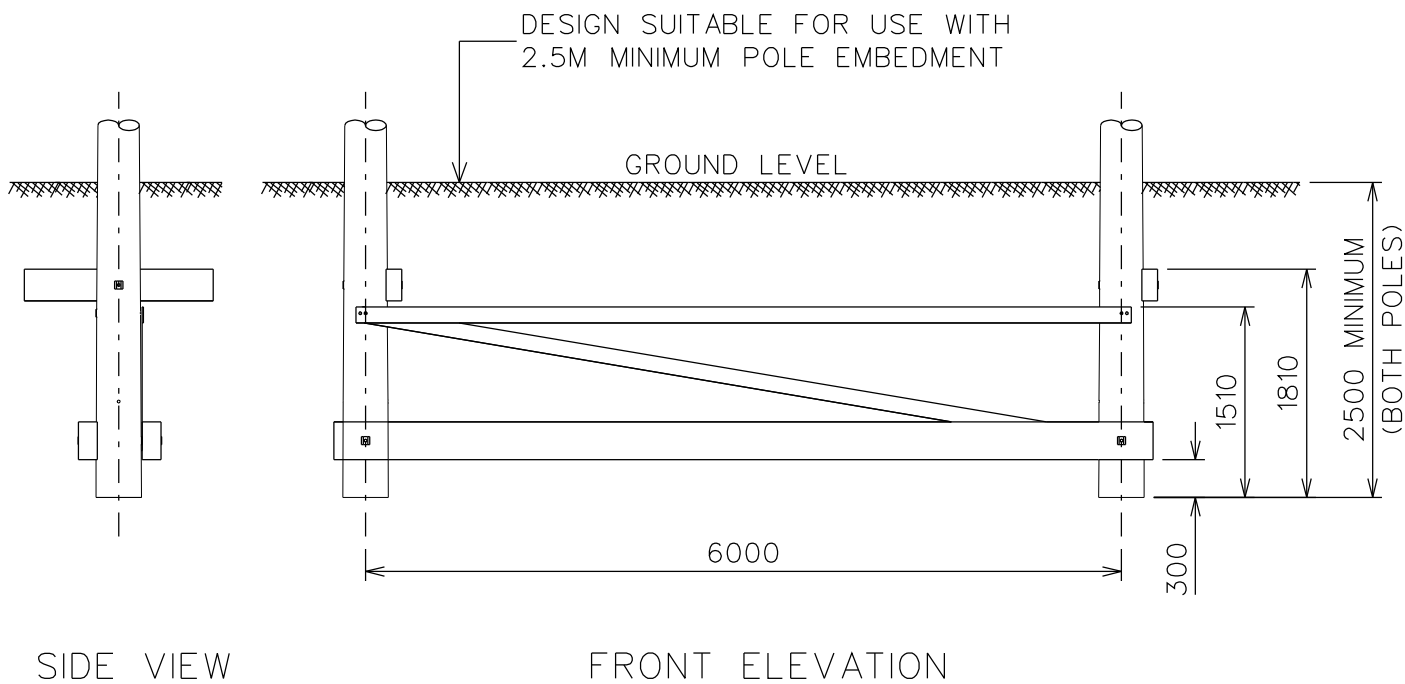

- GENERAL NOTES:
1. ALL STEELWORK TO BE PROTOTYPE CHECK ERECTED PRIOR TO MASS PRODUCTION.
 2. ALL DIMENSIONS ARE IN MILLIMETRES.
 3. NO ADDITIONAL ITEMS REQUIRED WHEN "POOR" SOIL CONDITIONS ARE ENCOUNTERED. FOUNDATIONS TO HAVE MINIMUM EMBEDMENT DEPTH OF 2.5M.
TO BE READ IN CONJUNCTION WITH:
LSTC/STD/GNA/527: FAILURE CONTAINMENT WOOD POLE
LSTC/STD/GNA/529: MATERIAL LIST
LSTC/STD/GNA/555: BOLT LENGTH DETERMINATION
 4. IMPORTANT: REFER TO LSTC/STD/GNA/779 SHEETS 1 TO 4 FOR FOUNDATION DESIGN CRITERIA.
- SHT 1 : SOIL CLASSIFICATIONS & POLE EMBEDMENT DETAILS.
SHT 2 : FOUNDATION DETAILS / STRUCTURE TYPES.
SHT 3 : FACTORS OF SAFETY.
SHT 4 : OUTLINE DESIGN FOR "VERY POOR" SOIL FOUNDATIONS.

CLIENT	PowerSystems	TITLE	SCALE 1:60 (UNLESS OTHERWISE STATED)		ORIGINAL SIZE	A4	LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617
			DATE	16/05/05	CHECKED	GS	
SPECIFICATION	OHL-03-132		DRAWN	R.F.	APPROVED	PP	
			DRAWING NUMBER		REV		
			LSTC/STD/GNA/811		3		