


* MINIMUM DISTANCE BETWEEN FACE OF EXCAVATION & STRUCTURE TO ALLOW ACCESS TO PLACE GRANULAR FILL & COMPACT

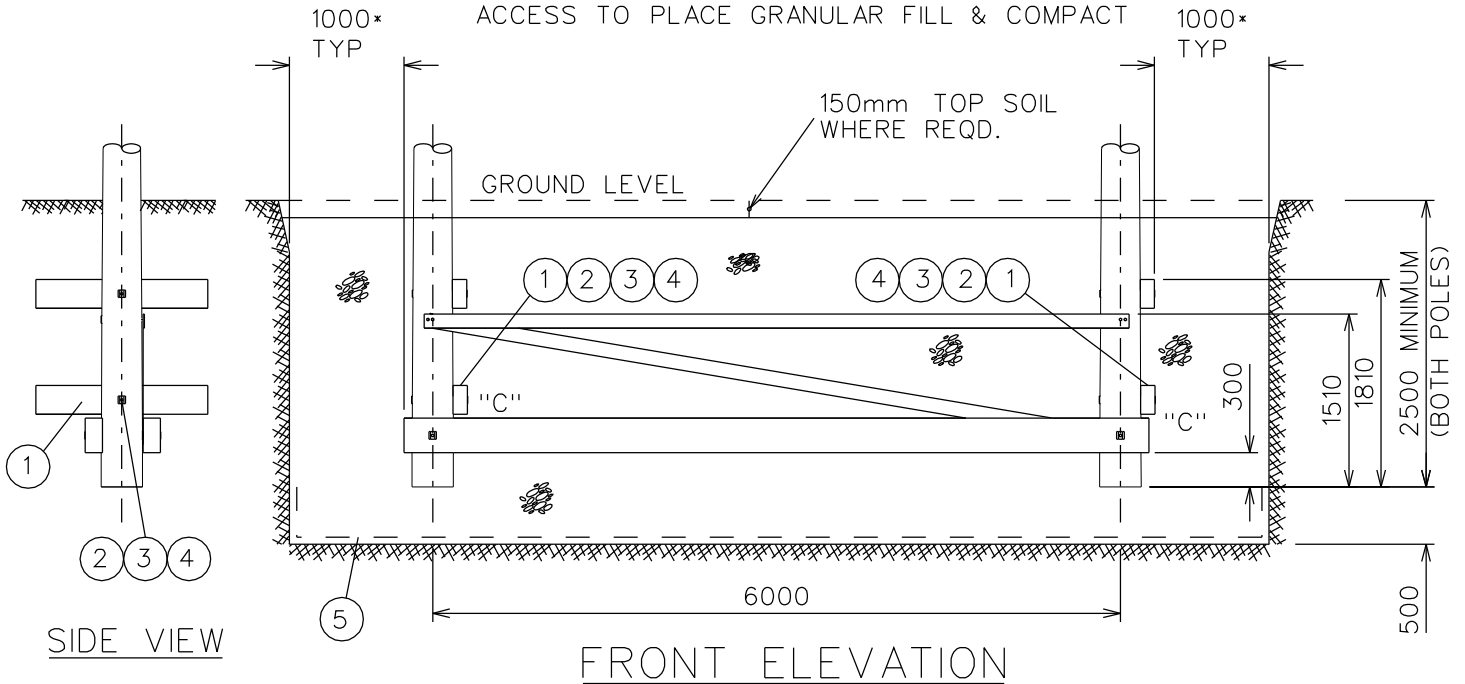

	ITEM - DESCRIPTION	REFERENCE No.	QTY REQ'D	WEIGHT EACH (Kg)	REMARKS
1	Foundation Block	LSTC/STD/PAR/602	2	40	Foundation Block "C" in addition to LSTC/STD/GNA/527
2	M20 Bolts x Length To Suit Pole Diameter	LSTC/STD/GNA/555	2	0.5	M20 Bolts to attach additional Foundation Block "C"
3	Square Flat Washer	LSTC/STD/PAR/619	2	0.1	
4	Square Curved Washer	LSTC/STD/PAR/620	2	0.2	
5	Geotextile Membrane		1	--	Place in Bottom of Excavation Prior to Granular Backfill
Total Additional Calculated Weight = 82Kg					

GENERAL NOTES:

- ALL STEELWORK TO BE PROTOTYPE CHECK ERECTED PRIOR TO MASS PRODUCTION.
 - ALL DIMENSIONS ARE IN MILLIMETRES.
 - NO ADDITIONAL ITEMS REQUIRED WHEN "VERY POOR" SOIL CONDITIONS ARE ENCOUNTERED. FOUNDATIONS TO HAVE MINIMUM EMBEDMENT DEPTH OF 2.5M.
TO BE READ IN CONJUNCTION WITH:
LSTC/STD/GNA/527: FAILURE CONTAINMENT WOOD POLE
LSTC/STD/GNA/529: MATERIAL LIST
LSTC/STD/GNA/555: BOLT LENGTH DETERMINATION
 - IMPORTANT: REFER TO LSTC/STD/GNA/779 SHEETS 1 TO 4 FOR FOUNDATION DESIGN CRITERIA.
- SHT 1 : SOIL CLASSIFICATIONS & POLE EMBEDMENT DETAILS.
SHT 2 : FOUNDATION DETAILS / STRUCTURE TYPES.
SHT 3 : FACTORS OF SAFETY.
SHT 4 : OUTLINE DESIGN FOR "VERY POOR" SOIL FOUNDATIONS.