


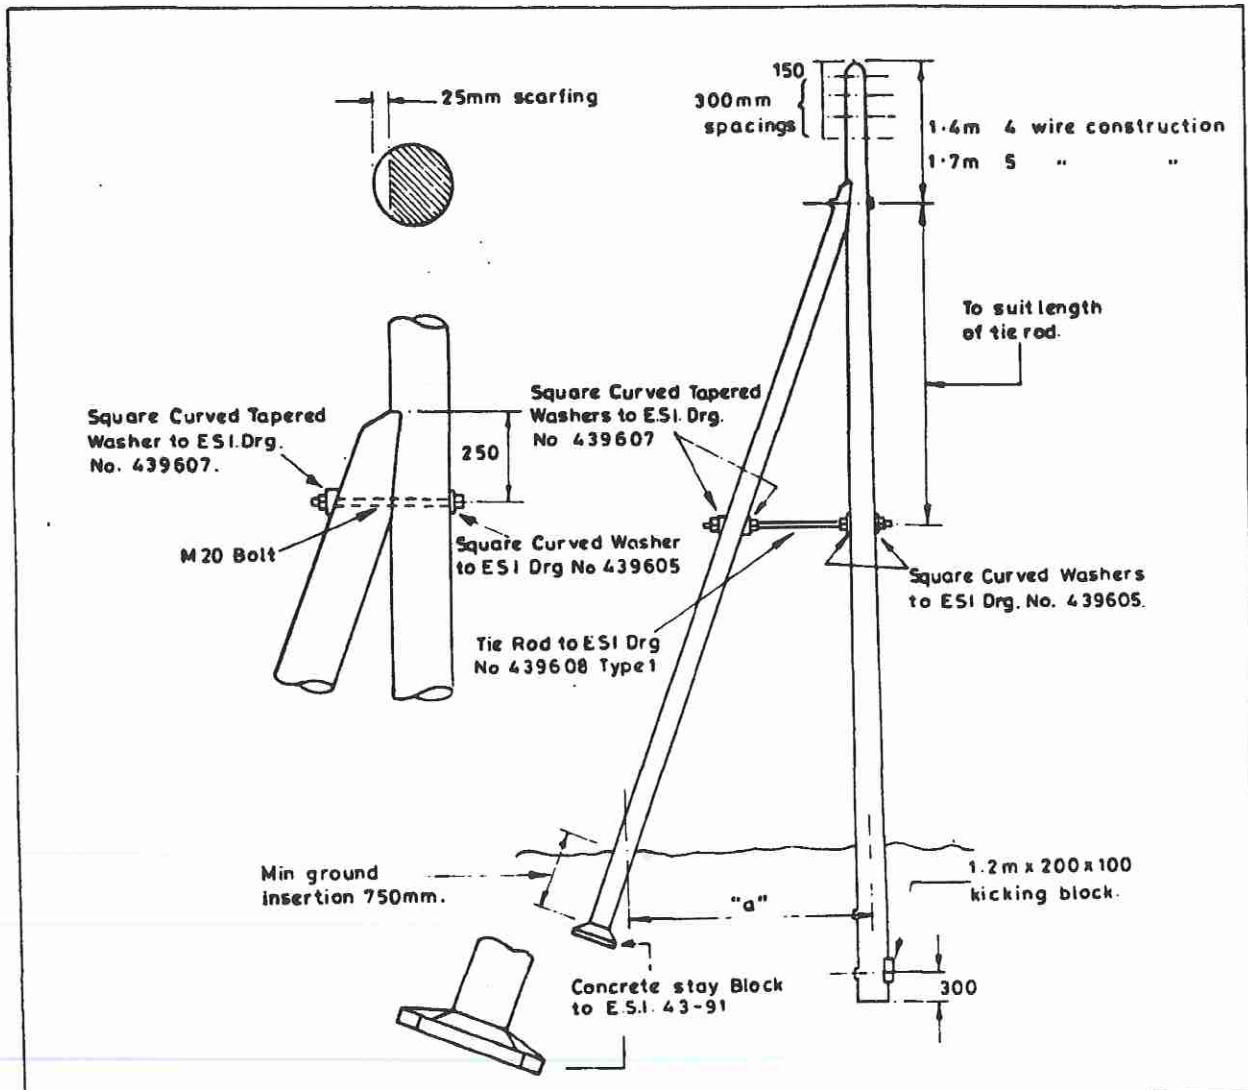

RECOMMENDED SUPPORT & STRUT SIZE

SITE CONDITIONS MUST BE TAKEN INTO CONSIDERATION AND CARE EXERCISED WHEN SELECTING KICKING AND COMPRESSION BLOCKS

Conductor Type and Size.	Line Deviation	MINIMUM POLE SIZES			MINIMUM STRUT SIZES			Dimension a
		Length (m)	Dia at Pole Top	Dia at 1.5m from Buttend	Length (m)	Dia at Pole Top	Dia at 1.5m from Buttend	
4x16mm ² Cu 4x25mm ² Al	Up to 15°	8.5	150	205	7.0	150	205	2.2m
		9.0	150	205	7.5	150	205	
		9.5	150	210	8.0	150	210	
		10.0	150	210	8.5	150	210	
		10.5	150	210	9.0	150	210	
4x32mm ² Cu 4x50mm ² Al	15° to 30°	8.5	165	230	7.0	165	230	2.3m
		9.0	165	235	7.5	165	235	
		9.5	165	240	8.0	165	240	
		10.0	165	245	8.5	165	245	
		10.5	165	245	9.0	165	245	
4x70mm ² Cu 4x100mm ² Al	Up to 15°	8.5	160	226	7.0	160	225	2.4m
		9.0	160	230	7.5	160	230	
		9.5	160	235	8.0	160	235	
		10.0	160	240	8.5	160	240	
		10.5	160	240	9.0	160	240	
	15° to 30°	8.5	175	240	7.0	175	240	2.5m
		9.0	175	245	7.5	175	245	
		9.5	175	250	8.0	175	250	
		10.0	175	255	8.5	175	255	
		10.5	175	255	9.0	175	255	

All dimensions in mm unless otherwise stated.

Fig. 15 Angle support using strut
(ESI Drawing 433015)