


- GENERAL NOTES:
- ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNO.
 - MILD STEEL GRADE 275JR TO BS EN 10025.
 - TIMBER SELECTION AND TREATMENT SHALL BE IN ACCORDANCE WITH ENATS 43-88.
 - BOLT SETS SHALL BE IN ACCORDANCE WITH NGS 3.4 TO BS 4190.
 - ALL STEELWORK TO BE HOT DIPPED GALVANISED TO BS EN 1461.
 - REMOVE ALL BURRS AND SHARP EDGES PRIOR TO GALVANISING.
 - ANY ON SITE DRILLED/CUT SURFACES TO BE CORROSION PROTECTED USING A MINIMUM 2 COATS OF GALVAFROID OR SIMILAR.
 - APPLY APPROPRIATE PROTECTIVE TREATMENT TO ALL SITE CUT/SCARFED/DRILLED TIMBER.
 - FOUNDATION CONSTRUCTION TO BE IN ACCORDANCE WITH ENATS 43-50 AND 43-125 EXCEPT WHERE STANDARDS HAVE BEEN SUPERSEDED OR AMENDED BY FURTHER INSTRUCTIONS OUTLINED ON THIS DRAWING.
 - THE CONTRACTOR IS TO ADOPT MEASURES TO KEEP THE OPEN EXCAVATION SUPPORTED AND FREE OF STANDING WATER UNTIL THE FOUNDATION HAS BEEN COMPLETED.
 - WHERE GROUNDWATER IS ABOVE EXCAVATION LEVEL, AND IT IS IMPRACTICAL TO KEEP THE EXCAVATION STABLE AND DRY DURING CONSTRUCTION, AN ALTERNATIVE SPECIAL FOUNDATION MAY BE REQUIRED.
 - GEOTEXTILE MEMBRANE TO BE PLACED IN BOTTOM AND UP SIDES OF EXCAVATION PRIOR TO BACKFILL.
 - BACKFILL SHALL BE GRANULAR FILL TO D.O.T. TYPE 1 OR 2 SPEC COMPACTED IN 300mm LAYERS TO ACHIEVE A BULK DENSITY OF 1750kg/m³.
 - ALL UNSUITABLE BACKFILL MATERIAL (i.e. PEATY SOIL, SOFT CLAY, SATURATED SANDLY CLAY) IS TO BE DISGARDED AND REPLACED WITH A GOOD QUALITY BACKFILL.
 - ANY OVERDIG TO FORM BATTERS AND STABLE SIDE SLOPES ARE TO BE BACKFILLED WITH COMPACTED MATERIAL AS SPECIFIED ABOVE.
 - ANY SOFT SPOTS AT FORMATION LEVEL TO BE EXCAVATED AND BACKFILLED AS SPECIFIED ABOVE.
 - STRUCTURES APPLICABLE TO HORIZONTAL GROUND PROFILES ONLY, FOR GROUND GRADIENTS ACROSS THE POLES REFER TO VERIFY SUITABILITY OF STRUCTURE.

CDM NOTES




- ONLY COMPETENT/EXPERIENCED CONTRACTORS SHALL BE APPOINTED TO UNDERTAKE THIS WORK.
- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE PROJECT SPECIFICATION, PRE CONSTRUCTION INFORMATION PACK (PCIP) AND ANY OTHER DOCUMENTS ISSUED BY THE CLIENT.
- THE CONTRACTOR SHALL HAVE ASSESSED ALL RISKS AND SHALL USE SAFE METHODS OF WORKING TO COMPLY WITH CURRENT HEALTH AND SAFETY LEGISLATION AND CDM REGULATIONS.
- THE CONTRACTOR SHALL HAVE TAKEN DUE COGNISANCE OF THE HAZARDS IDENTIFIED IN THE CONSTRUCTION PHASE HEALTH AND SAFETY PLAN AND DESIGN HAZARD INVENTORY
- RISK ASSESSMENT SHOULD INCLUDE BUT NOT BE LIMITED TO CONSIDERATION OF THE FOLLOWING :-
 - SAFE ACCESS AND EGRESS TO SITE
 - IDENTIFICATION OF BURIED SERVICES
 - DEMARCATON OF WORKING AREA
 - TEMPORARY WORKS DESIGN
 - WORK IN PROXIMITY TO LIVE CIRCUITS
 - WORK IN CONFINED SPACES
 - SAFE ACCESS AND EGRESS TO EXCAVATIONS
 - LIMITS OF APPROACH FOR VEHICLES
- REFERENCE SHOULD ALSO BE MADE TO HSE PUBLICATIONS :-
 - HSG47 AVOIDING DANGER FROM UNDERGROUND SERVICES
 - HSG185 HEALTH AND SAFETY IN EXCAVATIONS
 - HSG 150 HEALTH AND CONSTRUCTION
 - HSE CONSTRUCTION INFORMATION SHEET 8 - SAFETY IN EXCAVATIONS
 - HSE CONSTRUCTION INFORMATION SHEET 47 - INSPECTIONS AND REPORTS
 - HSE GUIDANCE NOTE GS6 - AVOIDANCE OF DANGER FROM OVERHEAD ELECTRIC LINES

DESCRIPTION
BRACE BLOCK / BAULK ARRANGEMENTS MODIFIED

REV	DATE	BY	CHKD	APPD
B	28/10/13	MA	SP	MJ

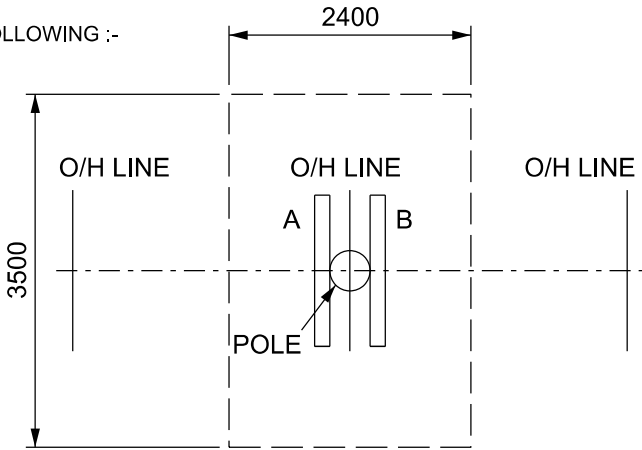

PLAN VIEW
TYPICAL FOUNDATION DETAILS
FOR SINGLE POLE INTERMEDIATE STRUCTURE

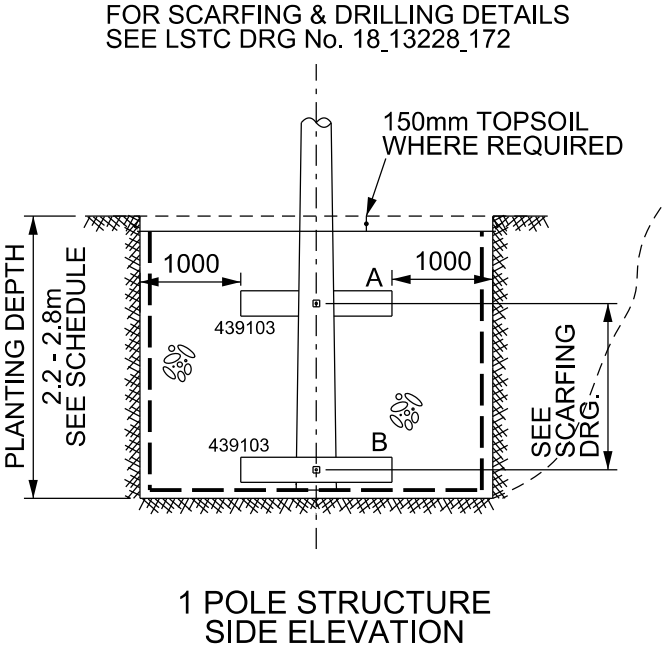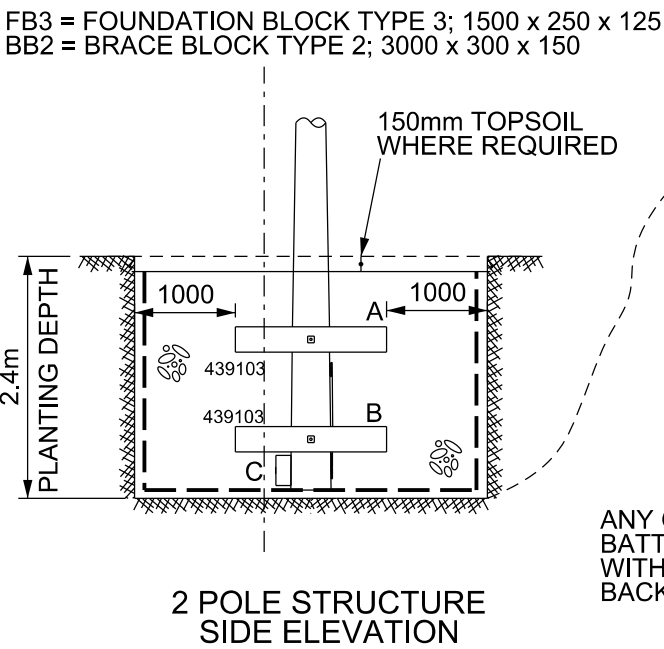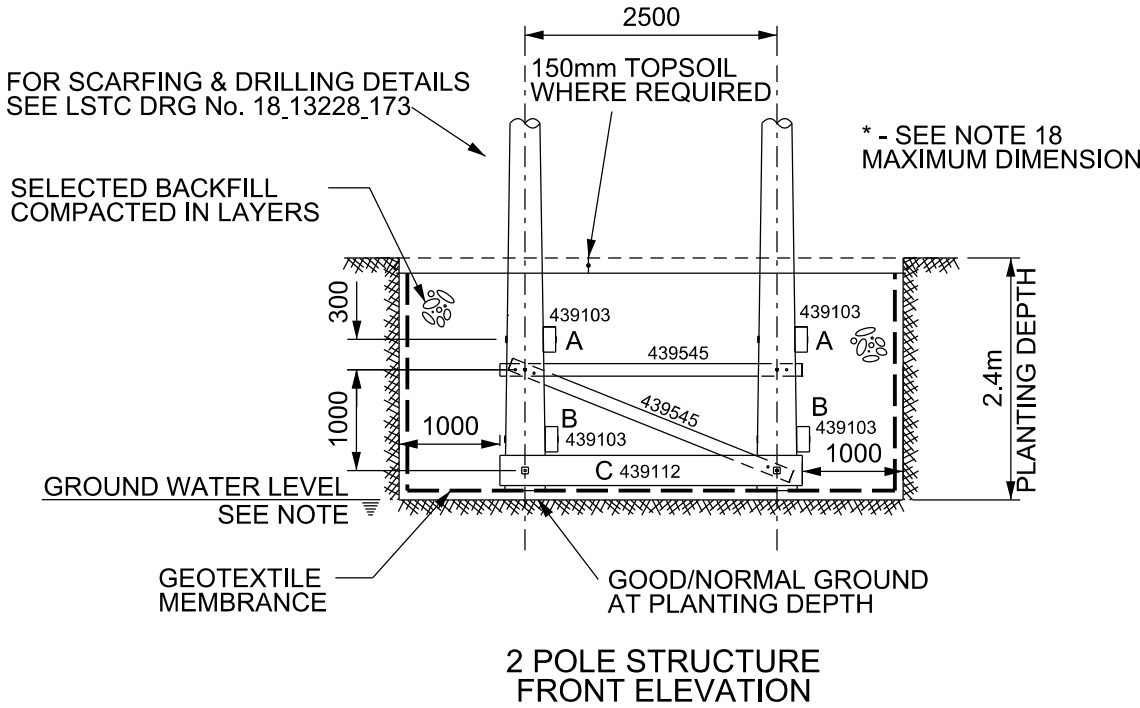

SUPERSEDES 16-10331-01

LSTC North:
Yorkshire House
York Road
Little Driffield
East Yorkshire
YO25 5XA
Tel 01377 253617
Fax 01377 259555

LSTC South:
Bourne House
Office 21
475 Godstone Road
Whyteleafe
Surrey
CR3 0BL
Tel 01883 621114

GENERAL NOTES:

LS Transmission Consultancy Limited makes no warranties, express or implied, that compliance with this drawing, or any other document issued by LSTC, would in itself be sufficient to ensure safe systems of work or operation. Users are reminded of their own duties under health and safety legislation.

CLIENT

electricity
north west

WHITEBIRK DRIVE
WHITEBIRK
BLACKBURN
BB1 3HT
Tel: 01254 688917

PROJECT

KIRKBY ORRELL

TITLE

FOUNDATION FOR ALL POLE
STRUCTURES IN POOR/VERY POOR
GROUND WITH NORMAL/GOOD
GROUND CONDITIONS AT PLANTING
DEPTH

SCALE	N.T.S. (UNLESS OTHERWISE STATED)	DESIGNED	MV
DATE	08/05/13	CHECKED	SP
DRAWN	MA	APPROVED	MJ
ORIGINAL SIZE	A3	DRAWING NUMBER	16_13228_115
		REV	B