


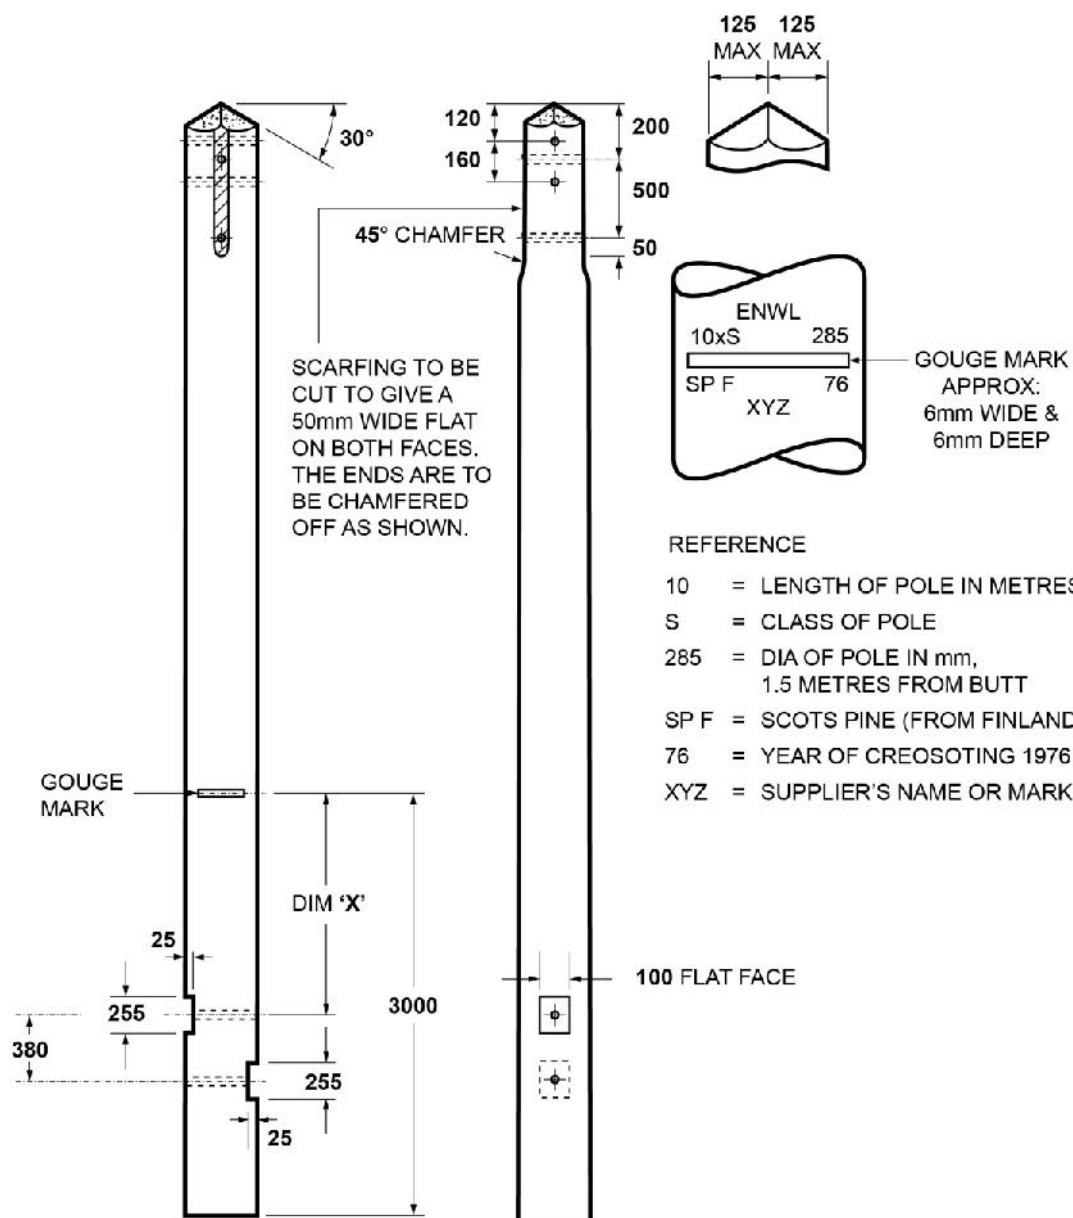

POLE TOP SHALL BE QUARTERED
BAULK CUTS AND DRILLINGS SHALL BE
90° TO POLE TOP SCARFING AND
DRILLING AS SHOWN

WOOD POLE FABRICATION
(ES40002 AND ES40003),
SINGLE POLE

Change information for this issue
Converted to one sheet –
text separated from drawing

Appears in
ES400W2

Electricity
north west

I-400W2-FAB-001 Iss 8 sht 1 of 1

Scale: nts Auth: DMT Date: 20/01/2012

NOTES ON DRAWING I-400W2-FAB-001

1. Foundation blocks shall be selected and ordered separately. Refer to ES400O2 or ES400O3 as appropriate.
2. This fabrication is for use with all single pole structures.
3. The pole butt shall be cut at right angles to the vertical axis of the pole.
4. All cutting, drilling and scarfing shall be done using a template prior to preservation treatment.
5. All holes shall be 22mm diameter and drilled at right angles to the vertical centre line of the pole.
6. Pole size and grade shall be impressed on the butt.
7. To accommodate wood blocks, the scarfing shall be cut to provide a 100mm face.
8. Pole length/Dimension "X" and Planting Depth:

Pole Length (m)	Dimension 'X' (mm)	Planting Depth (mm)
9, 10, 11, 12	1700	1800
13, 14, 15, 16, 17, 18	1100	2400
20, 22, 24	500	3000

9. The pole top dimensions shown on the drawing (125 (max)) are from pole centre to scarfed face.