


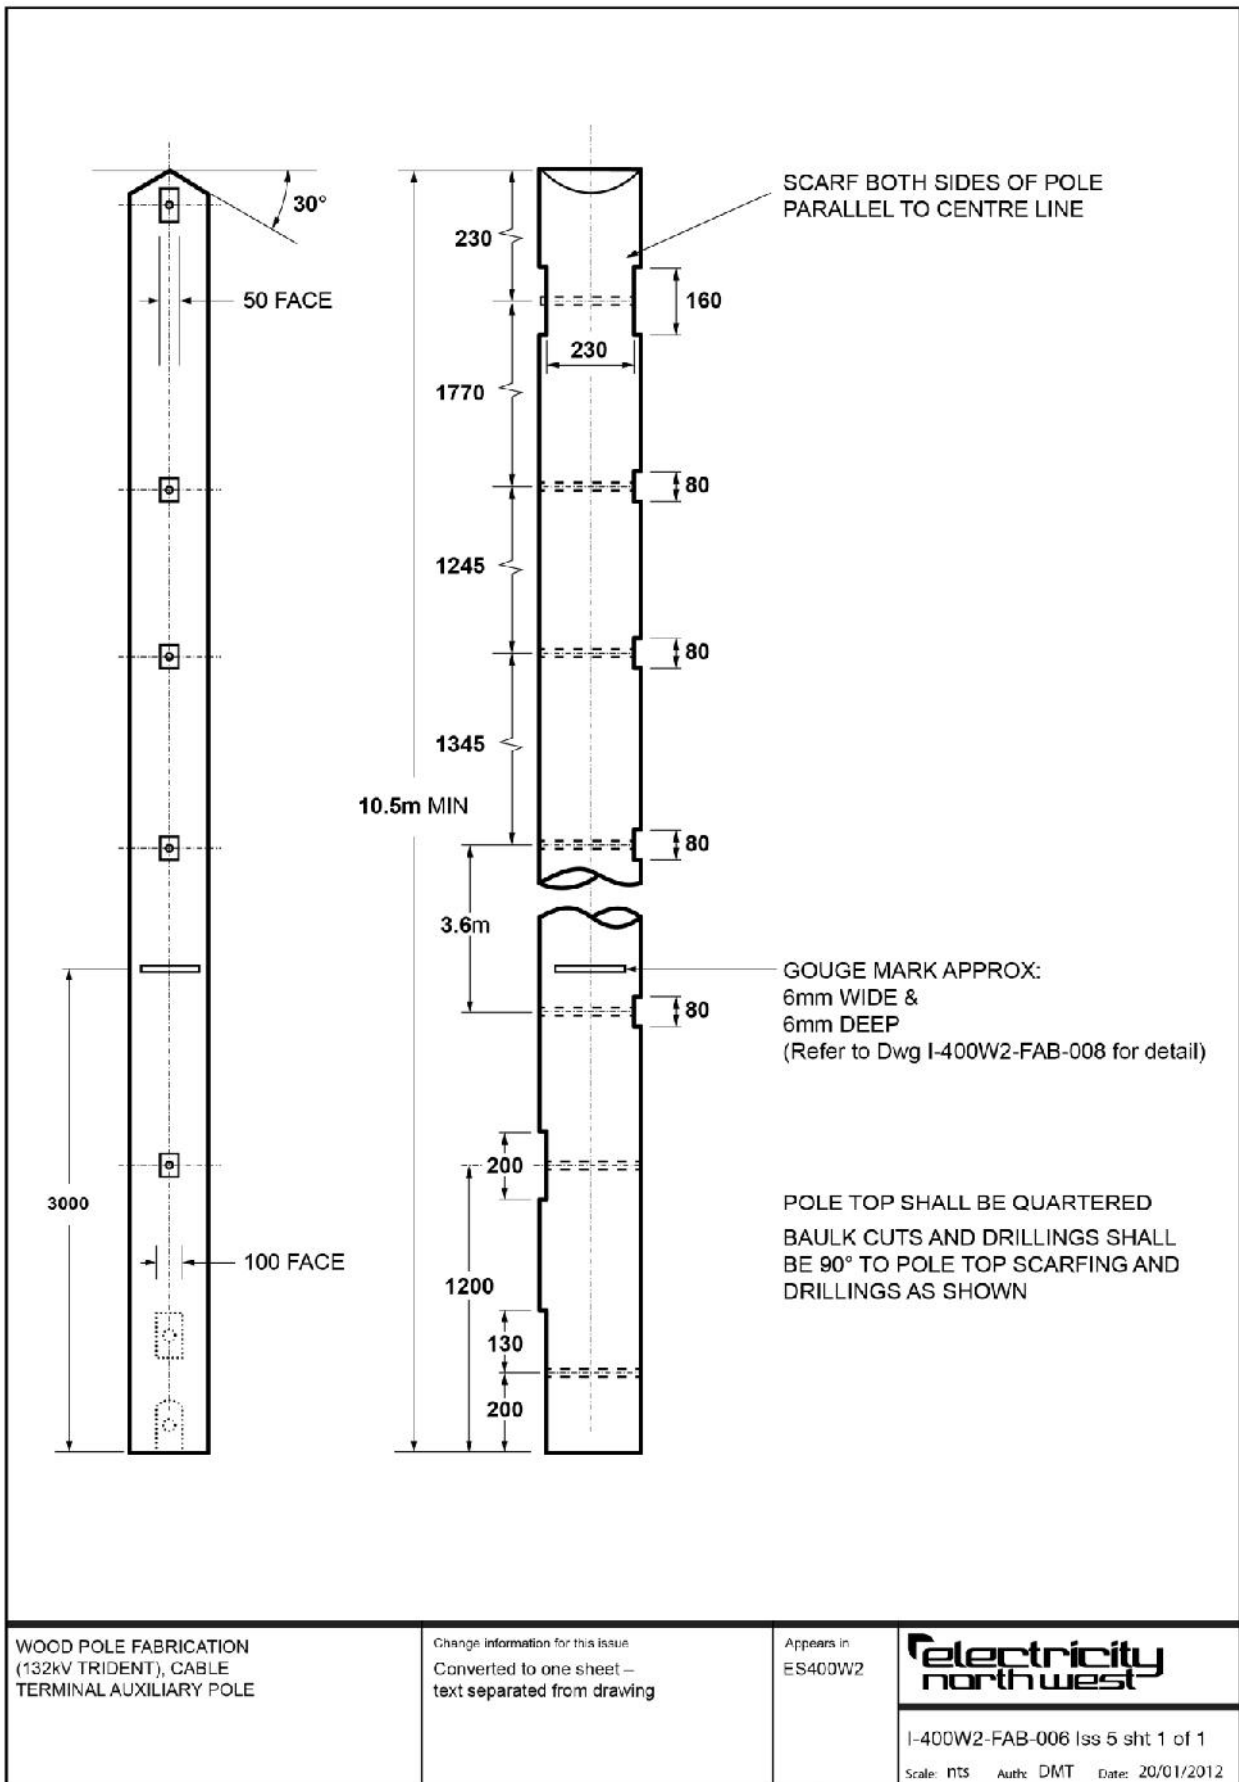

NOTES ON DRAWING I-400W2-FAB-006

1. Brace blocks shall be selected and ordered separately. Refer to the general arrangement drawing in ENA TS 43-50.
2. This fabrication is for use as part of a pole mounted cable termination arrangement (refer to ENA TS 43-50).
3. Individual poles shall be matched to form the auxiliary pair.
4. The pole butt shall be cut at right angles to the vertical axis of the pole.
5. All cutting, drilling and scarfing shall be done using a template prior to preservation treatment.
6. All holes shall be 22mm diameter and drilled at right angles to the vertical centre line of the pole.
7. Pole size and grade shall be impressed on the butt of each pole.