

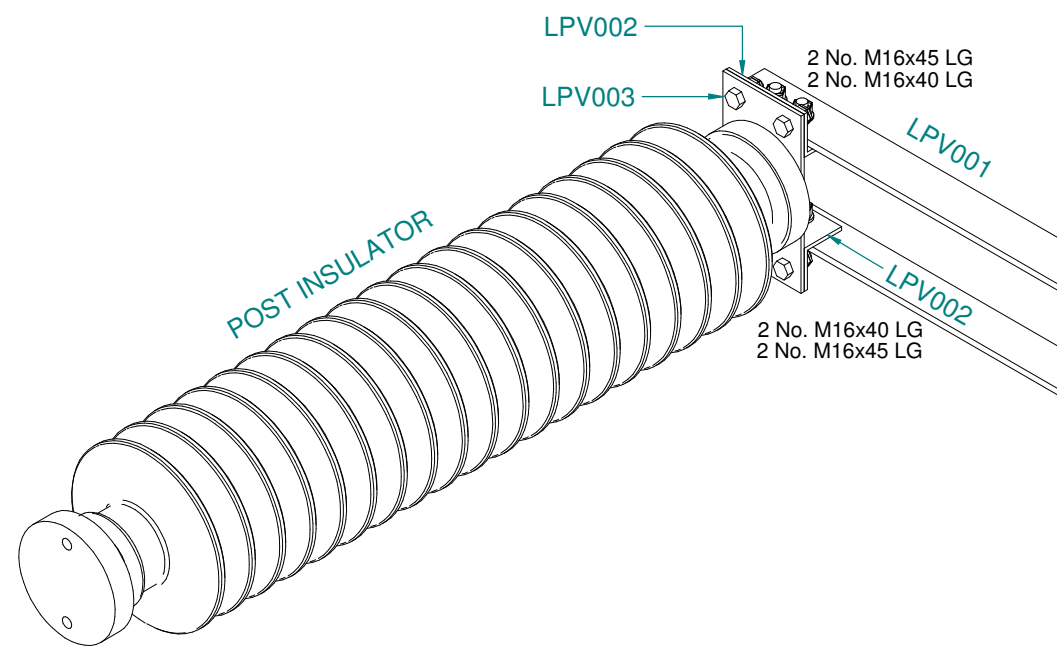


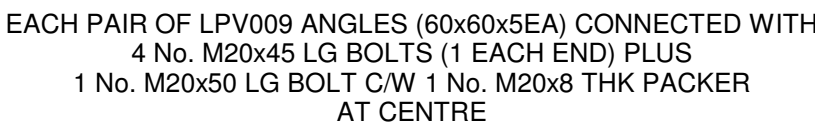

REV	DATE	BY	CHKD	APPD
B	11/09/2015	MA	RF	GY
SEALING				
DESIGN ENDOS & SURGE ARRESTERS PLUS MOUNTING AMYD				
GENERAL NOTES:				
1. ALL DIMENSIONS ARE IN MILLIMETRES (mm) U.N.O.				
2. MATERIAL :				
HIGH TENSILE STEEL - Suffixed (HTS) : - Grade S355JR TO BS EN ISO 10025 (<19mm THICK) - Grade S355J0 TO BS EN ISO 10025 (>=19mm THICK)				
MILD STEEL - Suffixed (MS) : - Grade S275JR TO BS EN 10025				
3. METRIC BOLT SETS IN ACCORDANCE WITH NGTS 3.4.14 ISSUE 4 & 3.4.16 ISSUE 2 TO BS EN ISO 898-1 (GALVANISED)				
- HIGH TENSILE BOLT SETS c/w PALNUTS (Comprising of the following): 1 x BOLT (Grade 9.8) 1 x FULL HEX HEAD NUT (Grade 8) 1 x 4mm THICK WASHER 1 x PALNUT				
- HIGH TENSILE BOLT SETS c/w LOCKNUTS (Comprising of the following): 1 x BOLT (Grade 9.8) 1 x FULL HEX HEAD NUT (Grade 8) 1 x 4mm THICK WASHER 1 x FULL HEX HEAD LOCKNUT (Grade 8)				
4. REMOVE ALL BURRS & SHARP EDGES PRIOR TO GALVANISING.				
5. GALVANISING IN ACCORDANCE WITH BS EN ISO 1461 (MIN. COATING THICKNESS IN ACCORDANCE WITH TABLE D.1)				
6. ALL BARS TO CLEARLY STAMPED WITH ERECTION MARKS FOR SITE IDENTIFICATION. (BAR MARK "LPV").				
7. FOR MATERIAL LIST SEE DOCUMENT NO. :-				
ENATS 435013 ENATS 435015 19_15098_12				
8. FOR PIECE SMALL DETAIL & DRAWING REGISTER SEE DRAWING No. :-				
19_15098_11 ENATS 43-95				
9. FOR WOOD POLE SCARFING AND DRILLING DETAILS SEE DRAWING No. :-				
19_15098_10 for 435004A AND DISCONNECTOR SUPPORT POLE ENATS 43-50 for 435004S				
10. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ENATS 435013 AND ENATS 435015 AS WELL AS ANY STEELWORK DETAIL DRAWING IDENTIFIED THEREIN.				
ENATS 435015 STEELWORK SHOWN ON THIS DRAWING IS TO BE ORDERED IN ACCORDANCE WITH THOSE DRAWINGS, EXCEPT WHERE SUCH STEELWORK IS MARKED (ADDITIONAL) WHEREUPON IT MUST BE ORDERED IN ADDITION TO THE QUANTITIES IDENTIFIED IN THOSE DRAWINGS AND IS TO BE FITTED IN MATERIAL LIST NO. 19_15098_12.				
11. FOR THE PURPOSE OF SAFETY, ALL HORIZONTAL PLAN MEMBERS CONNECTED BY BOLTS IN THE VERTICAL PLANE, SHALL BE FITTED WITH NGTS 3.4.14.				
13. ALL SITE DRILLED HOLES & CUT MEMBERS TO BE CORROSION PROTECTED USING TWO COATS OF GALVAFROID OR A SIMILAR PRODUCT.				
14. FOR STEELWORK INFORMATION, SEE SHEET 2.				
IF IN DOUBT ASK ENGINEER / DESIGN OFFICE				
				
VIEW CONVENTION THIRD ANGLE				
THIS DRAWING IS THE EXCLUSIVE PROPERTY OF LSTC LTD THE CONTENTS OF THE DRAWING MUST BE TREATED AS STRICTLY CONFIDENTIAL AND MUST NOT BE DISCLOSED TO ANY THIRD PARTY WITHOUT LSTC LTD WRITTEN CONSENT. USE ONLY FOR THE PURPOSE FOR WHICH IT WAS LOANED. NO COPYING OR REPRODUCING, RETURN ON REQUEST.				
LS TRANSMISSION PROJECTS LIMITED MAKES NO WARRANTIES, EXPRESS OR IMPLIED, THAT COMPLIANCE WITH THIS DRAWING, OR ANY OTHER DOCUMENT ISSUED BY LSTC, WOULD IN ITSELF BE SUFFICIENT TO ENSURE SAFE SYSTEMS OF WORK OR OPERATION. USERS ARE REMINDED OF THEIR OWN DUTIES UNDER HEALTH AND SAFETY LEGISLATION.				
CLIENT				
				
PROJECT				
LYNEHAM P.V. FARM				
TITLE				
ARRANGEMENT / ERECTION DIAGRAM FOR 132KV 6-POLE TERMINAL STRUCTURE WITH MOUNTED DISCONNECTOR				
SCALE		1:50 U.N.O.		
DESIGNED		IS		
DATE		09/09/2015		
CHECKED		RF		
DRAWN		MA		
APPROVED		GY		
				
LSTC North: Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA Tel 01377 253617 Fax 01377 259555				
LSTC South: Bourne House Office 21 475 Gostdown Road Whyteleafe Surrey CR3 0BL Tel 01883 221114				
ORIGINAL SIZE	DRAWING NUMBER			REV
A1	15_15098_09 (1 of 2)			B

