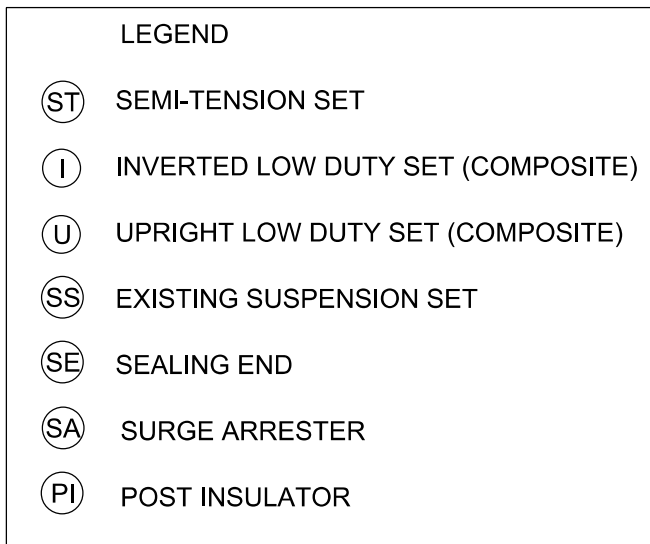


IMPORTANT NOTE:

DOWNLEAD CLEARANCES HAVE BEEN DERIVED USING THE CONDUCTOR SAGGING BASIS AND SAGS SPECIFIED IN NOTE 5. THESE SAGS TAKE INTO ACCOUNT THE NOMINAL WEIGHT OF THE GENERIC INSULATOR STRING.

ALL CLEARANCES MUST BE CHECKED DURING INSTALLATION AS ANY DEVIATION FROM THE SPECIFIED SAGS MAY RESULT IN REDUCED ELECTRICAL CLEARANCES.

- CDM NOTES**
1. ONLY COMPETENT/EXPERIENCED CONTRACTORS SHALL BE APPOINTED TO UNDERTAKE THIS WORK.
 2. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH PROJECT SPECIFICATION AND ANY OTHER DOCUMENTS ISSUED BY THE CLIENT.
 3. CONTRACTOR SHALL CONSIDER ALL PHASES OF WORK AND ENSURE LIMITS OF APPROACH ARE ADHERED TO WHEN LIVE ELECTRICAL EQUIPMENT IS IN PLACE.
 4. CONTRACTOR SHALL ADHERE TO ALL ELECTRICITY COMPANIES OPERATIONAL PROCEDURES. MANUFACTURERS RECOMMENDED & INSTALLATION PROCEDURES FOR PLANT AND MATERIALS.
 5. CONTRACTOR SHALL HAVE ASSESSED RISKS AND USE SAFE METHODS OF WORKING TO COMPLY WITH CURRENT HEALTH AND SAFETY LEGISLATION AND CDM REGULATIONS.
 6. THE CONTRACTOR SHALL HAVE TAKEN DUE COGNISANCE OF THE HAZARDS IDENTIFIED IN THE DESIGN HAZARD INVENTORY AND HEALTH AND SAFETY ANALYSIS, PARTICULARLY MEN WORKING AT HEIGHT AND ELECTROCUTION AND SHALL HAVE IMPLEMENTED MITIGATION MEASURES TO REDUCE RISKS TO ACCEPTABLE LEVEL.