


DESCRIPTION		FIRST ISSUE							
REV	A	DATE	04/08/15	BY	JDH	CHKD	OC	APPD	KM

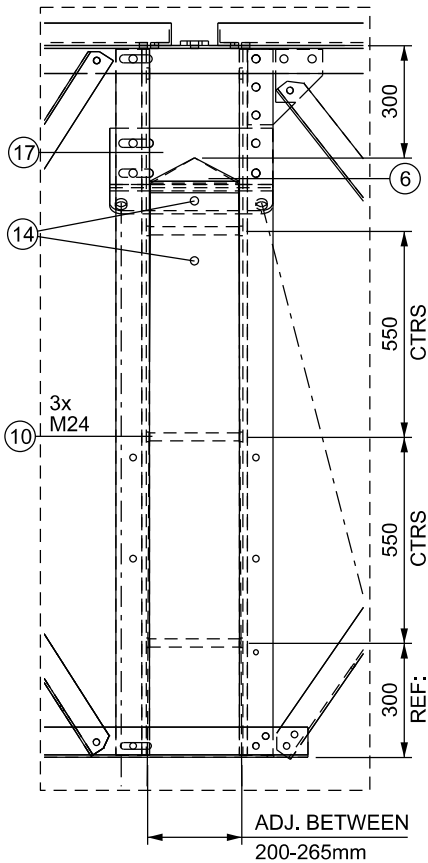

ENLARGED DETAIL 'A'

STAYS INSTALLED AT TRUE VERTICAL ANGLE OF 45° - UNLESS OTHERWISE STATED


- (45) OPERATIONAL PLATES AND DEVICES TO USERS REQUIREMENTS
(46) POSITION MIN. 3000mm ABOVE GROUND LEVEL
(47)

ALTERNATIVE U/GROUND CABLE ARRANGEMENT WITH REDUCED BEND RADIUS SHOWN DOTTED

GROUND LEVEL

GENERAL NOTES

1. FOR PLAN & ISOMETRIC VIEW SEE DRAWING 15_15229_40
2. FOR SIDE ELEVATION SEE DRAWING 15_15229_42
3. FOR MATERIAL LIST SEE 19_15229_43
4. OPGW TO BE INSTALLED ON THE SAME SIDE OF STRUCTURES THROUGHOUT. NO CROSSING OF OPGW AND PHASE CONDUCTORS PERMITTED.

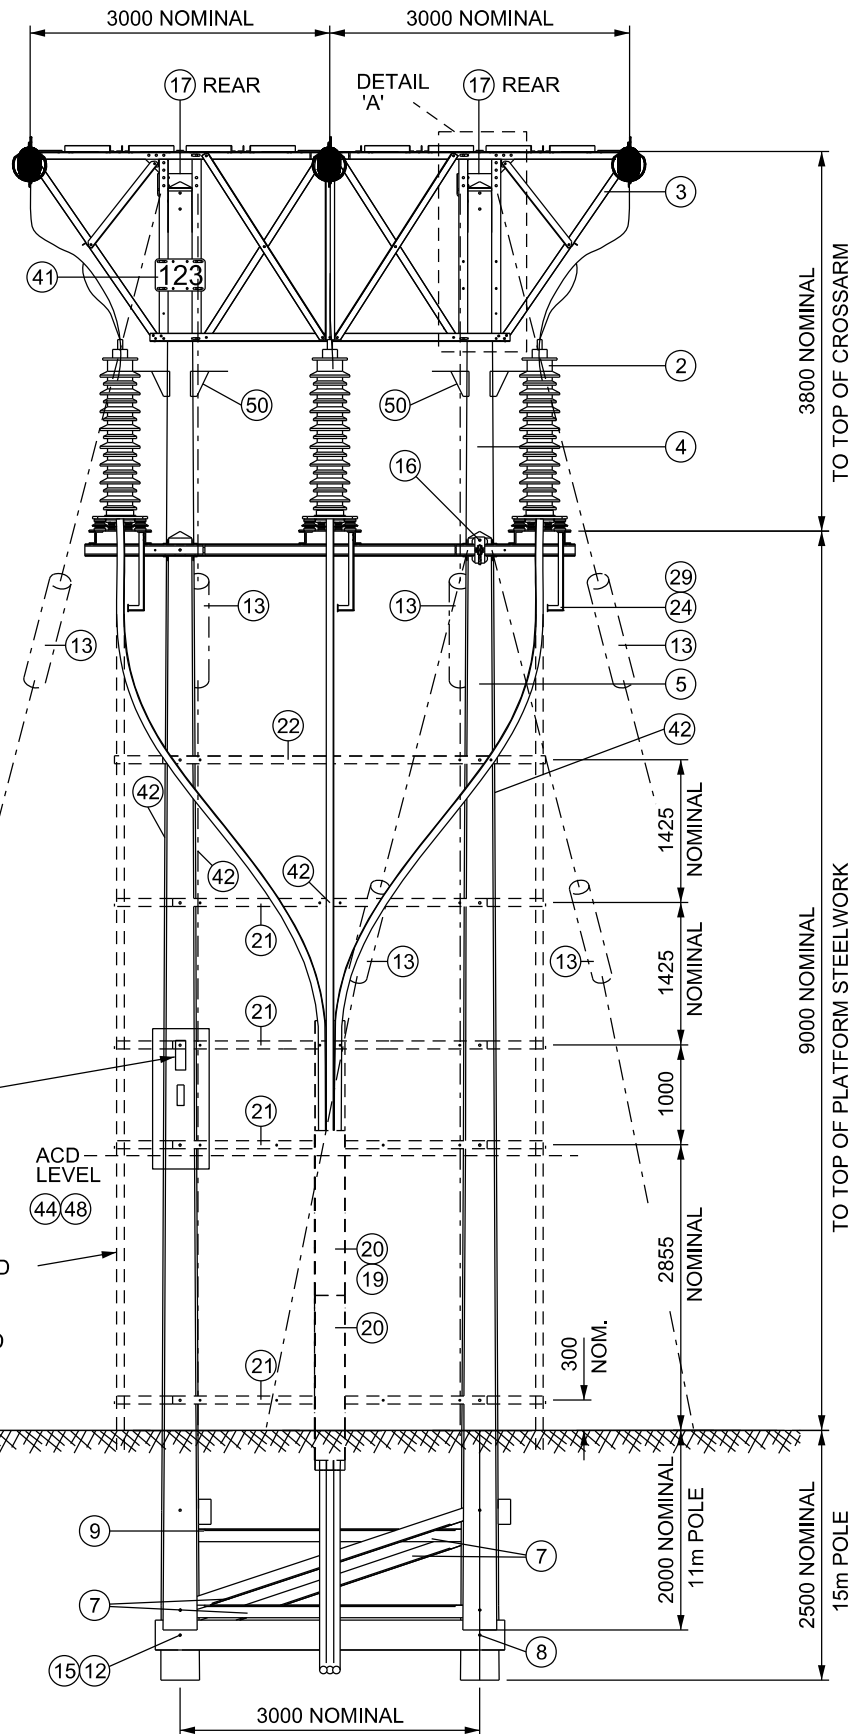

FRONT ELEVATION

ALL CABLE FIXINGS, SUPPORTS AND GUARDING TO BE SPECIFIED AND SUPPLIED BY CABLE CONTRACTOR

CLIENT	KTL
SPECIFICATION	CUMNOCK - DESALLOCH ROUTE

TITLE	GA - FRONT ELEVATION 0° ENTRY / TERMINAL 4 POLE STRUCTURE
-------	--

SCALE	1 : 75 (UNLESS OTHERWISE STATED)	ORIGINAL SIZE	A4
DATE	04/08/15	CHECKED	OC
DRAWN	JDH	APPROVED	KM
DRAWING NUMBER	15_15229_41	REV	A

LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617
