
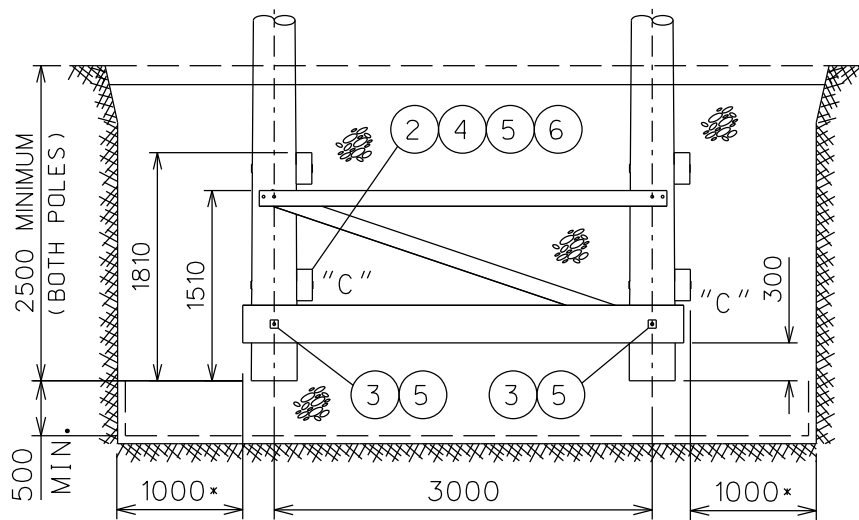


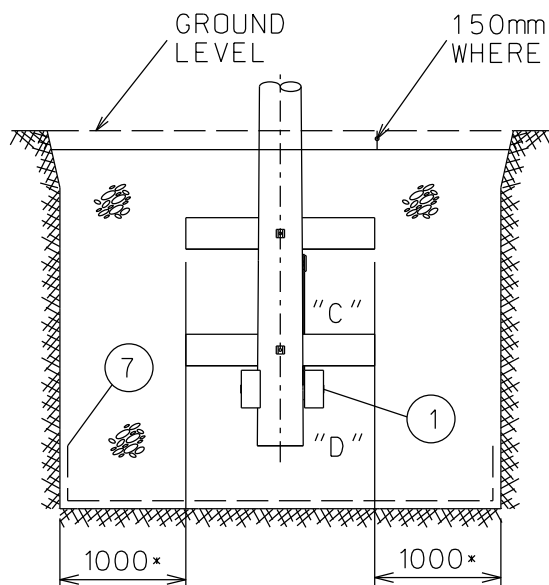

DESCRIPTION		FIRST ISSUE			
REV	DATE	BY	CHKD	APPD	KM
A	15/09/15	JDH	OC		

* MINIMUM DISTANCE BETWEEN FACE OF EXCAVATION & STRUCTURE TO ALLOW ACCESS TO PLACE GRANULAR FILL & COMPACT

ITEM - DESCRIPTION	REFERENCE No.	QTY REQ'D	WEIGHT EACH (kg)	REMARKS
1 "H" Pole Timber Baulk	LSTC/STD/PAR/601	1	135	Timber Baulk "D" in addition to 15_15229_59
2 Foundation Block	LSTC/STD/PAR/602	2	42	Foundation Block "C" in addition to 15_15229_59
3 M20 Bolts x Length To Suit Pole Diameter	LSTC/STD/GNA/555	2	0.5	M20 Bolts to attach additional Timber Baulk "D" to Foundation
4 M20 Bolts x Length To Suit Pole Diameter	LSTC/STD/GNA/555	2	1.5	M20 Bolts to attach additional Foundation Block "C"
5 Square Flat Washer	LSTC/STD/PAR/619	4	0.1	Flat Washers in addition to 15_15229_59
6 Square Curved Washer	LSTC/STD/PAR/620	2	0.2	Curved Washers in addition to 15_15229_59
7 Geotextile Membrane	--	1	--	Place in Bottom of Excavation Prior to Granular Backfill
8				

Total Additional Calculated Weight = 225Kg

GENERAL NOTES:

- ALL STEELWORK TO BE PROTOTYPE CHECK ERECTED PRIOR TO MASS PRODUCTION.
- ALL DIMENSIONS ARE IN MILLIMETRES.
- MATERIAL LIST INDICATES ADDITIONAL ITEMS REQUIRED WHEN "VERY POOR" SOIL CONDITIONS ARE ENCOUNTERED. THESE FOUNDATIONS CAN ONLY BE INSTALLED IN LEVEL GROUND. TO BE READ IN CONJUNCTION WITH:
15_15229_59: 20-35° ANGLE STRUCTURE
19_15229_61: MATERIAL LIST
LSTC/STD/GNA/555: BOLT LENGTH DETERMINATION
- IMPORTANT:** REFER TO LSTC/STD/GNA/779 SHEETS 1 TO 4 FOR FOUNDATION DESIGN CRITERIA.

SHT 1 : SOIL CLASSIFICATIONS & POLE EMBEDMENT DETAILS.
SHT 2 : FOUNDATION DETAILS / STRUCTURE TYPES.
SHT 3 : FACTORS OF SAFETY.
SHT 4 : OUTLINE DESIGN FOR "VERY POOR" SOIL FOUNDATIONS.

CLIENT 	TITLE ADDITIONAL MATERIAL 20-35° ANGLE STRUCTURE VERY POOR SOIL CONDITIONS	SCALE 1:60 (UNLESS OTHERWISE STATED)	ORIGINAL SIZE A4	LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617 
		DATE 15/09/2015	CHECKED OC	
DRAWN JDH		APPROVED KM		
DRAWING NUMBER 16_15229_65		REV A		
SPECIFICATION CUMNOCK - DERSALLOCH ROUTE				