


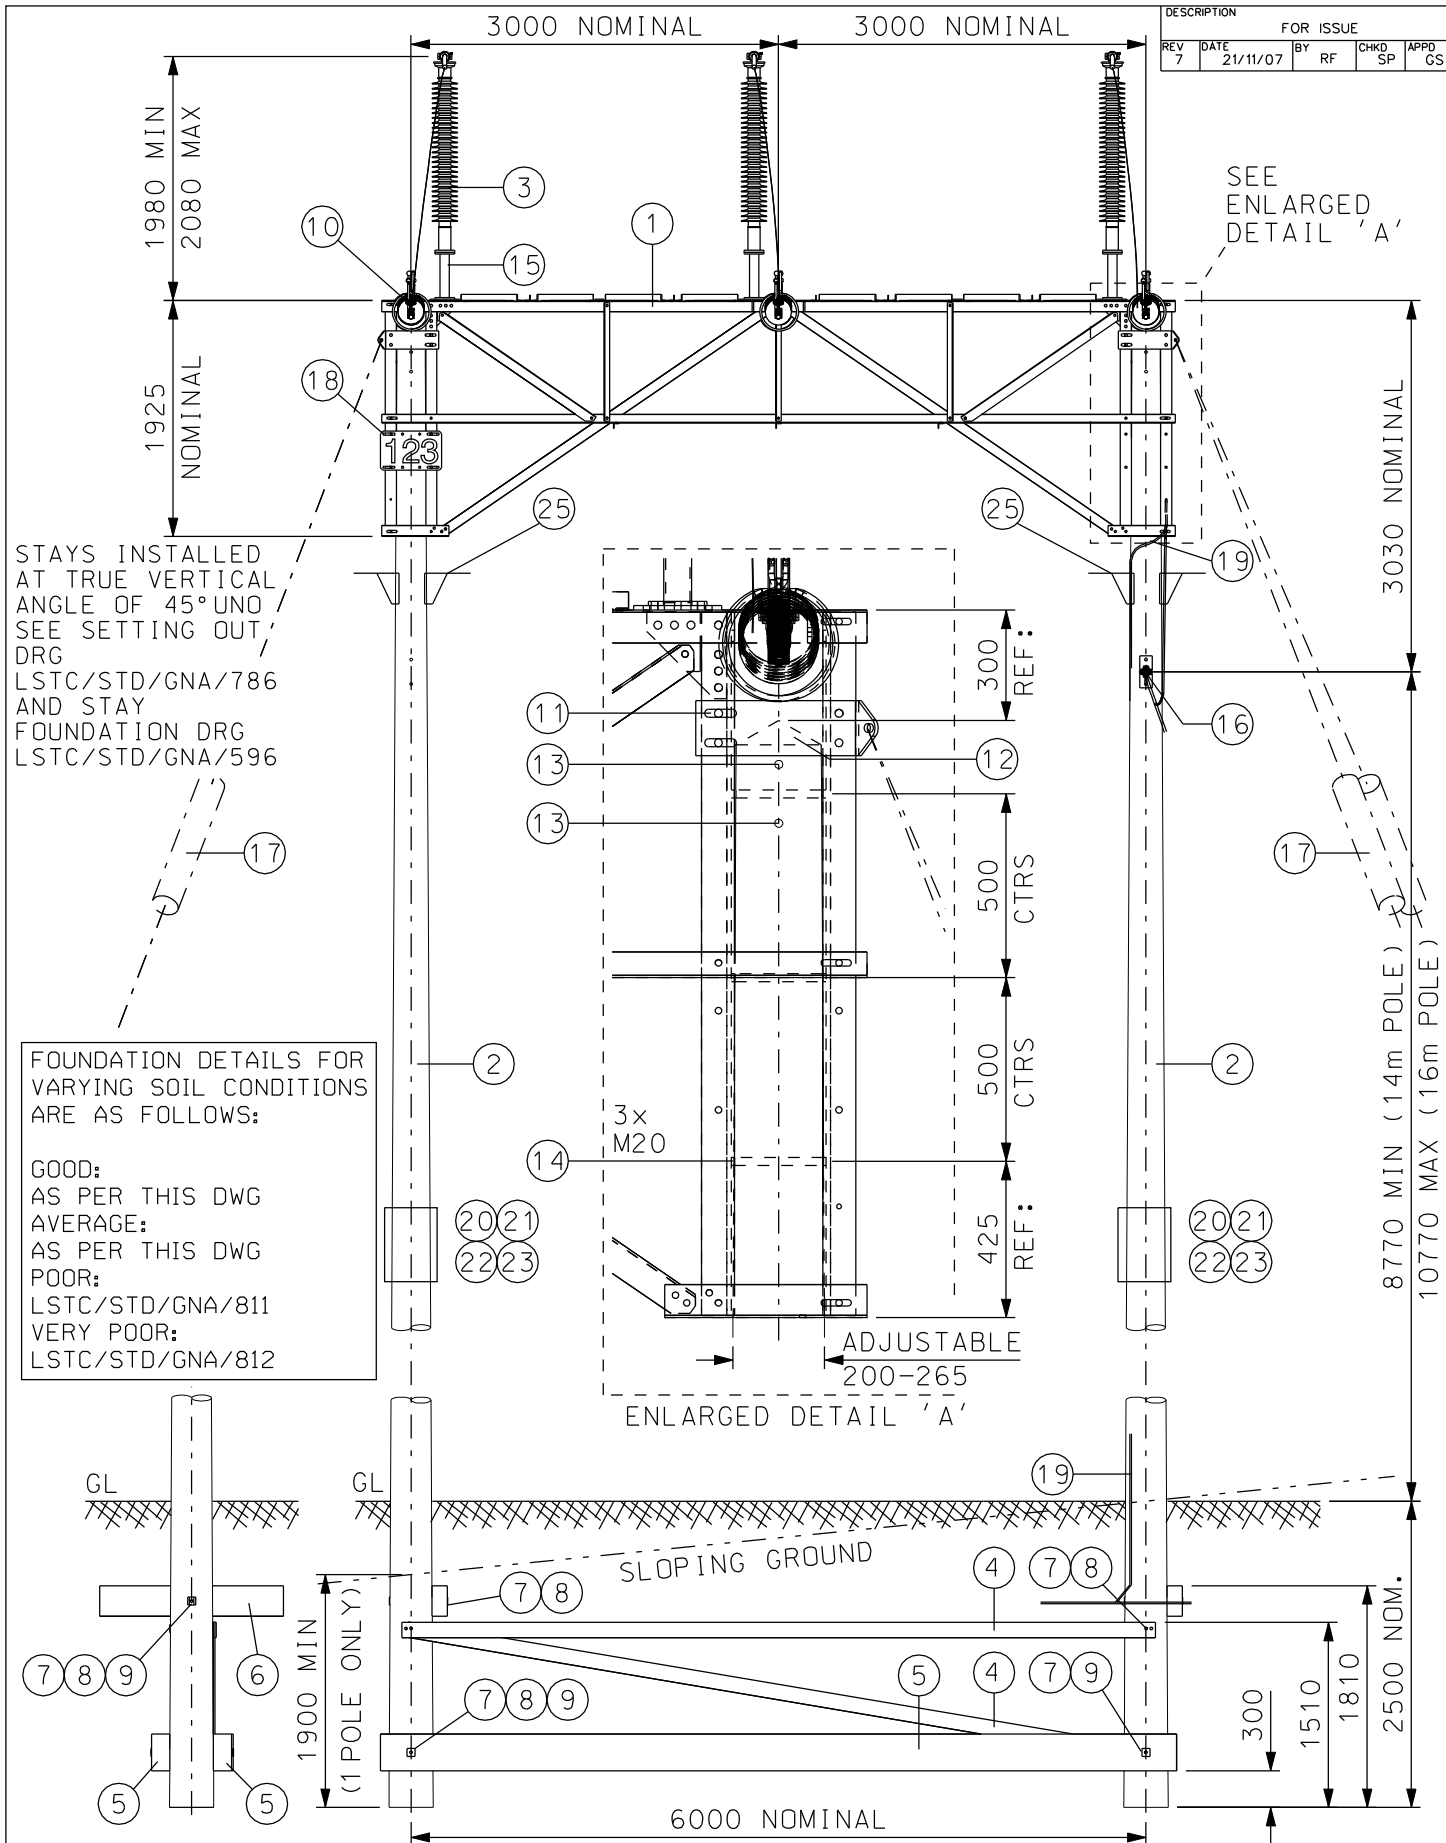

GENERAL NOTES:

1. ALL STEELWORK TO BE PROTOTYPE CHECK ERECTED BEFORE MASS PRODUCTION.
2. SAFETY SIGNS TO BE INSTALLED TO CONFORM TO POWER SYSTEMS PROCEDURES

3. FOR PLAN VIEW SEE LSTC/STD/GNA/528

4. FOR MATERIAL LIST SEE LSTC/STD/GNA/529

5. OPGW TO BE INSTALLED ON THE SAME SIDE OF STRUCTURES THROUGHOUT. NO CROSSING OF OPGW AND PHASE CONDUCTORS PERMITTED.

CLIENT	PowerSystems	TITLE	GA - 0° FAILURE CONTAINMENT STRUCTURE	SCALE (UNLESS OTHERWISE STATED) 1:60	ORIGINAL SIZE A4	LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617
SPECIFICATION	OHL-03-132			DATE 10/11/04	CHECKED GS	
				DRAWN R.T.J	APPROVED PP	
				DRAWING NUMBER LSTC/STD/GNA/527	REV 7	