

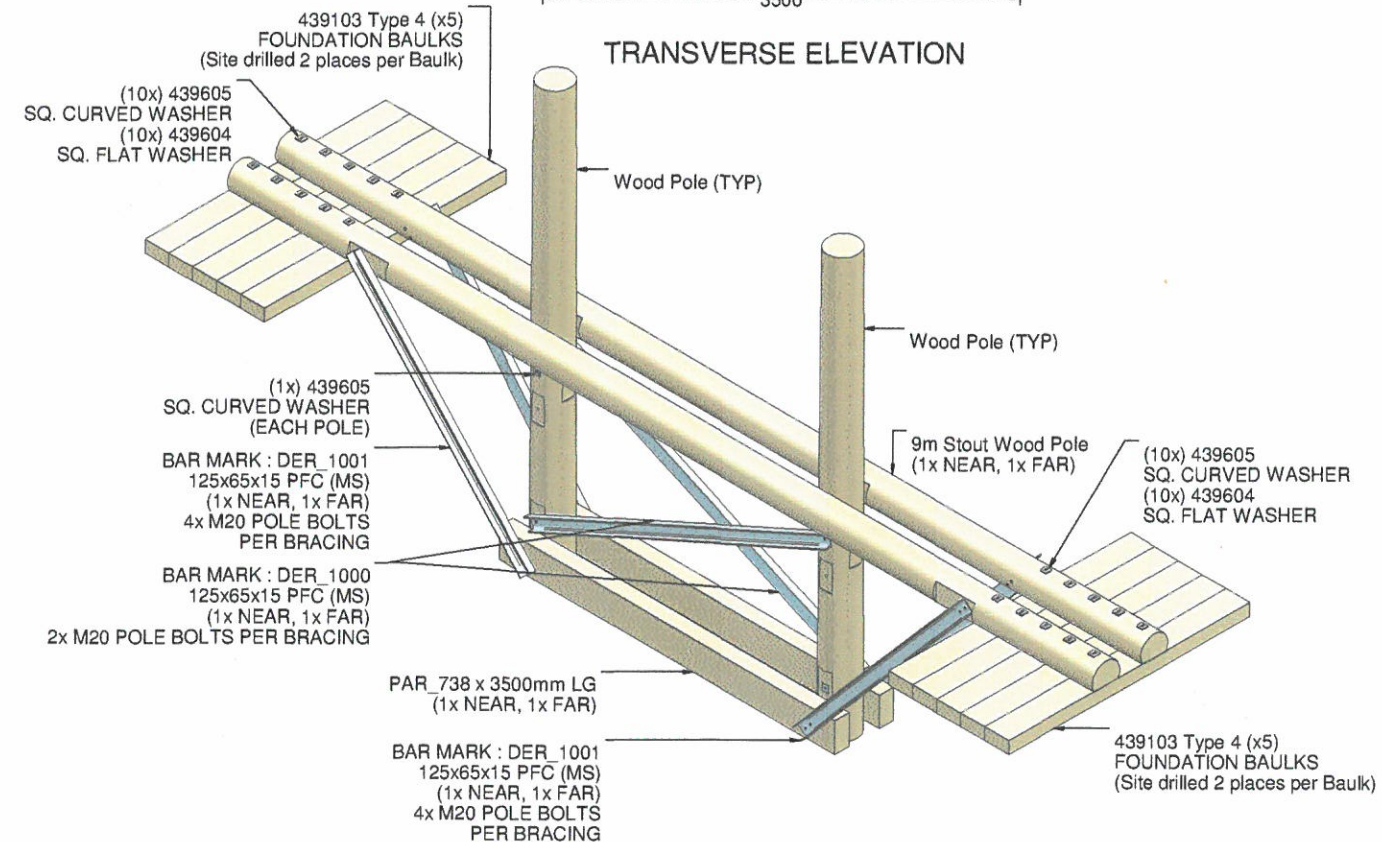


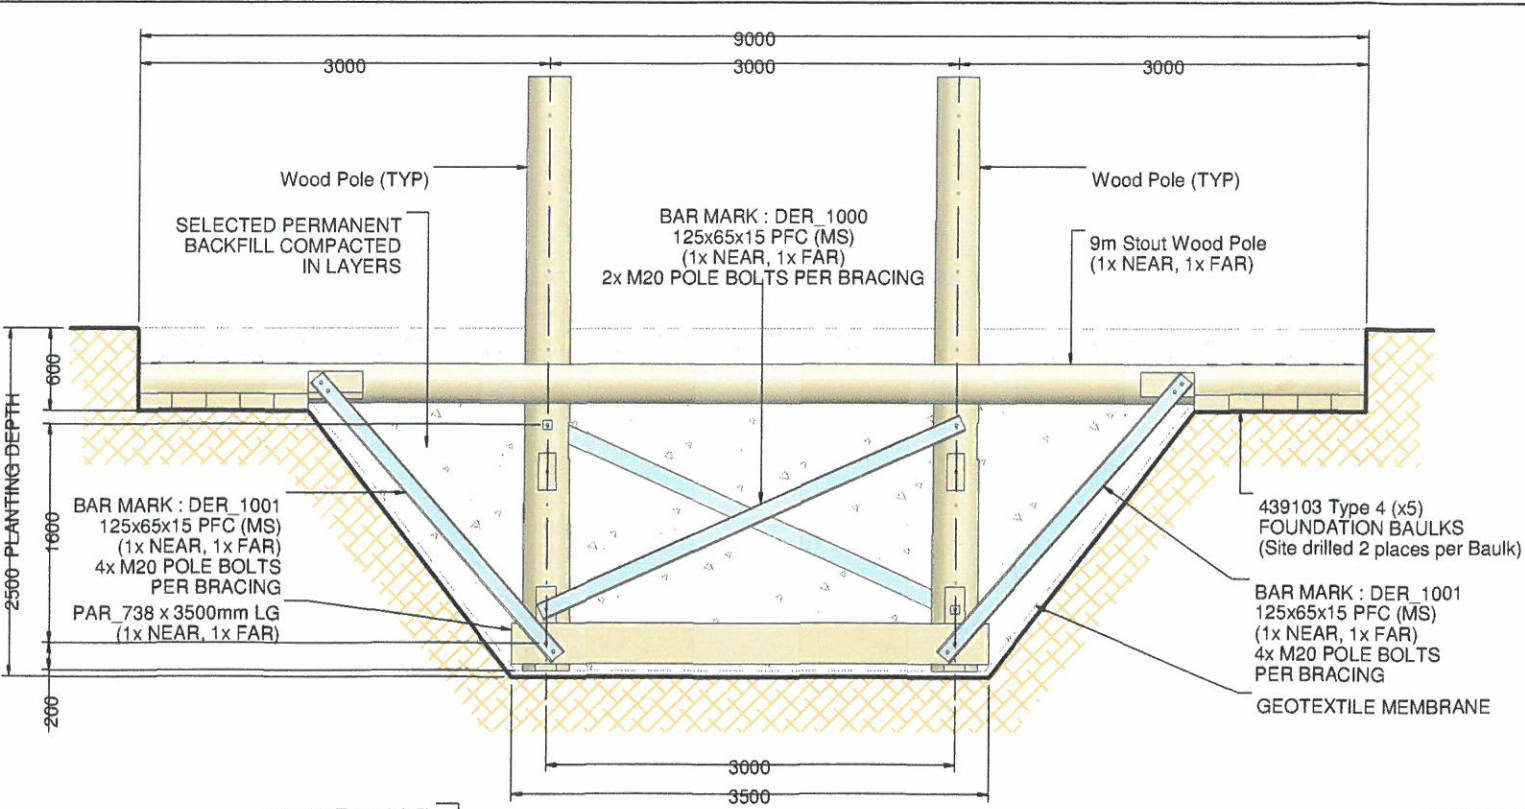

TRANSVERSE ELEVATION

ISOMETRIC VIEW

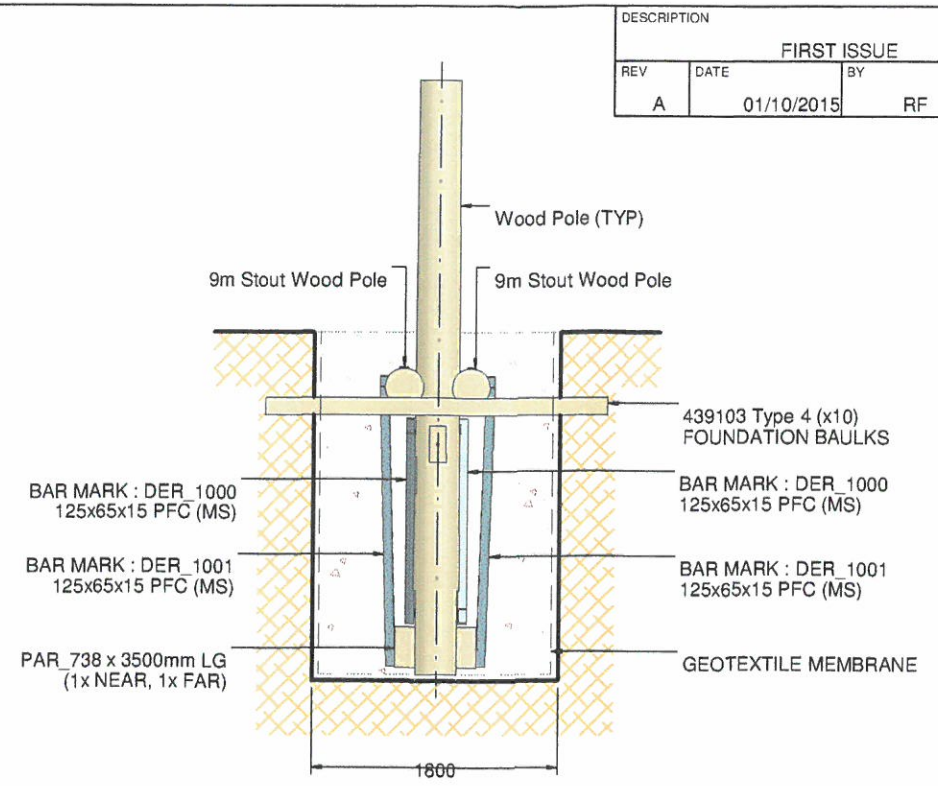

LONGITUDINAL ELEVATION

GENERAL NOTES:

- ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNO.
- STEELWORK: MILD STEEL, Grade S275JR TO BS EN 10025 & HOT DIPPED GALVANISED TO BS EN 1461
- TIMBER SELECTION & TREATMENT IN ACCORDANCE WITH ENATS 43-88
- REMOVE BURRS & SHARP EDGES PRIOR TO GALVANISING
- BOLTS SHALL BE IN ACCORDANCE WITH NGS 3.4. to BS4190
- APPLY APPROPRIATE PROTECTIVE TREATMENT TO ALL SITE CUT, SCARFED & DRILLED TIMBER
- THE CONTRACTOR TO ADOPT METHODS TO KEEP OPEN EXCAVATION SUPPORTED AND FREE OF STANDING WATER UNTIL THE FOUNDATION HAS BEEN COMPLETED
- FOUNDATION CONSTRUCTION IN ACCORDANCE WITH OHL 03-132 & 43-125 EXCEPT WHERE STANDARDS HAVE BEEN SUSPENDED OR AMENDED BY FURTHER INSTRUCTIONS ON THIS DRAWING
- WHERE GROUND WATER IS ABOVE EXCAVATION LEVEL AND IT IS IMPRACTICABLE TO KEEP THE EXCAVATION DRY DURING CONSTRUCTION, AN ALTERNATIVE FOUNDATION MAY BE REQUIRED
- GEOTEXTILE MEMBRANE TO BE PLACED IN BOTTOM & UP THE SIDES OF EXCAVATION PRIOR TO BACKFILL.
- BACKFILL SHALL BE COMPACTED IN 300mm LAYERS TO ACHIEVE A BULK DENSITY OF 1600kg/m3. SOIL MIXING AND COMPACTION OF EXCAVATED MATERIAL TO MANUFACTURERS RECOMMENDATIONS TO ACHIEVE AN EQUIVALENT DENSITY WOULD BE ACCEPTABLE. ALL UNSUITABLE MATERIAL (e.g. PEATY SOIL) SHOULD BE DISGUARDED
- ANY VERY SOFT SILTS / CLAYS OR VERY LOOSE SANDS ENCOUNTERED AT THE UNDERSIDE OF PADS SHALL BE EXCAVATED AND BACKFILLED WITH COMPACTED IMPORTED OR SOIL MIXED MATERIAL.
- ANY OVERDIG TO FORM BATTERS AND STABLE SIDE SLOPES ARE TO BE BACK FILLED WITH COMPACTED MATERIAL AS SPECIFIED ABOVE
- WITH SETTLEMENT LIKELY TO OCCUR WITH TIME A REGIME OF RE TENSIONING STAYS AND CHECKING POLE VERTICALITY SHOULD BE CONSIDERED. AFTER SEVERE EVENTS LINE INSPECTION WOULD BE RECOMMENDED
- STRUCTURES APPLICABLE TO HORIZONTAL GROUND PROFILES ONLY. FOR GROUND GRADIENTS ACROSS THE POLES REFER TO VERIFY SUITABILITY OF STRUCTURE
- FOR PIECE SAMLL DETAILS SEE DRAWING16_15229_78 (Sheet 2 of 3) & FOR TYPICAL BOLT DETAILS SEE DRAWING LSTC_STD_GNA_555

 LSTC North: Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA Tel 01377 253617 Fax 01377 259555 LSTC South: Bourne House Office 21 475 Godstone Road Whyteleafe Surrey CR3 0BL Tel 01883 621114	IF IN DOUBT ASK ENGINEER / DESIGN OFFICE			TITLE GA/ED OF FOUNDATIONS FOR SECTION (150m) H-POLE STRUCTURES FOR THE FOLLOWING GROUND CONDITIONS POOR / WEAK GROUND WITH POOR WEAK GROUND AT FORMATION LEVEL (STRUCTURES WITH 4xSTAYS & FOUNDATION BAULKS)	SCALE N/A	TOTAL No. OF SHEETS -	DESIGNED L.S.T.C.
	 VIEW CONVENTION THIRD ANGLE				DATE 20/05/2015	CHECKED M.J.	
	THIS DRAWING IS THE EXCLUSIVE PROPERTY OF: LSTC LTD TO THE CONTENTS OF THE DRAWING MUST BE TREATED AS STRICTLY CONFIDENTIAL AND MUST NOT BE DISCLOSED TO ANY THIRD PARTY WITHOUT LSTC LTD WRITTEN CONSENT. USE ONLY FOR THE PURPOSE FOR WHICH IT WAS LOANED. NO COPYING OR REPRODUCING, RETURN ON REQUEST.				DRAWN RFisk	APPROVED K.M.	
	LS TRANSMISSION CONSULTANCY LIMITED MAKES NO WARRANTIES, EXPRESS OR IMPLIED, THAT COMPLIANCE WITH THIS DRAWING OR ANY OTHER DOCUMENT ISSUED BY LSTC, WOULD IN ITSELF BE SUFFICIENT TO ENSURE SAFE SYSTEMS OF WORK OR OPERATION. USERS ARE REMINDED OF THEIR OWN DUTIES UNDER HEALTH AND SAFETY LEGISLATION.				ORIGINAL SIZE A3	DOCUMENT NUMBER 16_15229_78 (Sheet 1 of 3)	REV A
PROJECT DERSALLOCH 132kV OHL							

1890-1-LD-KTL-0104 Rev A
 GA/ED of foundation for section structure
 4 stays full back fill