

POLE LENGTH	DIM 'A' (mm)	Min. Top Dia. (mm)	Min. Dia 1.5m From Butt (mm)	Planting Depth (m)
16m	10000	250	390	2.4
17m	11000	250	415	2.4

STAY INSULATORS SHALL BE INSTALLED IN SUCH A MANNER THAT, IN THE EVENT OF A FAILURE OF THE STAY BELOW THE INSULATOR POSITION, THE INSULATOR OR ASSEMBLY SHALL HAVE A MINIMUM VERTICAL GROUND CLEARANCE OF 3m UNDER ALL CONDITIONS.

NO SINGLE INSULATOR OR INSULATOR ASSEMBLY SHALL BE MOUNTED HIGHER THAN ANY LIVE EQUIPMENT ON THE SUPPORTING POLE


STAYS

6 No. 7 / 4.0 GRADE 1150 STAY WIRES IN ACCORDANCE WITH ENATS 43-91.


TYPE 2 RODS AND BLOCKS - SML 101KN.

TYPE 2 STAY BLOCKS TO BE INSTALLED AT A DEPTH OF 1.8m BELOW GROUND.


SEE MATERIAL LIST No. 19_210521_09.

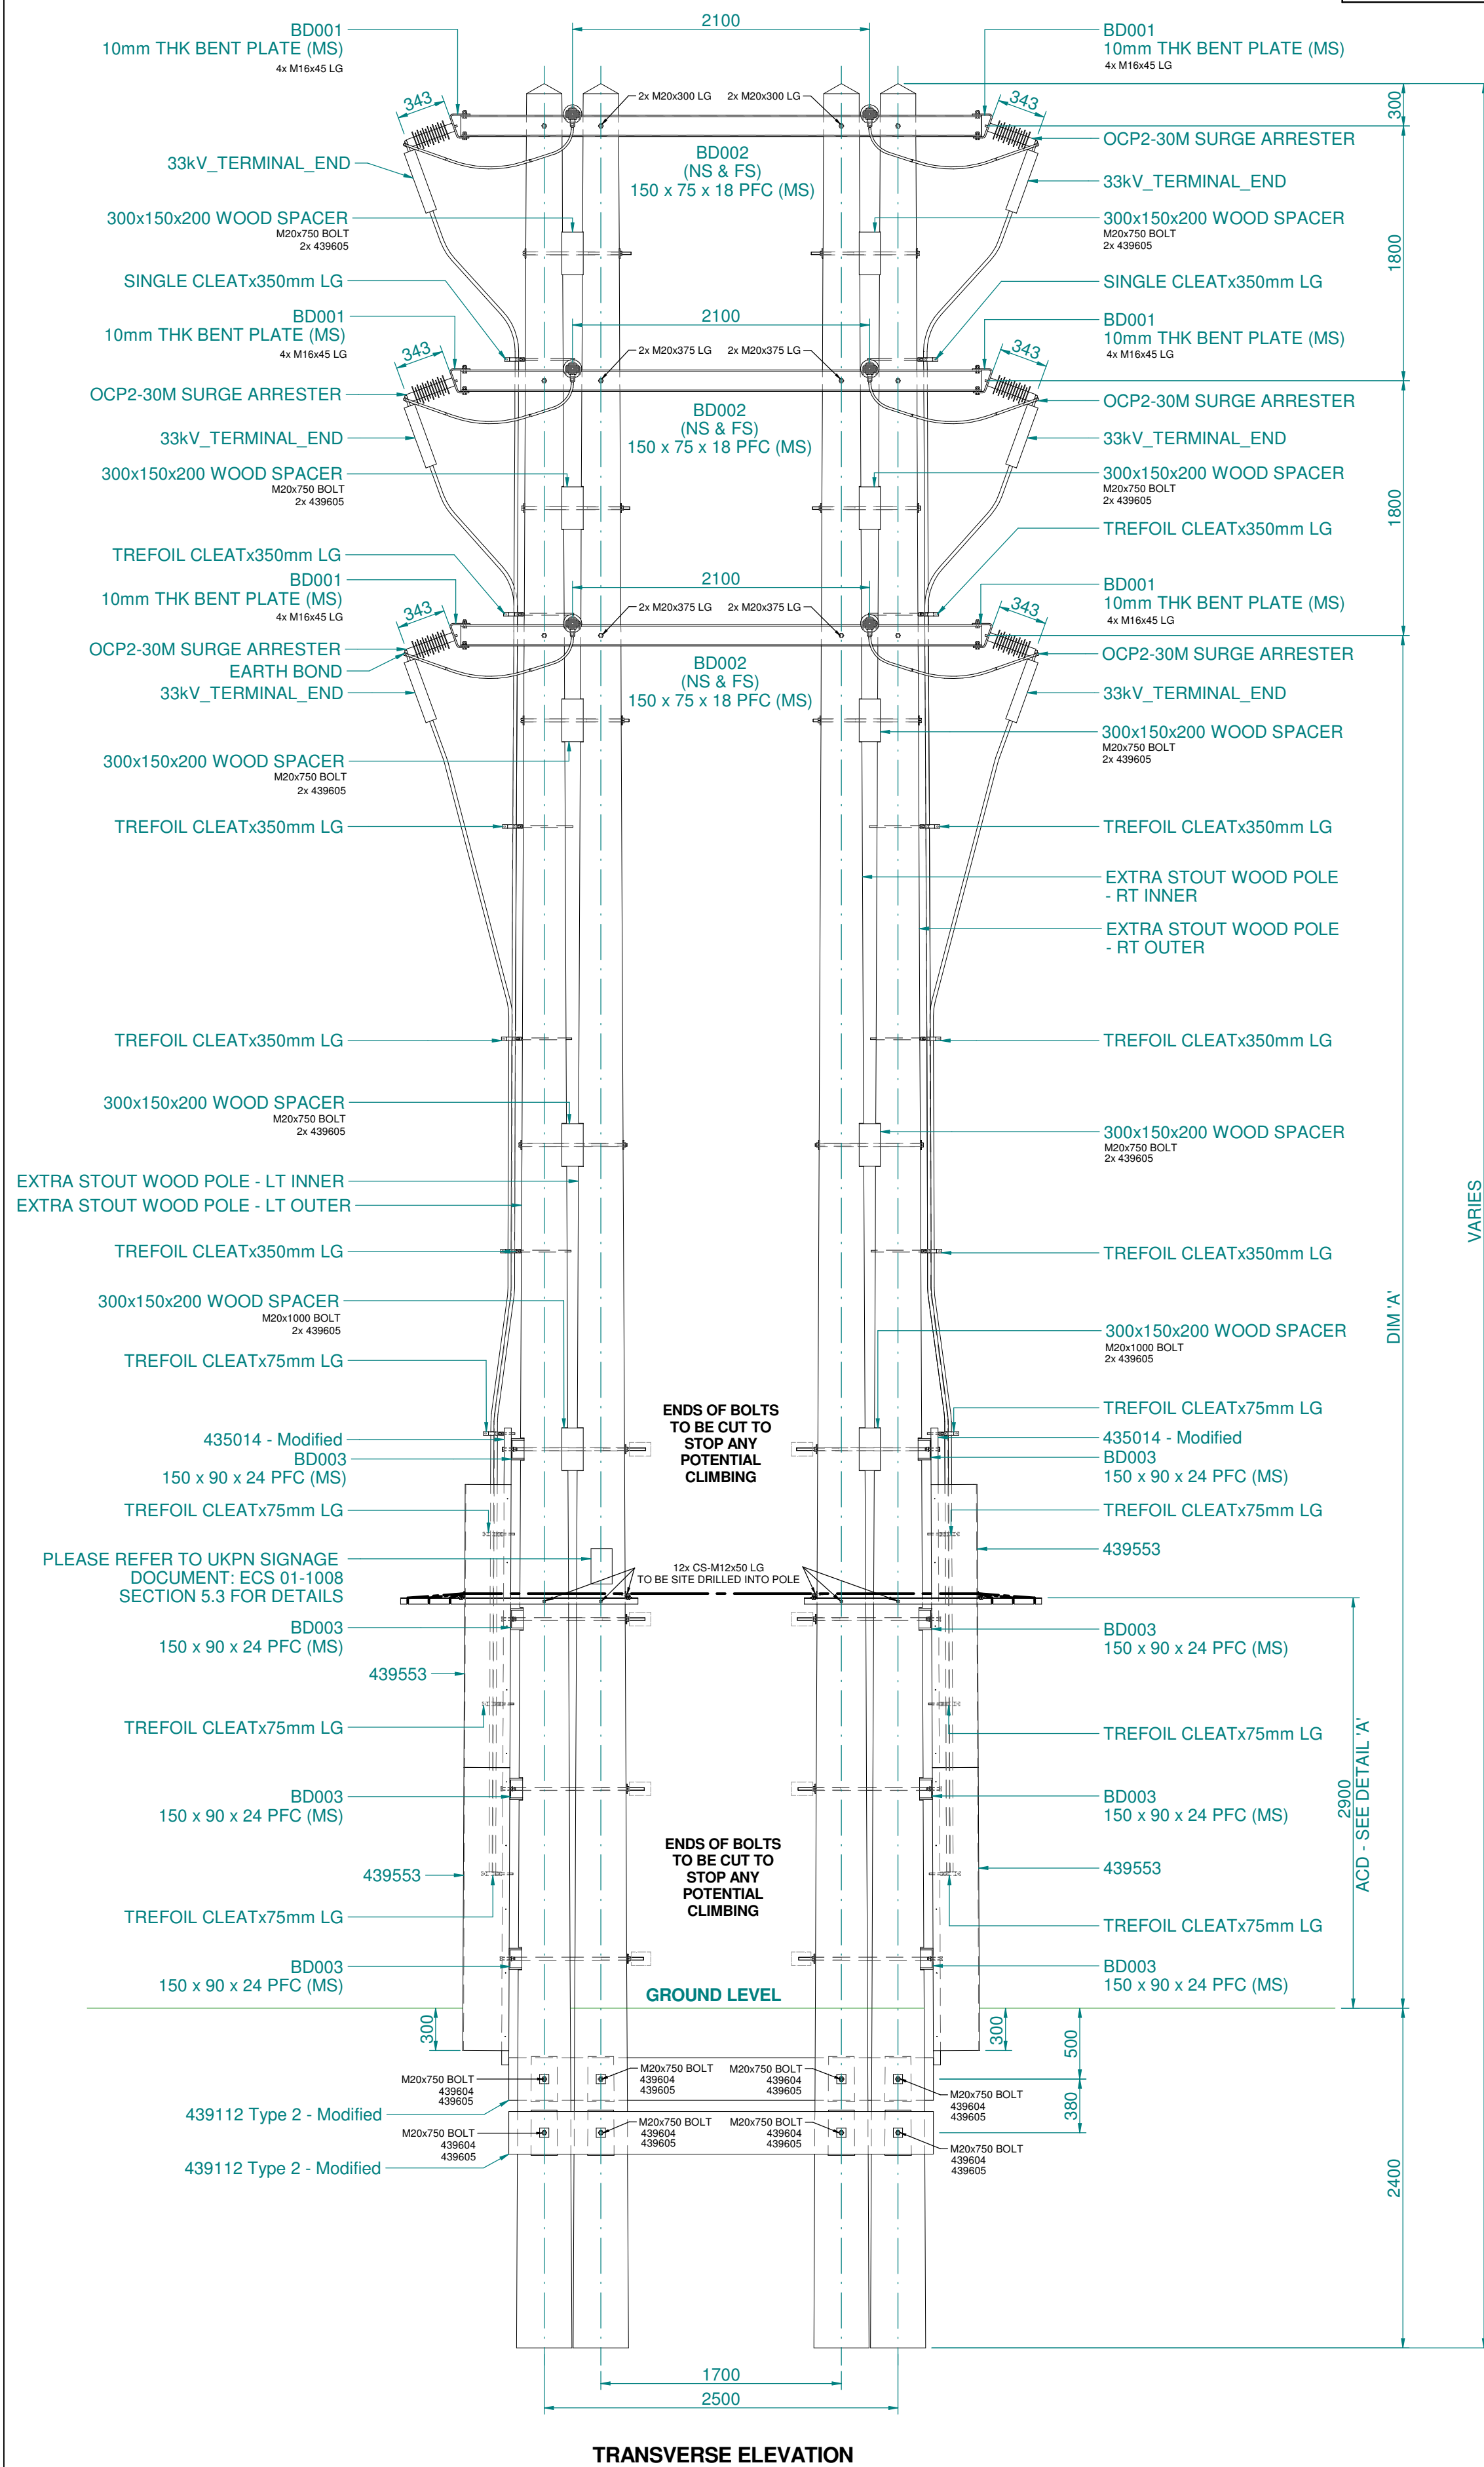


TRANSVERSE ELEVATION

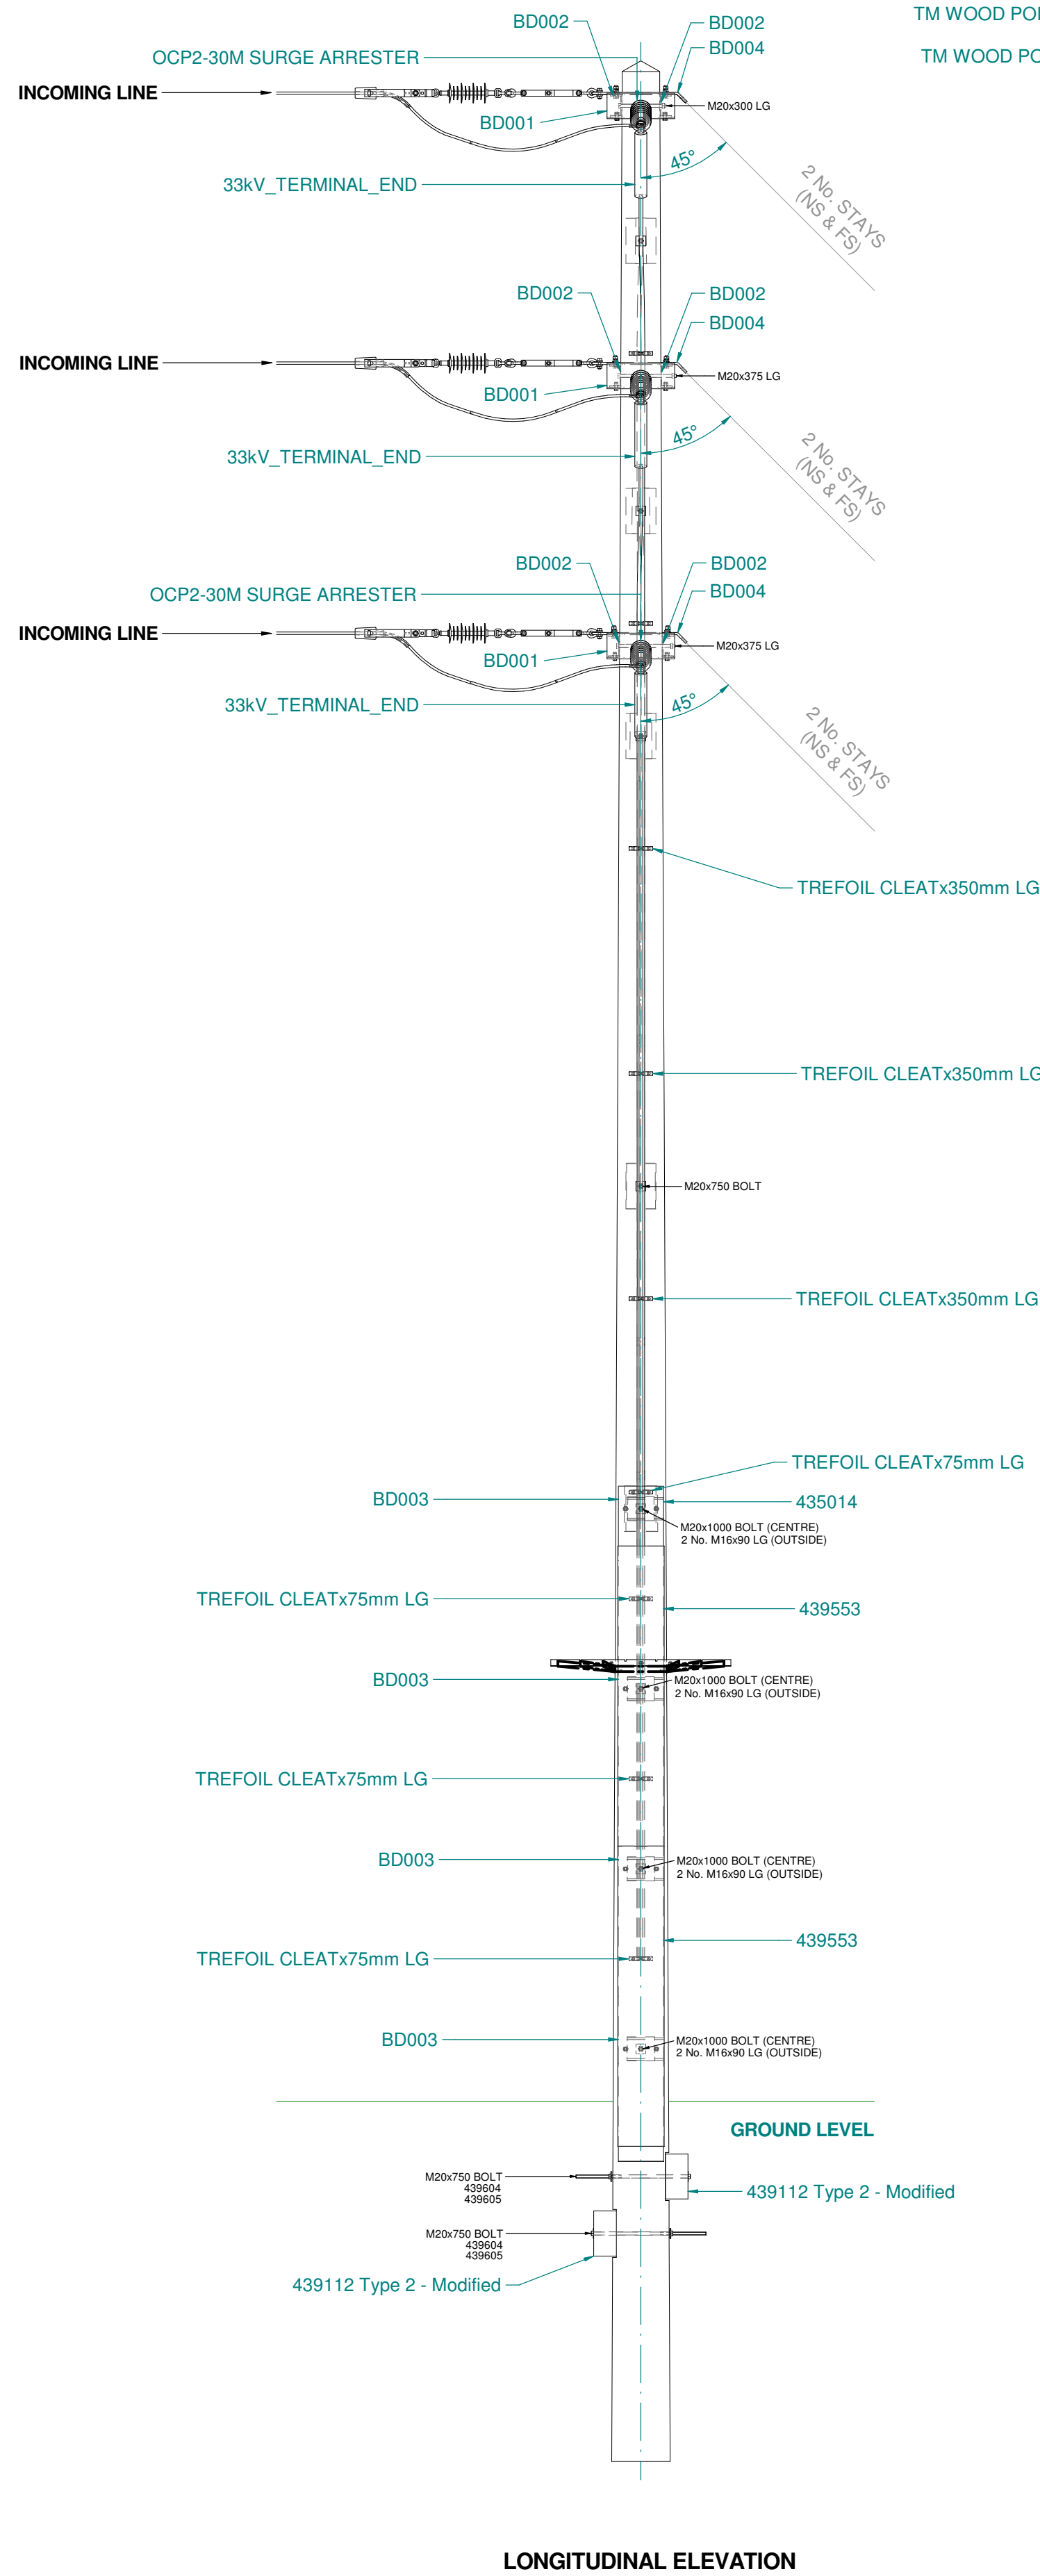


LONGITUDINAL ELEVATION

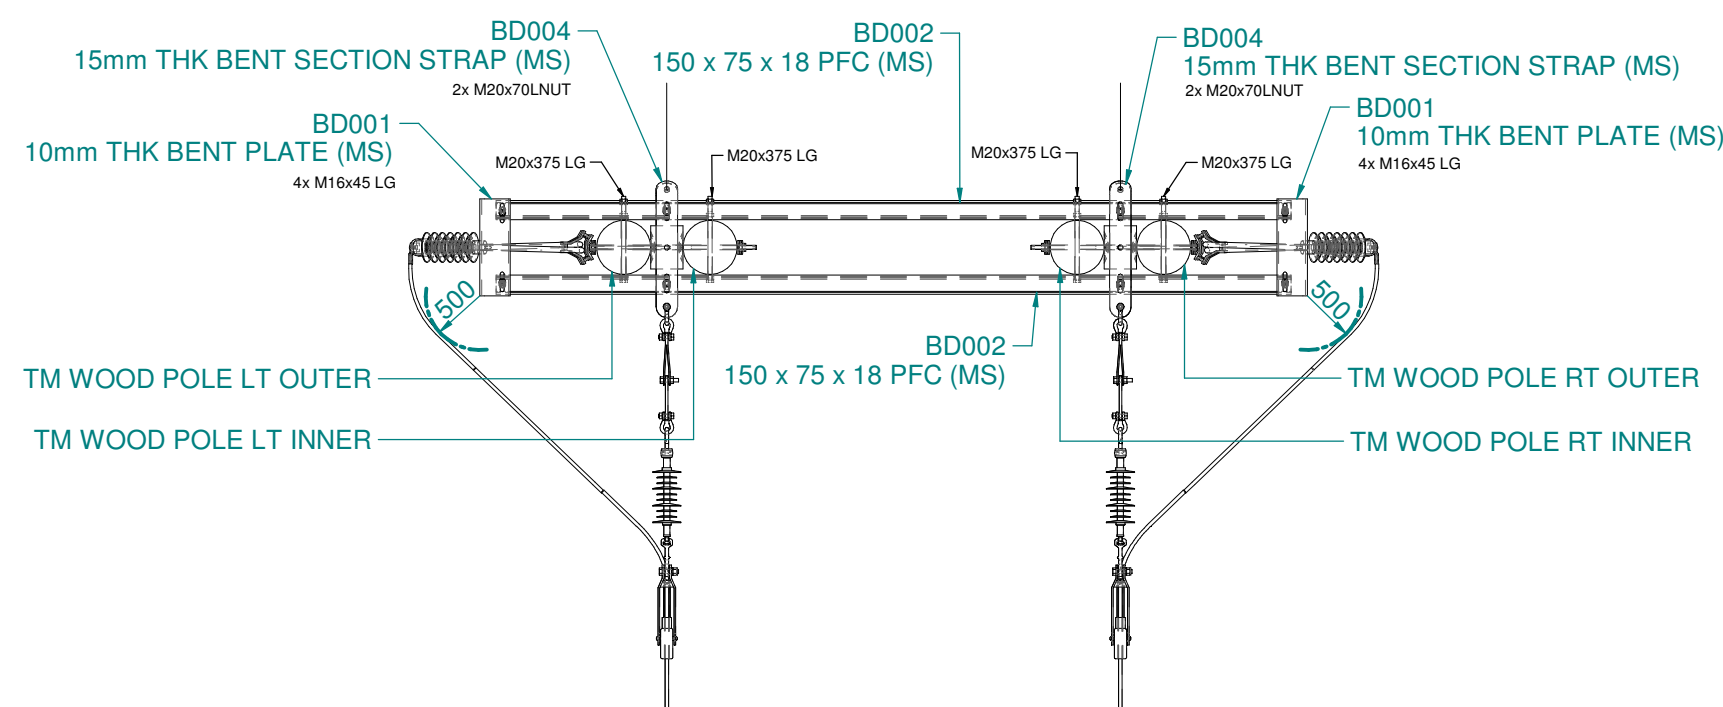

TYPICAL PLAN VIEW OF CROSSARM

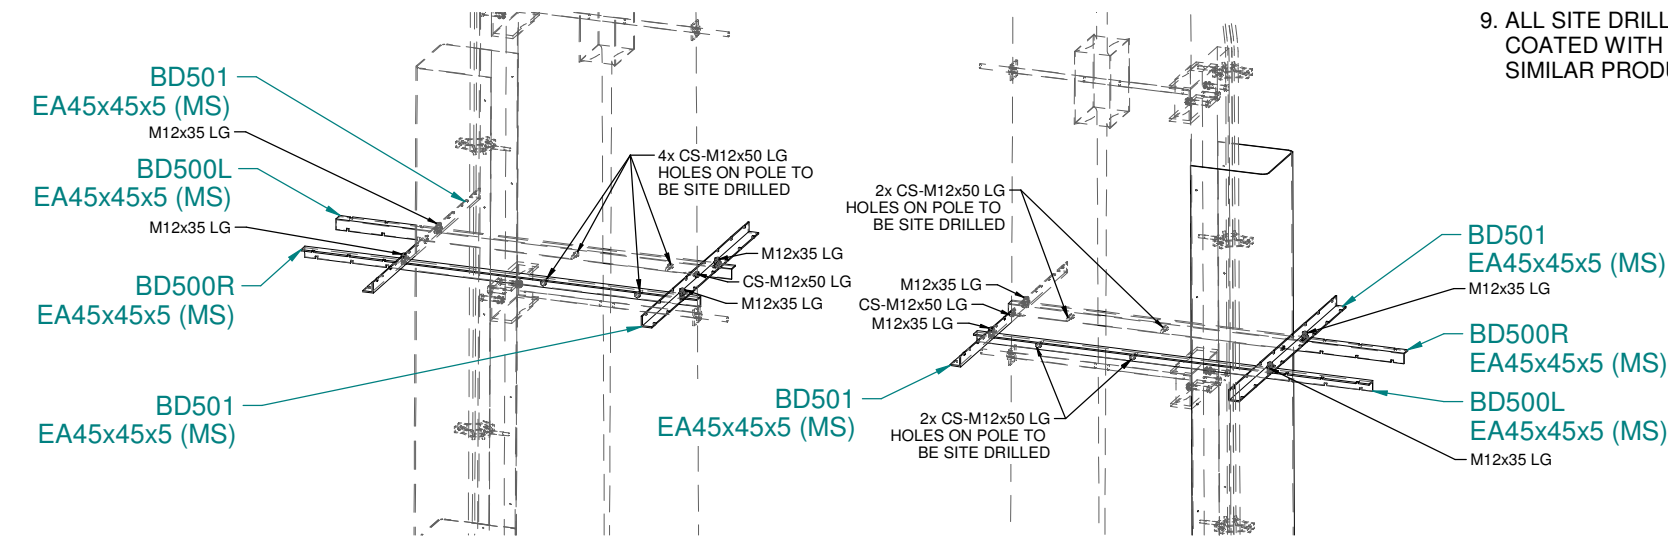

DETAIL 'A' VIEW OF ACD

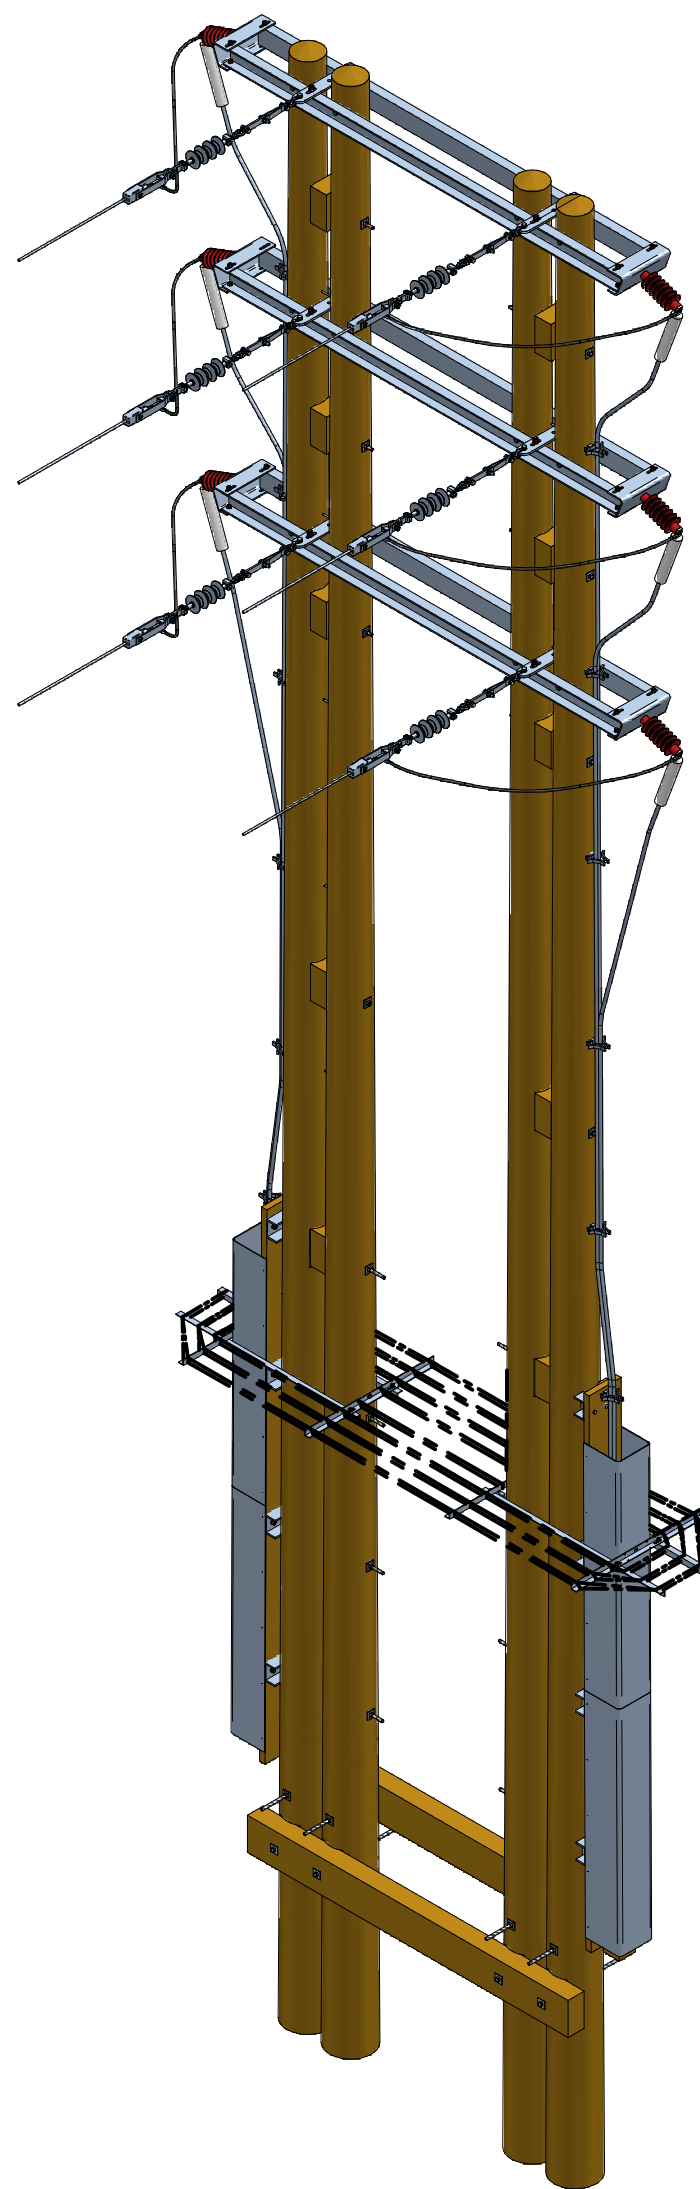

ISOMETRIC VIEW (ILLUSTRATIVE ONLY)

REV	DATE	BY	CHKD	APPD	SG
A	10/02/2022	RL	RF		
DESCRIPTION					
FIRST ISSUE					
REV	DATE	BY	CHKD	APPD	SG
B	11/05/2022	MB	RF		
DESCRIPTION					
SAG ADJUSTER REMOVED					

GENERAL NOTES:

- ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE.
- ALL NEW STEELWORK TO BE GALVANISED IN ACCORDANCE WITH BS EN ISO 1461 AFTER FABRICATION (MINIMUM COATING THICKNESS IN ACCORDANCE WITH TABLE D.1).
- FOR STRUCTURE MATERIAL LIST, SEE DRAWING No. 19_210521_09.
- FOR WOOD POLE SCARFING AND DRILLING DETAILS, SEE DRAWING No. 18_210521_10.
- FOR SMALL PIECE DETAILS, SEE DRAWING No. 18_210521_08.
- CONTRACTOR TO PERFORM SOIL INVESTIGATION BEFORE CONSTRUCTION.
- SURGE ARRESTER IN ACCORDANCE WITH ADVICE FROM UK POWER NETWORKS.
- ACD TO BE AS PER DETAIL 'A'. ALL BARBED WIRE IS TO BE PASSED AROUND THE BRACKETS AND WRAPPED AROUND THE RETAINING SLOTS.
- ALL SITE DRILLED OR CUT SURFACES TO BE COATED WITH 2 COATS OF GALVAFROID OR SIMILAR PRODUCT.

CDM RESIDUAL RISK

- DESIGN BASED HAZARDS ARE ACTIVELY ELIMINATED WHERE PRACTICAL. WHERE HAZARDS ARE NOT ELIMINATED THEY ARE IDENTIFIED BY THIS SYMBOL.
- HAZARDS / RISKS THAT SHOULD BE CONSIDERED BY A COMPETENT CONTRACTOR ARE NOT IDENTIFIED

IF IN DOUBT ASK ENGINEER / DESIGN OFFICE



THIS DRAWING IS THE EXCLUSIVE PROPERTY OF THE CLIENT THE CONTENTS OF THE DRAWING MUST BE TREATED AS STRICTLY CONFIDENTIAL AND MUST NOT BE DISCLOSED TO ANY THIRD PARTY WITHOUT THE CLIENTS WRITTEN CONSENT. USE ONLY FOR THE PURPOSE FOR WHICH IT WAS LOANED. NO COPYING OR REPRODUCING. RETURN ON REQUEST.

LS TRANSMISSION CONSULTANCY LIMITED MAKES NO WARRANTIES, EXPRESS OR IMPLIED, THAT COMPLIANCE WITH THIS DRAWING OR ANY OTHER DOCUMENT ISSUED BY LSTC, WOULD IN ITSELF BE SUFFICIENT TO ENSURE SAFE SYSTEMS OF WORK OR OPERATION. USERS ARE REMINDED OF THEIR OWN DUTIES UNDER HEALTH AND SAFETY LEGISLATION.



PROJECT
BRAintree - DUNMOW

TITLE
GENERAL ARRANGEMENT DRAWING FOR 33kV 'H' TERMINAL POLE ARRANGEMENT

SCALE	1:35	DESIGNED	SG/RL
DATE	10/02/2022	CHECKED	RF
DRAWN	RL	APPROVED	SG



ORIGINAL SIZE	DRAWING NUMBER	REV
A1	15_210521_07	B

REV B	DATE 11/05/2024	BY MB	CHKD RF	APPR SG
DESCRIPTION SAG ADJUSTER REMOVED				
 CDM RESIDUAL RISK ☐ DESIGN BASED HAZARDS ARE ACTIVELY ELIMINATED WHERE PRACTICAL WHERE HAZARDS ARE NOT ELIMINATED THEY ARE IDENTIFIED BY THIS SYMBOL. ☐ HAZARDS / RISKS THAT SHOULD BE CONSIDERED BY A COMPETENT CONTRACTOR ARE NOT IDENTIFIED				
