


GENERAL NOTES

1. STEELWORK TO BE PROTOTYPE CHECK ERECTED BEFORE MASS PRODUCTION.
2. SAFETY SIGNS INSTALLED TO POWERSYSTEMS PROCEDURES.
3. FOR FRONT ELEVATION SEE LSTC/STD/GNA/546
4. FOR SIDE ELEVATION SEE LSTC/STD/GNA/547
5. FOR MATERIAL LIST SEE LSTC/STD/GNA/548
6. OPGW AND BACKSTAY ARRGT CAN BE MOUNTED EITHER SIDE OF STRUCTURE. SEE PLAN VIEW.
7. FOR STAY WIRE SETTING OUT DETAILS SEE LSTC/STD/GNA/787.
8. FOR MAINTENANCE ATTACHMENT LOCATIONS SEE LSTC/STD/GNA/553.


FOR FOUNDATION DETAILS FOR VARYING SOIL CONDITIONS SEE INFORMATION LISTED BELOW:

GOOD: AS PER THIS DWG
AVERAGE: AS PER THIS DWG
POOR: LSTC/STD/GNA/813
VERY POOR: LSTC/STD/GNA/814

ALTERNATIVE U/GROUND CABLE ARRANGEMENT WITH REDUCED BEND RADIUS SHOWN DOTTED

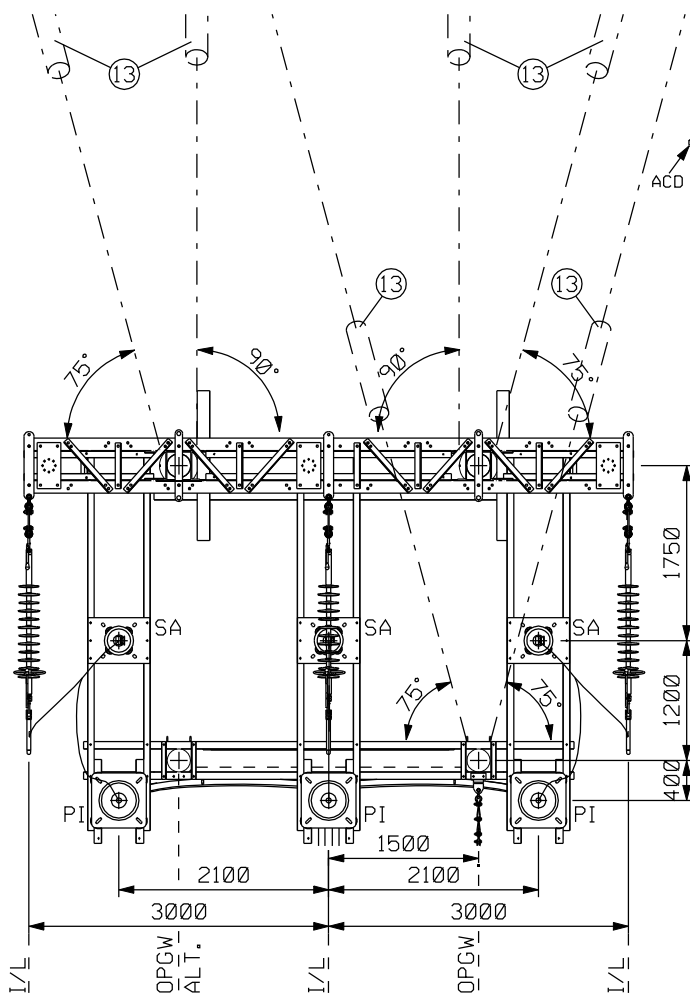

PLAN VIEW

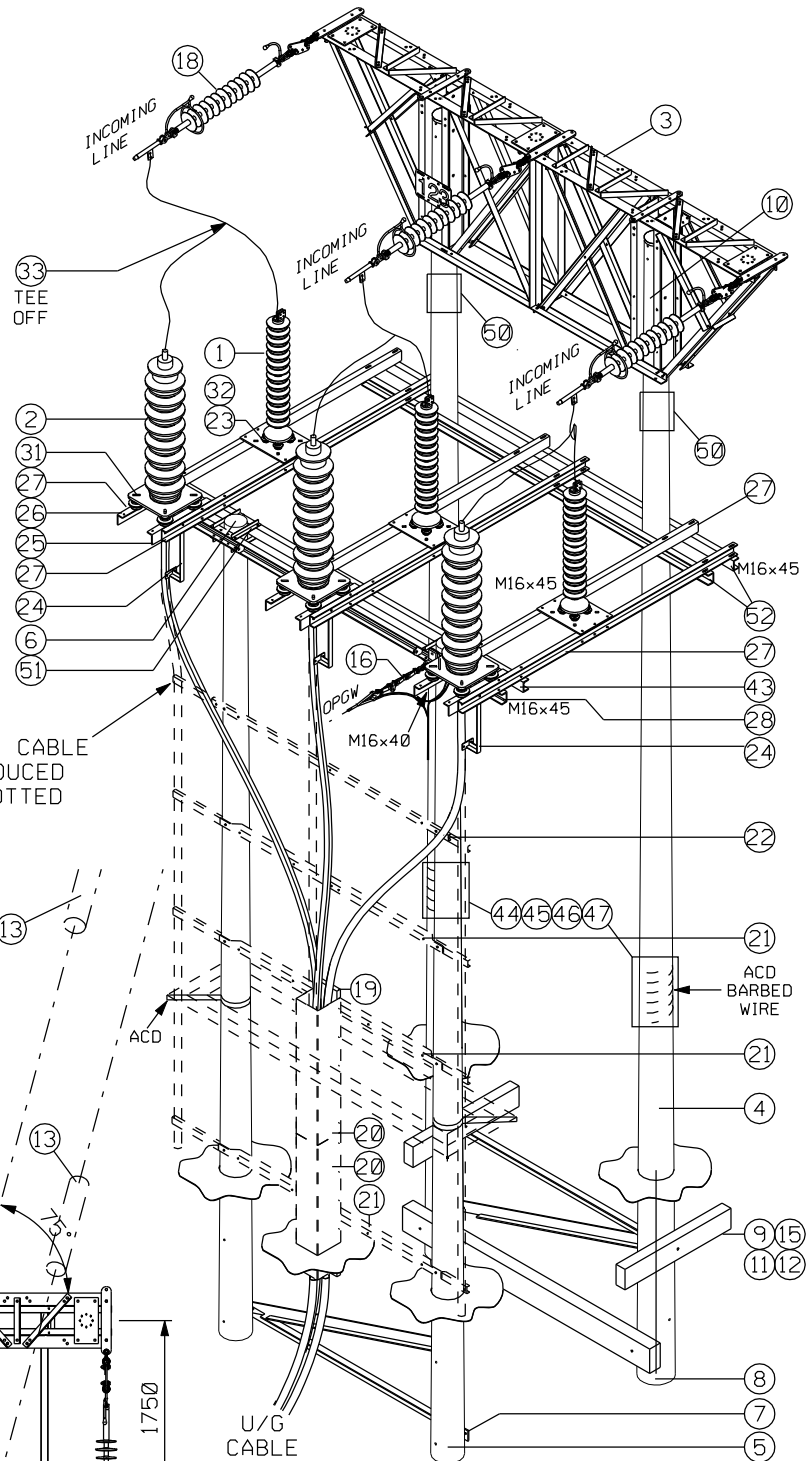

ISOMETRIC VIEW

(BACKSTAYS NOT SHOWN FOR CLARITY)

ALL CABLE FIXINGS, SUPPORTS AND GUARDING TO BE SPECIFIED AND SUPPLIED BY CABLE CONTRACTOR

CLIENT PowerSystems	TITLE GA - PLAN & ISOMETRIC VIEWS 0° ENTRY / TERMINAL 4 POLE STRUCTURE	SCALE 1 : 75 (UNLESS OTHERWISE STATED) DATE 16/04/04 DRAWN R.T.J DRAWING NUMBER LSTC/STD/GNA/545	ORIGINAL SIZE A4 CHECKED GS APPROVED PP REV 8
SPECIFICATION OHL-03-132			LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617