
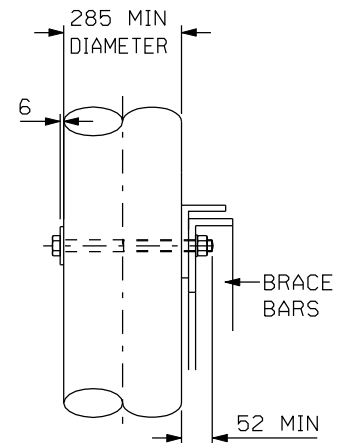
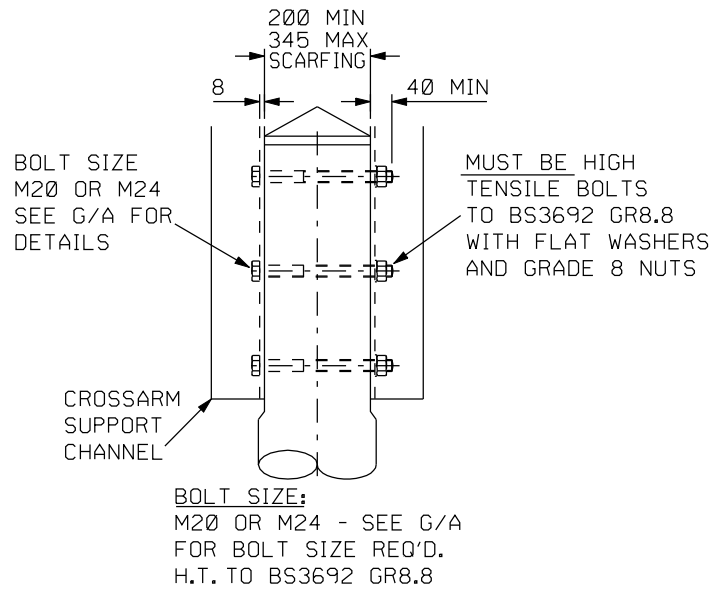


DESCRIPTION		FOR ISSUE			
REV	DATE	BY	CHKD	SP	APPD
6	28/11/07	RF			GS

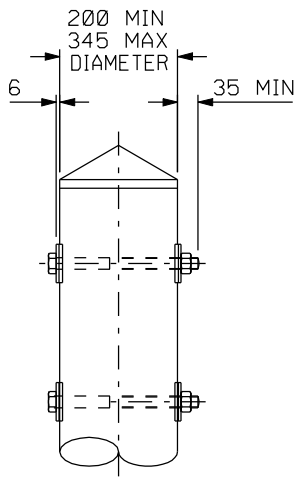

POLE DIAMETERS:

200-259 - USE M20x300 LG
260-334 - USE M20x375 LG
335-409 - USE M20x450 LG

ANTI SPLIT BOLTS

SCARFING:



200-252 - USE 300 LG
253-265 - USE 375 LG
266-340 - USE 450 LG
341-420 - USE 530 LG

CROSSARM SUPPORT CHANNEL MOUNTING BOLTS


POLE DIAMETER:

285-317 - USE M20x375
318-392 - USE M20x450
393-472 - USE M20x530
473-532 - USE M20x590
533-550 - USE M20x650

BRACE BAR MOUNTING BOLTS

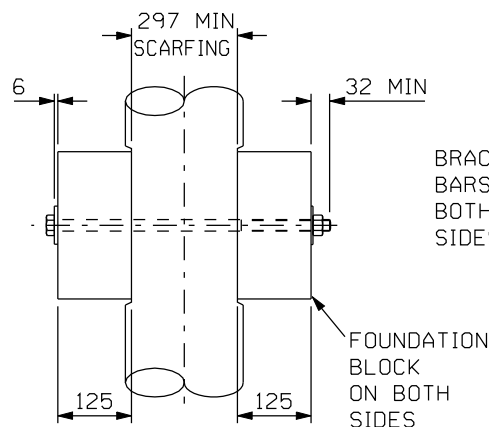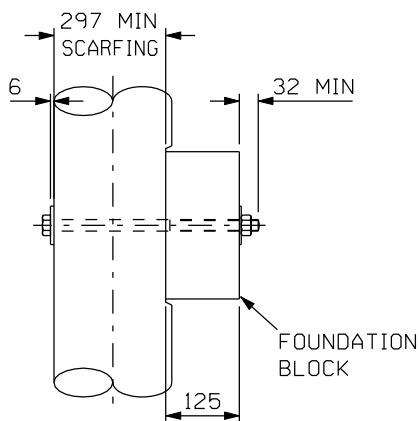

BRACE
BARS ON
BOTH
SIDES

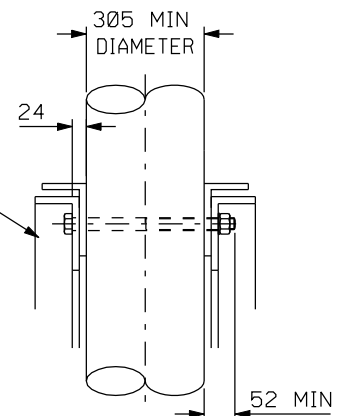

SCARFING:

297-367 - USE M20x530
368-427 - USE M20x590
428-483 - USE M20x650
484-533 - USE M20x700
534-550 - USE M20x760

SCARFING:

297-362 - USE M20x650
363-412 - USE M20x700
413-472 - USE M20x760
473-532 - USE M20x820
533-550 - USE M20x900

DIAMETER:

305-374 - USE M20x450
375-454 - USE M20x530
455-514 - USE M20x590
515-550 - USE M20x650

FOUNDATION BLOCK MOUNTING BOLTS

FOUNDATION BLOCK ON BOTH SIDES OF POLE MOUNTING BOLTS

BRACE BAR TO BRACE BAR MOUNTING BOLTS

GENERAL NOTES:

1. POLE SIZES BASED ON BS1990 : EXTRA STOUT POLES.

VARIABLE LENGTH = 10M - 17M
MINIMUM TOP DIA = 200mm*
MAXIMUM TOP DIA = 265mm (345mm SINGLE POLE)
MINIMUM DIAMETER 1.5M FROM BUTT = 305
(* VALUE AMMENDED FROM THAT SHOWN ON BS1990)

2. BOLTS TO BE SUPPLIED IN ACCORDANCE WITH BS4190 GRADE 4.6 - UNLESS NOTED OTHERWISE.
THREAD LENGTHS 150mm. BOLTS TO BE SUPPLIED COMPLETE WITH FLAT WASHERS & GRADE 4 FULL NUTS U.N.O.
BOLTS OF LENGTHS GREATER THAN 600mm MAY BE SUBSTITUTED WITH INCREASED LENGTHS OF STUD BAR OF COMPARABLE GRADE WITH 150 THREAD LENGTH AT BOTH ENDS. WASHERS & NUTS TO BE SUPPLIED FOR BOTH ENDS.

CLIENT PowerSystems	TITLE PART - WOOD POLE ATTACHMENT BOLT LENGTH DETERMINATION DRAWING SHEET 1 OF 3	SCALE (UNLESS OTHERWISE STATED) NTS	ORIGINAL SIZE A4	LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617 
		DATE 28/01/05	CHECKED GS	
DRAWN R.T.J.		APPROVED PP		
DRAWING NUMBER LSTC/STD/GNA/555		REV 6		
SPECIFICATION OHL-03-132				