



DESCRIPTION SEE SHEET 1 FOR REVISION HISTORY				
REV	DATE	BY	CHKD	APPD
6	-	-	-	-

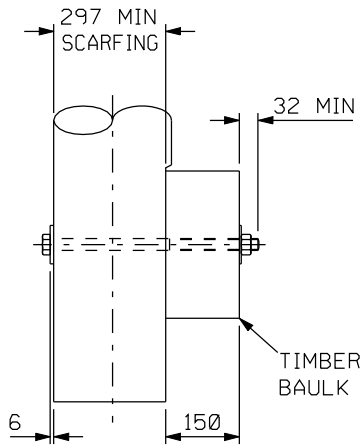

SCARFING:

297-342 - USE M20x530
343-402 - USE M20x590
403-462 - USE M20x650
463-512 - USE M20x700
513-550 - USE M20x760


TIMBER BAULK MOUNTING BOLTS

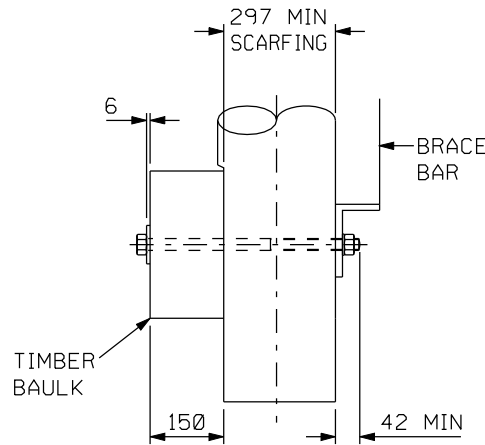

SCARFING:

297-332 - USE M20x530
333-392 - USE M20x590
393-452 - USE M20x650
453-502 - USE M20x700
503-550 - USE M20x760


BRACE BAR TO TIMBER BAULK MOUNTING BOLTS

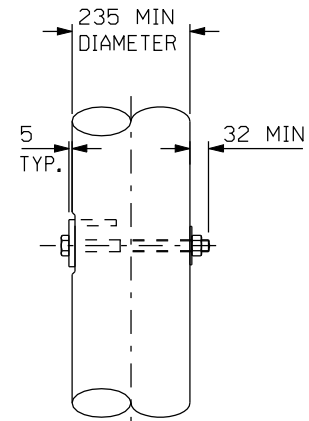

SCARFING:

235-263 - USE M20x300
264-338 - USE M20x375
339-413 - USE M20x450


CABLE SUPT X-MEM MTG TO AUX POLE ON 4 POLE TERMINAL STRUCTURE

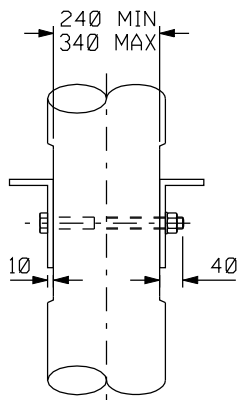

SCARFING:

240-250 - USE M20x300
251-325 - USE M20x375
326-340 - USE M20x450

SEALING END X-ARM MTG TO MAIN POLE ON 4 POLE TERMINAL STRUCTURE

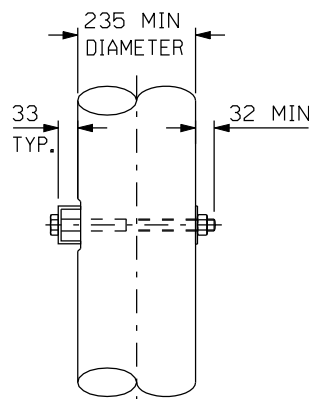


SCARFING:

235-310 - USE M20x375
311-385 - USE M20x450
386-465 - USE M20x530

CABLE SUPT X-MEM MTG TO AUX POLE ON 4 POLE TERMINAL STRUCTURE

MUST BE HIGH
TENSILE BOLTS
TO BS3692 GR8.8
WITH FLAT WASHERS
AND GRADE 8 NUTS

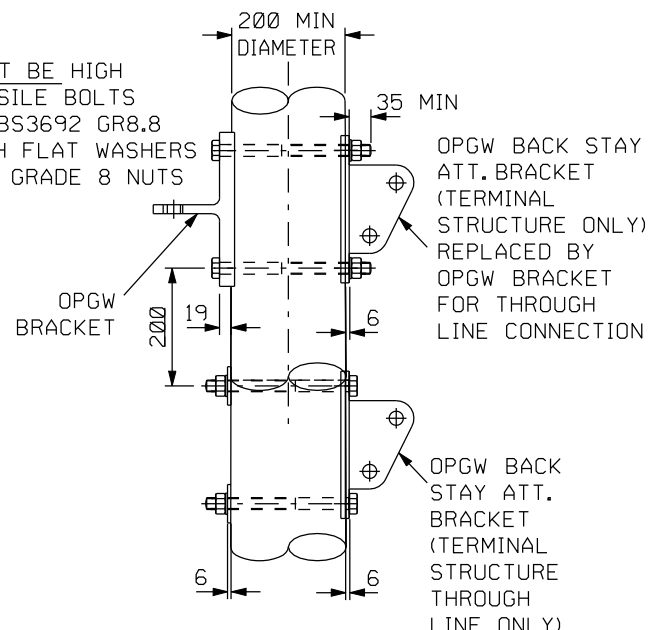

POLE DIAMETER:

200-253 - USE M20x300
254-328 - USE M20x375
329-403 - USE M20x450

OPGW MOUNTING BRACKETS FOR TERMINAL STRUCTURE (SHOWN) AND THROUGH LINE CONNECTIONS

GENERAL NOTES:

1. POLE SIZES BASED ON BS1990 : EXTRA STOUT POLES.

VARIABLE LENGTH = 10M - 17M
MINIMUM TOP DIA = 200mm*
MAXIMUM TOP DIA = 265mm (345mm SINGLE POLE)
MINIMUM DIAMETER 1.5M FROM BUTT = 305
(* VALUE AMMENDED FROM THAT SHOWN ON BS1990)

2. BOLTS TO BE SUPPLIED IN ACCORDANCE WITH BS4190 GRADE 4.6 - UNLESS NOTED OTHERWISE.
THREAD LENGTHS 150mm. BOLTS TO BE SUPPLIED COMPLETE WITH FLAT WASHERS & GRADE 4 FULL NUTS U.N.O.
BOLTS OF LENGTHS GREATER THAN 600mm MAY BE SUBSTITUTED WITH INCREASED LENGTHS OF STUD BAR OF
COMPARABLE GRADE WITH 150 THREAD LENGTH AT BOTH ENDS. WASHERS & NUTS TO BE SUPPLIED FOR BOTH ENDS.

CLIENT PowerSystems	TITLE PART - WOOD POLE ATTACHMENT BOLT LENGTH DETERMINATION DRAWING SHEET 2 OF 3	SCALE NTS (UNLESS OTHERWISE STATED)		ORIGINAL SIZE A4	LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617 
		DATE 28/01/05		CHECKED GS	
SPECIFICATION OHL-03-132		DRAWN R.T.J.	APPROVED PP		
		DRAWING NUMBER LSTC/STD/GNA/555		REV 6	