



DESCRIPTION		FOR ISSUE					
REV	2	DATE	13/08/07	BY	JR	CHKD	GS
						APPD	PP

STAY BLOCK FOUNDATION DETAILS

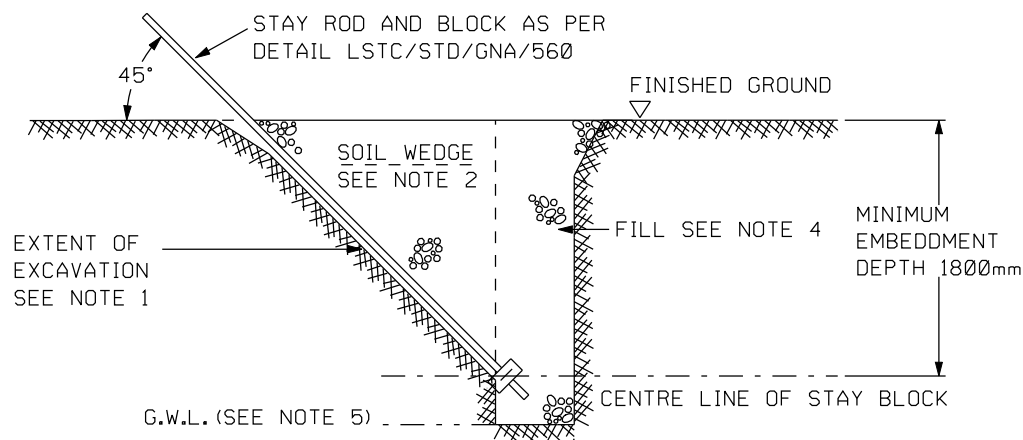

SECTIONAL ELEVATION

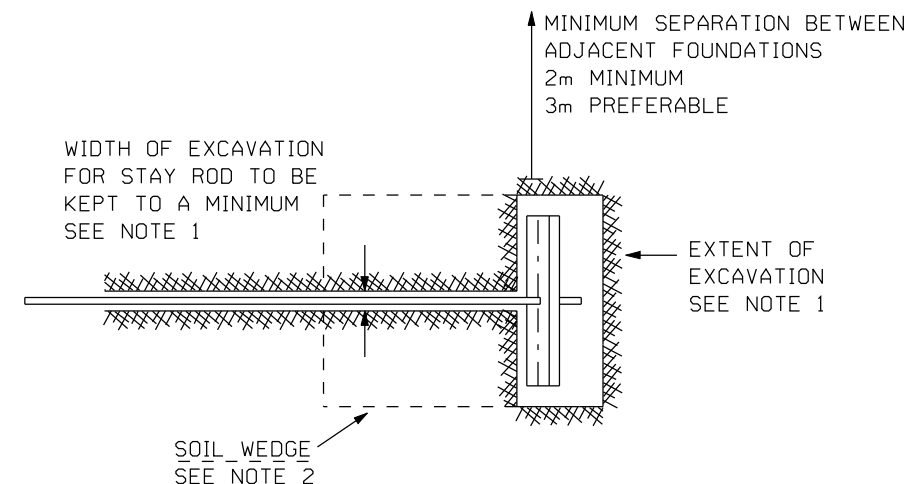

PLAN OF EXCAVATION LIMITS

NOTES FOR STAY BLOCK FOUNDATION DETAIL:

1. THE EXTENT OF THE EXCAVATION IS TO BE KEPT TO A MINIMUM TO AVOID DISTURBING THE SOIL WEDGE ABOVE THE STAY ROD AND BLOCK PROVIDING ANCHORAGE.
2. THE MINIMUM IN SITU DRY DENSITY OF THE SOIL WEDGE IS TO BE NO LESS THAN 1750kg/m^3 .
3. IF THE DRY DENSITY OF THE SOIL WEDGE IS LESS THAN 1750kg/m^3 THIS CAN EITHER BE COMPACTED TO RAISE ITS DENSITY WITH THE GROUND LEVEL MADE UP TO ORIGINAL WITH COMPACTED IMPORTED SUITABLE MATERIAL, OR THE EXISTING SOFT LOW DENSITY MATERIAL IS REMOVED AND REPLACED WITH A SUITABLY COMPACTED MATERIAL WHICH CAN ACHIEVE THE REQUIRED DRY IN SITU DENSITY.
4. TRENCHES AND EXPOSED EXCAVATIONS FOR THE STAY BLOCK AND THE STAY RODS ARE TO BE BACKFILLED WITH SUITABLE ARISINGS AND/OR IMPORTED FILL MATERIAL AND COMPACTED TO ACHIEVE THE SAME DRY DENSITY OF THE SOIL WEDGE. APPROXIMATE VOLUME OF FILL 3m^3 .
5. WHERE THERE IS HIGH GROUND WATER LEVEL ABOVE THE FORMATION LEVEL OF THE STAY BLOCK FOUNDATION, A SPECIAL FOUNDATION WILL BE REQUIRED.

GENERAL NOTES:	CLIENT	TITLE	SCALE	ORIGINAL SIZE	LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617
	POWER SYSTEMS		(UNLESS OTHERWISE STATED)	A4	
SPECIFICATION	OHL-03-132	STAY - FOUNDATION BLOCK DETAILS	DATE	CHECKED	
			05/05/2005	GS	
			DRAWN	APPROVED	
			RF	PP	
			DRAWING NUMBER	REV	
			LSTC/STD/GNA/596	2	