




Specification Soil Description	Typical Soil Types	Typical Ranges of Drained Dry Density kg/m³ See Note 3	Typical θ° Values For Drained Dry Condition
Granular Type Soils			
Very Poor	Loose coarse to fine Sand Loose fine silty Sand	See Note 2	
Poor	Medium Dense coarse to fine Sand Medium Dense fine silty Sand Loose Gravel with low sand content Loose well graded sandy Gravel Loose clayey sandy Gravel	No Less Than 1900kg/m³	30 to 35
Average	Medium Dense Gravel with low sand content Medium Dense well graded sandy Gravel Medium Dense clayey sandy Gravel	No Less Than 2000kg/m³	35 to 40
Good	Dense to very Dense Gravel with low sand content Dense well graded sandy Gravel Dense to very dense clayey sandy Gravel	No Less Than 2200kg/m³	40 to 45
Cohesive Type Soils			Typical Cohesive C_u Values kN/m² For Dry Conditions
Very Poor	Peat Organic Clay Soft Plastic Clay Soft Slightly Plastic Clay	See Note 2	
Poor	Firm Plastic Clay Firm Slightly Plastic Clay	No Less Than 1900kg/m³	75 to 150
Average	Stiff Plastic Clay Stiff Slightly Plastic Clay	No Less Than 2000kg/m³	150 to 300
Good	Stiff to Very Stiff Clay	No Less Than 2200kg/m³	> 300

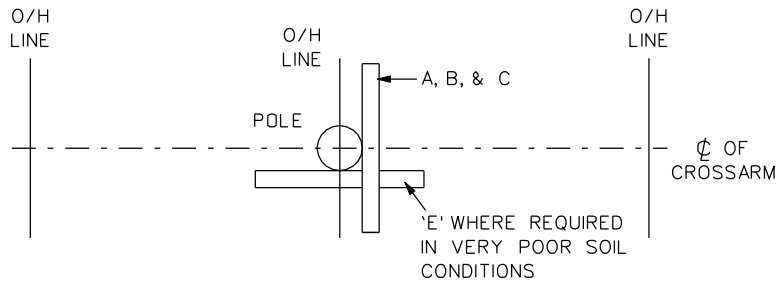


PLAN VIEW
TYPICAL FOUNDATION DETAILS
FOR SINGLE POLE INTERMEDIATE STRUCTURES

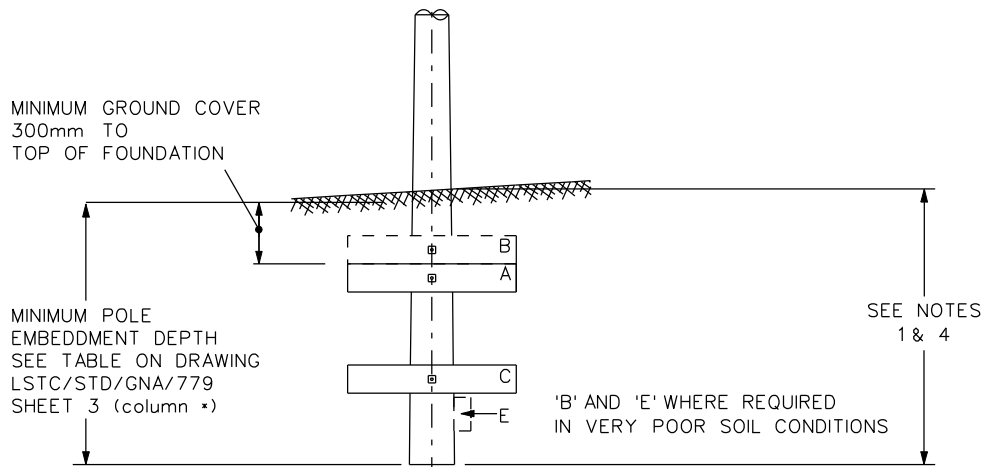


SIDE ELEVATION
TYPICAL FOUNDATION DETAIL
FOR SINGLE POLE STRUCTURES

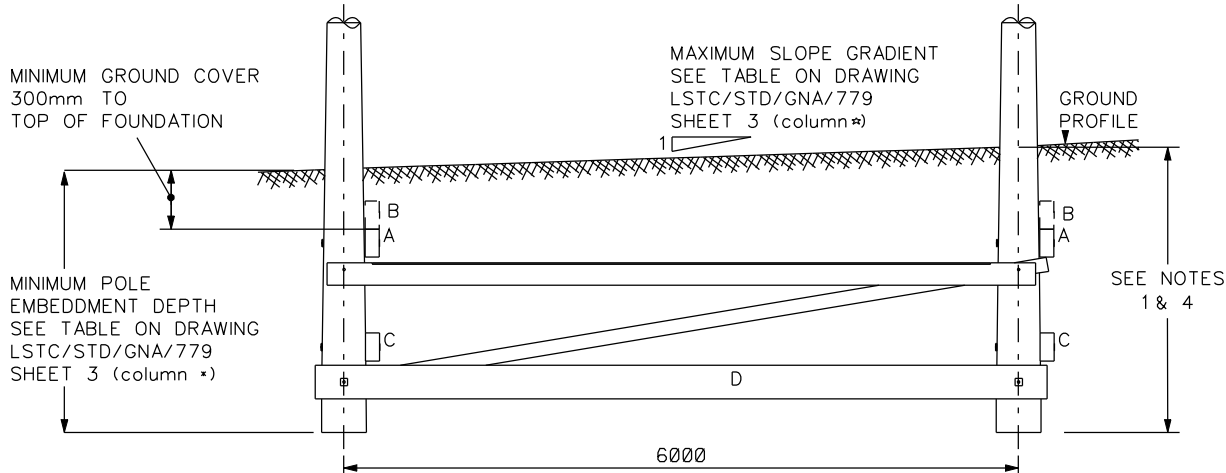

FRONT ELEVATION
TYPICAL FOUNDATION DETAIL
FOR WOOD POLE CONTAINMENT STRUCTURE

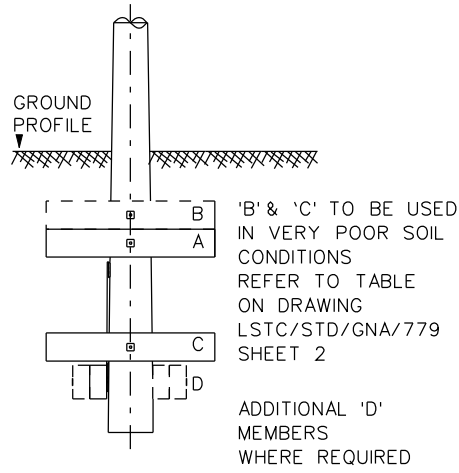

SIDE ELEVATION
TYPICAL FOUNDATION DETAIL
FOR 2 POLE STRUCTURES

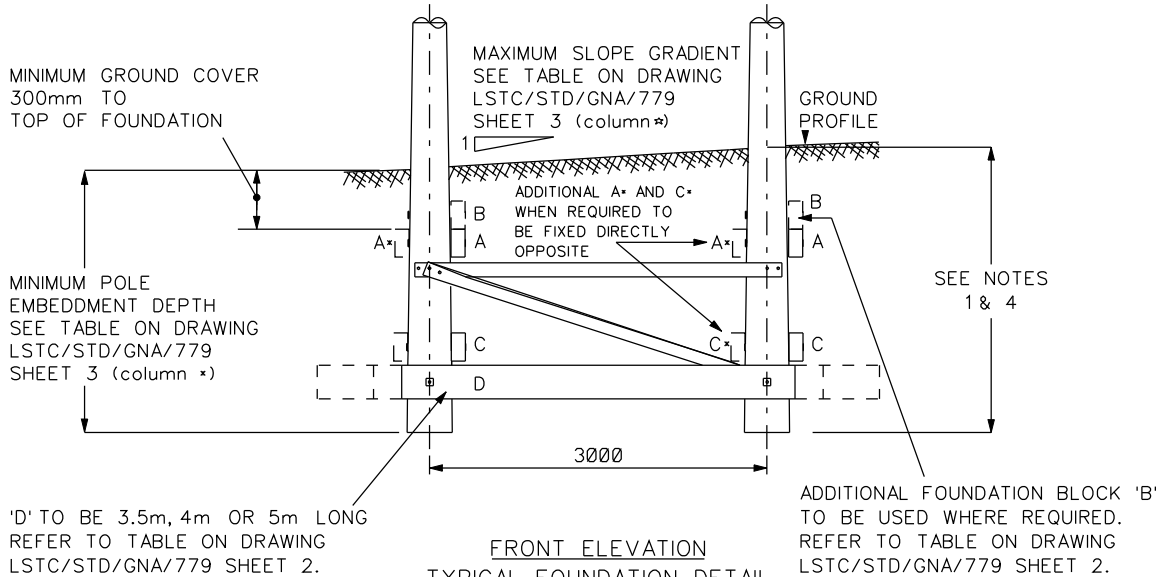

FRONT ELEVATION
TYPICAL FOUNDATION DETAIL
FOR TRIDENT STRUCTURES
FOR 3m POLE SPACINGS

- GENERAL NOTES:
- BACKFILL TO FOUNDATION EXCAVATIONS TO BE COMPACTED AND ALL VOIDS FILLED BACK TO EXISTING GROUND LEVEL WITH ARISING FREE FROM VEGETATION AND TOPSOIL. ANY SHORTFALL TO MADE UP WITH SUITABLE IMPORTED MATERIAL TO BRING BACKFILL UPTO EXISTING GROUND LEVEL.
 - IF THE SOIL CONDITIONS ENCOUNTERED ON SITE CANNOT MEET THE MINIMUM PARAMETERS DEFINED FOR THE TYPICAL SOIL TYPES, A SPECIAL FOUNDATION WILL BE REQUIRED. SEE LSTC/STD/GNA/779 (SHEET 4 OF 4)
 - THESE FOUNDATIONS ARE APPLICABLE ONLY FOR DRY SOIL CONDITIONS. WHERE SOILS ARE SATURATED OR WET, THEY ARE TO BE TREATED AS VERY POOR SOIL CONDITIONS AND A SPECIAL FOUNDATION DESIGN WILL BE REQUIRED. SEE LSTC/STD/GNA/779 (SHEET 4 OF 4)
 - MINIMUM POLE EMBEDMENT ON UP SLOPE TO BE 2.5m
 - ALL DIMENSIONS ARE IN MILLIMETRES (mm) UNLESS NOTED OTHERWISE
 - REFER TO AN ENGINEER FOR ANY GRADIENTS GREATER THAN SPECIFIED, FURTHER CALCULATIONS MAY BE REQUIRED

	CLIENT	TITLE	SCALE	ORIGINAL SIZE	LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617
	PowerSystems		N.T.S (UNLESS OTHERWISE STATED)	A3	
	SPECIFICATION		DATE	CHECKED	
	OHL-03-132		07/04/05	GS	
		FOUNDATION - DRAWING AND CHART - VARYING SOIL CONDITIONS (SHEET 1 OF 4)	DRAWN	APPROVED	
			JN	PP	
			DRAWING NUMBER	REV	
			LSTC/STD/GNA/779	4	