
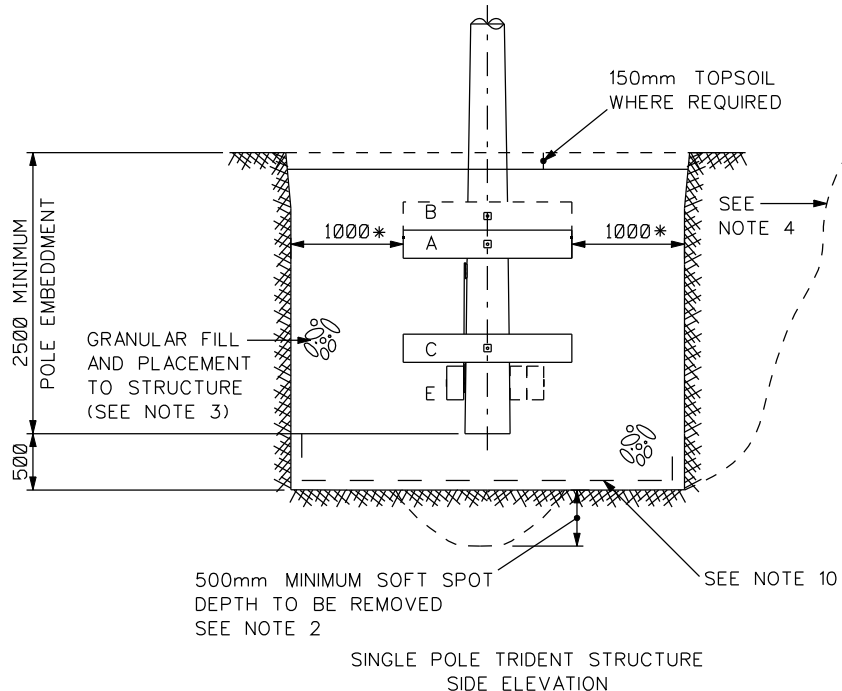
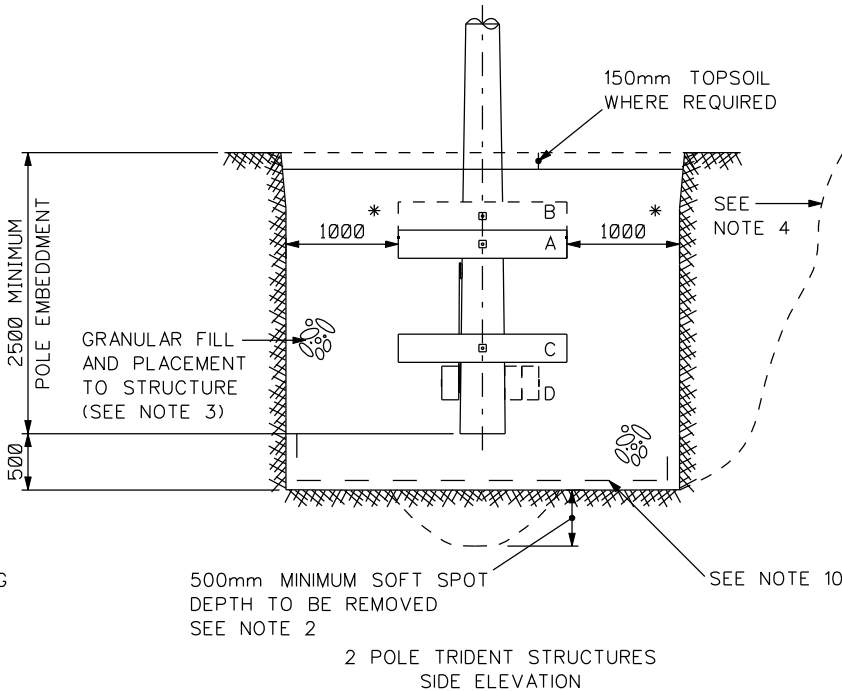


DESCRIPTION		FOR ISSUE			
REV 4	DATE 13/08/07	BY JR	CHKD GS	APPD PP	

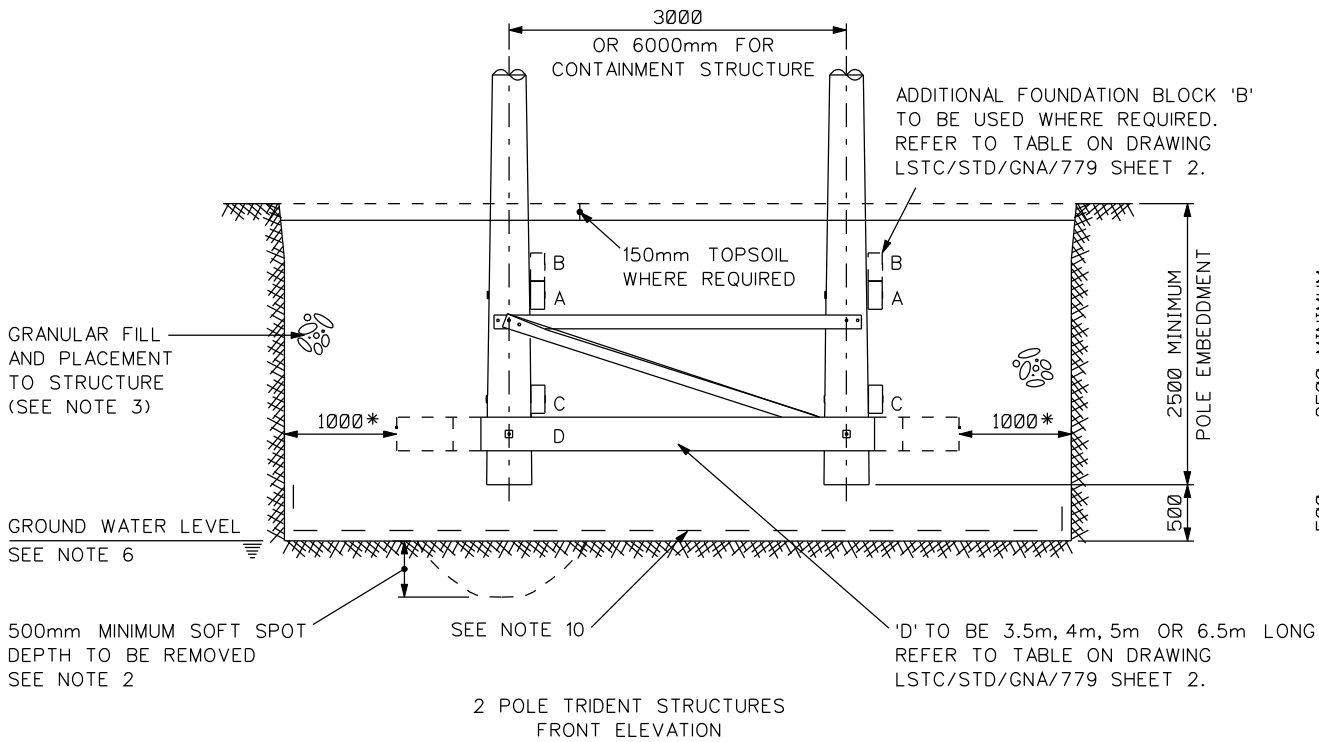

* MINIMUM WORKING CLEARANCE BETWEEN FACE OF EXCAVATION AND STRUCTURE TO ALLOW ACCESS TO PLACE GRANULAR FILL AND COMPACT.

APPROXIMATE VOLUMES OF COMPACTED GRANULAR FILL REQUIRED FOR EACH STRUCTURE TYPE:

STRUCTURE TYPE	EXCAVATION / FILL VOLUME M ³
H-POLE INTERMEDIATE	63
0 TO 5° ANGLE	73.5
5 TO 20° ANGLE	57.75
20 TO 35° ANGLE	57.75
2 POLE TERMINAL	57.75
0° SECTION UPTO 120M	73.5
0° SECTION 120 TO 150M	73.5
0° SECTION UNSTAYED	57.75
SINGLE POLE INTERMEDIATE	36.75
FAILURE CONTAINMENT WOOD POLE	89.25
4 POLE TERMINAL	57.75

- DIMENSIONS TO OUTSIDE FACES AND UNDERSIDES OF POLES ARE MINIMUM EXCAVATION SIZES TO BE CONSTRUCTED WHEN REMOVING EXISTING VERY POOR SOIL MATERIAL.
- FORMATION AT BOTTOM OF EXCAVATION TO BE PROOF ROLLED AND COMPACTED WITH ANY SOFT SPOTS REMOVED AND REPLACED WITH COMPACTED GRANULAR FILL, TO A MINIMUM DEPTH BEYOND FORMATION LEVEL OF 500mm.
- GRANULAR FILL TO BE A D.O.T TYPE 1 OR 2 GRADED MATERIAL TO BE PLACED IN LAYERS NOT EXCEEDING 100mm THICKNESS AND COMPACTED TO ACHIEVE A MINIMUM IN-SITU DENSITY OF NOT LESS THAN 1750 kg/m³ ABSOLUTE, TARGET DENSITY OF 1850 kg/m³.
- ANY OVER DIG TO FORM BATTERS AND STABLE SIDE SLOPES ARE TO BE BACKFILLED WITH COMPACTED GRANULAR BACKFILL AS SPECIFIED IN NOTE 3.
- THE CONTRACTOR IS TO ADOPT MEASURES TO KEEP THE OPEN EXCAVATION SUPPORTED AND FREE OF STANDING WATER UNTIL THE FOUNDATION HAS BEEN COMPLETED.
- WHERE GROUND WATER LEVEL IS ABOVE FOUNDATION FORMATION LEVEL AND IT IS IMPRACTICAL TO KEEP THE EXCAVATION STABLE AND DRY DURING CONSTRUCTION AN ALTERNATIVE SPECIAL FOUNDATION IS TO BE DESIGNED BY THE CONTRACTOR.
- MINIMUM POLE EMBEDDMENT TO BE 2.5M IN HORIZONTAL GROUND.
- ALL DIMENSIONS ARE IN MILLIMETRES UNLESS STATED OTHERWISE.
- STRUCTURES APPLICABLE TO HORIZONTAL GROUND PROFILES ONLY, FOR GROUND GRADIENTS ACROSS THE POLES REFER TO ENGINEER TO VERIFY STABILITY OF STRUCTURE.
- GEOTEXTILE MEMBRANE TO BE PLACED IN BOTTOM OF BASE EXCAVATION PRIOR TO GRANULAR BACKFILL.

CLIENT	PowerSystems
SPECIFICATION	OHL-03-132

FOUNDATION -
DRAWING AND CHART -
VARYING SOIL CONDITIONS
(SHEET 4 OF 4)

SCALE	N.T.S	ORIGINAL SIZE	A3
DATE	07/04/05	CHECKED	GS
DRAWN	JN	APPROVED	PP
DRAWING NUMBER	LSTC/STD/GNA/779	REV	4

LS TRANSMISSION CONSULTANCY LIMITED
Yorkshire House
York Road
Little Driffield
East Yorkshire
YO25 5XA
01377 253617