


DESCRIPTION		FOR ISSUE			
REV	DATE	BY	CHKD	APPD	
3	24/07/07	JR	GS	PP	

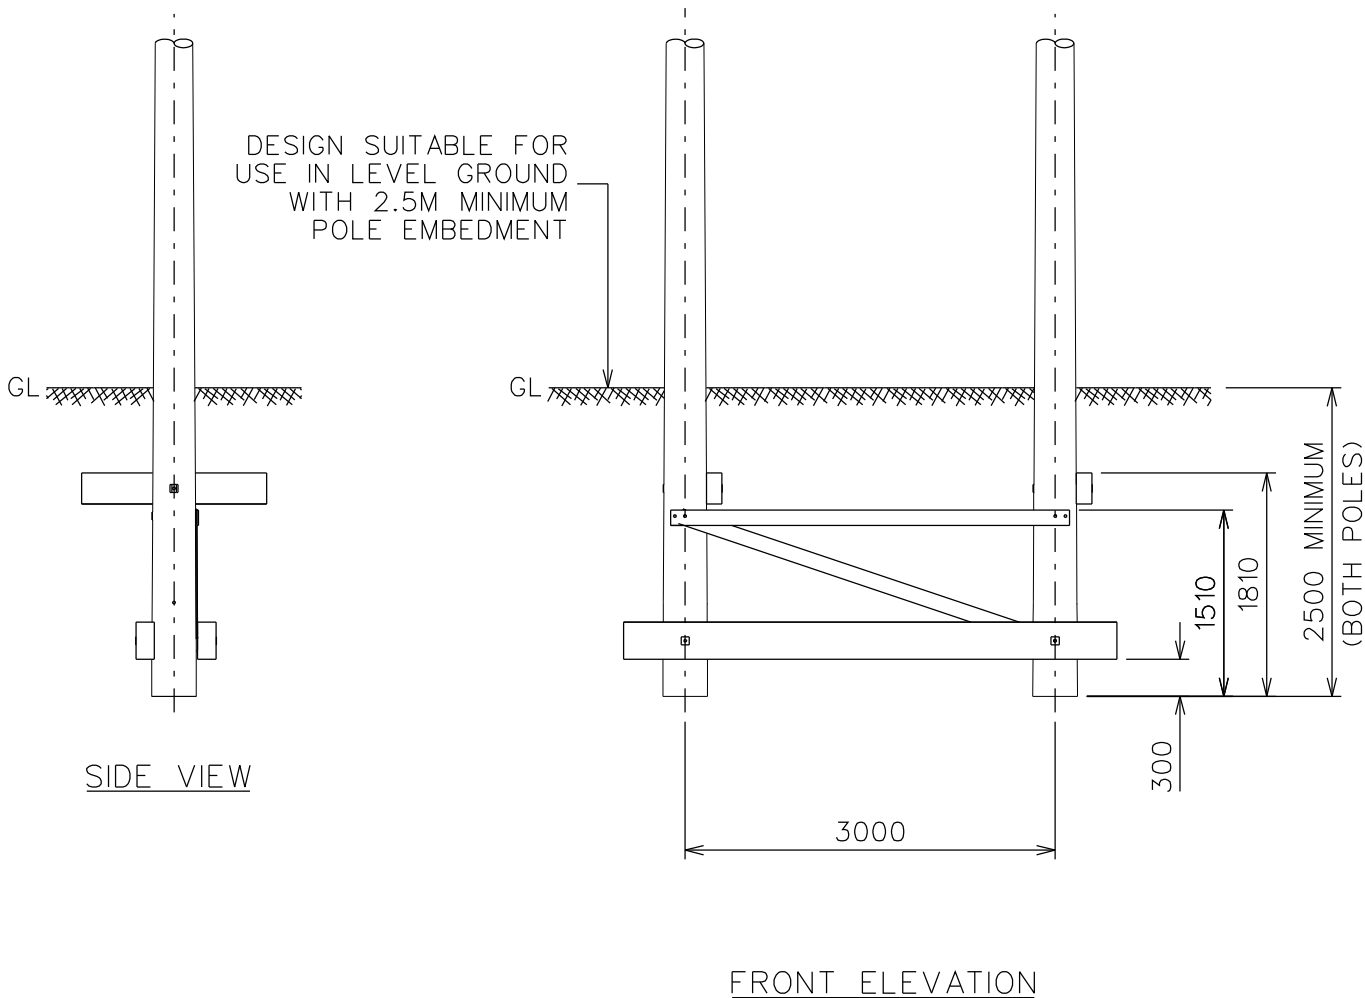

GENERAL NOTES:

1. ALL STEELWORK TO BE PROTOTYPE CHECK ERECTED PRIOR TO MASS PRODUCTION.
2. ALL DIMENSIONS ARE IN MILLIMETRES.
3. NO ADDITIONAL ITEMS REQUIRED WHEN "POOR" SOIL CONDITIONS ARE ENCOUNTERED, BUT CAN ONLY BE INSTALLED IN LEVEL GROUND WITH 2.5M MINIMUM EMBEDMENT.
4. IMPORTANT: REFER TO LSTC/STD/GNA/779 SHEETS 1 TO 4 FOR FOUNDATION DESIGN CRITERIA.

SHT 1 : SOIL CLASSIFICATIONS & POLE EMBEDMENT DETAILS.
 SHT 2 : FOUNDATION DETAILS / STRUCTURE TYPES.
 SHT 3 : FACTORS OF SAFETY.
 SHT 4 : OUTLINE DESIGN FOR "VERY POOR" SOIL FOUNDATIONS.
5. TO BE READ IN CONJUNCTION WITH:
 LSTC/STD/GNA/500: H-POLE INTERMEDIATE STRUCTURE.
 LSTC/STD/GNA/501: MATERIAL LIST
 LSTC/STD/GNA/555: BOLT LENGTH DETERMINATION

CLIENT	PowerSystems	TITLE	SCALE 1:60 (UNLESS OTHERWISE STATED)	ORIGINAL SIZE A4	LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617	
SPECIFICATION	OHL-03-132	ADDITIONAL MATERIAL - 'H' POLE INTERMEDIATE POOR SOIL CONDITIONS	DATE 11/05/05	CHECKED GS		
			DRAWN R.F.	APPROVED PP		
			DRAWING NUMBER			REV
			LSTC/STD/GNA/789			3