



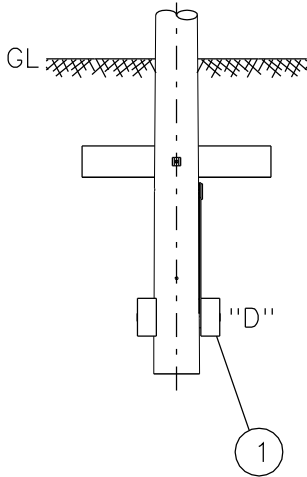

SIDE VIEW

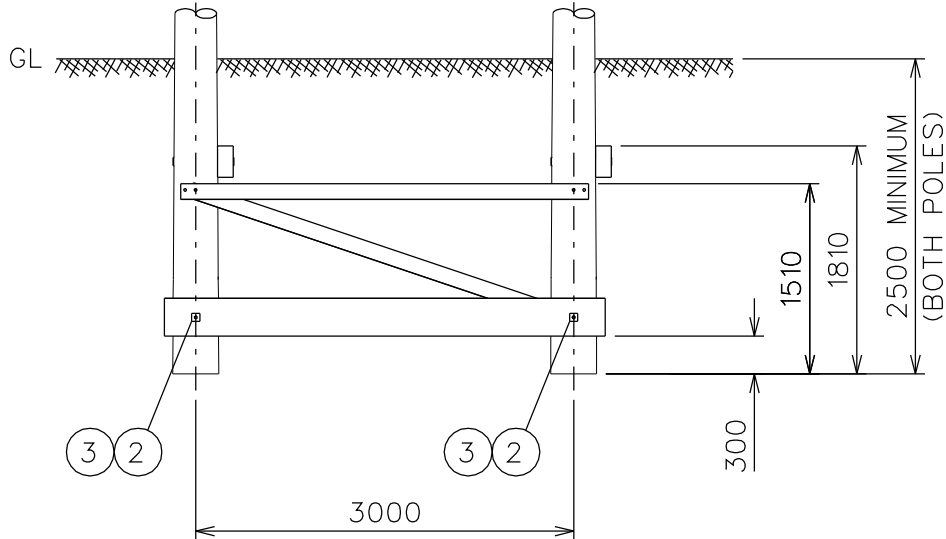

FRONT ELEVATION

	ITEM - DESCRIPTION	REFERENCE No.	QTY REQ'D	WEIGHT EACH (Kg)	REMARKS
1	"H" Pole Timber Baulk	LSTC/STD/PAR/601	1	135	Timber Baulk "D" in addition to LSTC/STD/GNA/505
2	M20 Bolts x Length To Suit Pole Diameter	LSTC/STD/GNA/555	2	1.5	M20 Bolts to attach additional Timber Baulk "D" to Foundation
3	Square Flat Washer	LSTC/STD/PAR/619	2	0.1	Flat Washers in addition to LSTC/STD/GNA/505
4					
5					
6					
7					
8					

Total Additional Calculated Weight = 138Kg

GENERAL NOTES:

- ALL STEELWORK TO BE PROTOTYPE CHECK ERECTED PRIOR TO MASS PRODUCTION.
 - ALL DIMENSIONS ARE IN MILLIMETRES.
 - MATERIAL LIST INDICATES ADDITIONAL ITEMS REQUIRED WHEN "POOR" SOIL CONDITIONS ARE ENCOUNTERED.
THESE FOUNDATIONS CAN ONLY BE INSTALLED IN LEVEL GROUND.
TO BE READ IN CONJUNCTION WITH:
LSTC/STD/GNA/505: 5-20° ANGLE STRUCTURE
LSTC/STD/GNA/507: MATERIAL LIST
LSTC/STD/GNA/555: BOLT LENGTH DETERMINATION
 - IMPORTANT: REFER TO LSTC/STD/GNA/779 SHEETS 1 TO 4 FOR FOUNDATION DESIGN CRITERIA.
- SHT 1 : SOIL CLASSIFICATIONS & POLE EMBEDMENT DETAILS.
SHT 2 : FOUNDATION DETAILS / STRUCTURE TYPES.
SHT 3 : FACTORS OF SAFETY.
SHT 4 : OUTLINE DESIGN FOR "VERY POOR" SOIL FOUNDATIONS.

CLIENT	PowerSystems	TITLE	ADDITIONAL MATERIAL - 5-20° ANGLE STRUCTURE POOR SOIL CONDITIONS	SCALE	1:60 (UNLESS OTHERWISE STATED)	ORIGINAL SIZE	A4	LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617
	SPECIFICATION			DATE	11/05/05	CHECKED	GS	
				DRAWN	R.F.	APPROVED	PP	
				DRAWING NUMBER	LSTC/STD/GNA/794	REV	3	