


DESCRIPTION		FOR ISSUE			
REV	DATE	BY	CHKD	APPD	
3	27/07/07	JR	GS	PP	

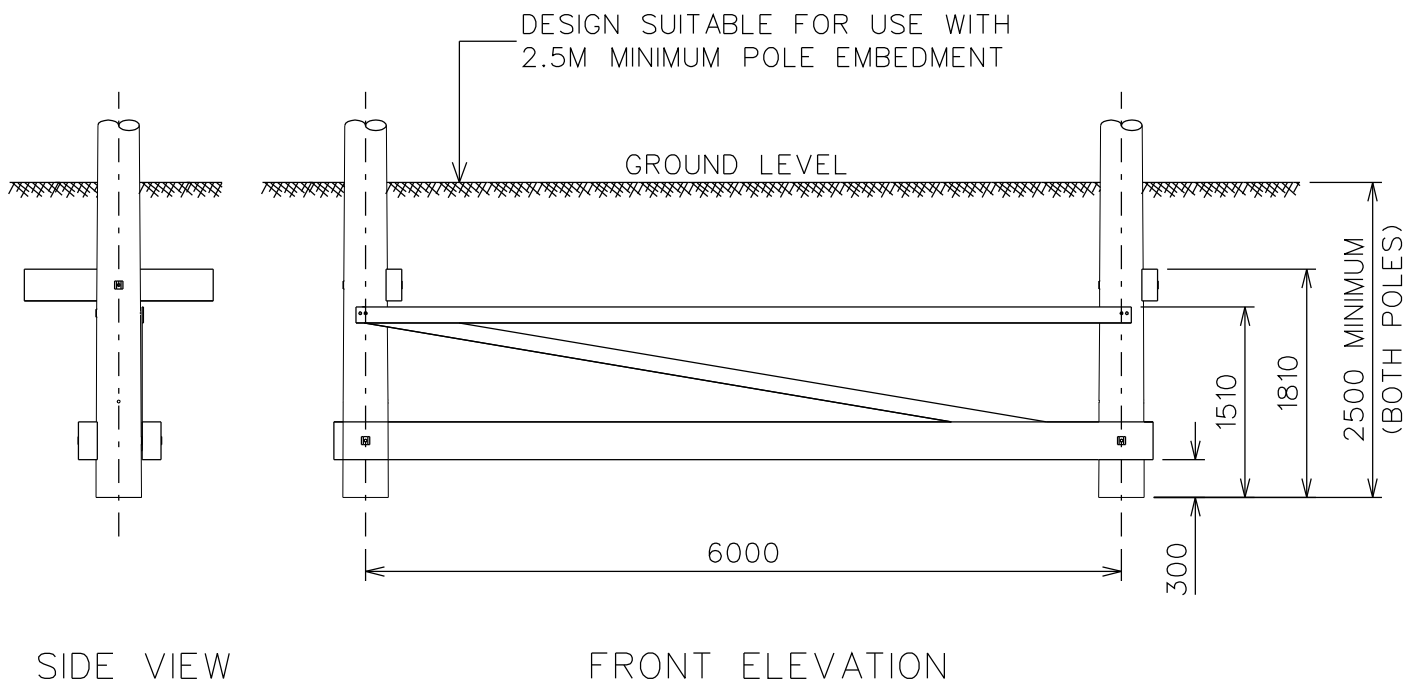

GENERAL NOTES:

- ALL STEELWORK TO BE PROTOTYPE CHECK ERECTED PRIOR TO MASS PRODUCTION.
- ALL DIMENSIONS ARE IN MILLIMETRES.
- NO ADDITIONAL ITEMS REQUIRED WHEN "POOR" SOIL CONDITIONS ARE ENCOUNTERED. FOUNDATIONS TO HAVE MINIMUM EMBEDMENT DEPTH OF 2.5M.
TO BE READ IN CONJUNCTION WITH:
LSTC/STD/GNA/527: FAILURE CONTAINMENT WOOD POLE
LSTC/STD/GNA/529: MATERIAL LIST
LSTC/STD/GNA/555: BOLT LENGTH DETERMINATION
- IMPORTANT: REFER TO LSTC/STD/GNA/779 SHEETS 1 TO 4 FOR FOUNDATION DESIGN CRITERIA.

SHT 1 : SOIL CLASSIFICATIONS & POLE EMBEDMENT DETAILS.
SHT 2 : FOUNDATION DETAILS / STRUCTURE TYPES.
SHT 3 : FACTORS OF SAFETY.
SHT 4 : OUTLINE DESIGN FOR "VERY POOR" SOIL FOUNDATIONS.

CLIENT	PowerSystems	TITLE	SCALE 1:60 (UNLESS OTHERWISE STATED)		ORIGINAL SIZE A4	LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617
			DATE 16/05/05	CHECKED GS		
SPECIFICATION	OHL-03-132	ADDITIONAL MATERIAL FAILURE CONTAINMENT WOOD POLE POOR SOIL CONDITIONS	DRAWN R.F.	APPROVED PP		
			DRAWING NUMBER LSTC/STD/GNA/811	REV 3		