


DESCRIPTION									
FIRST ISSUE									
REV	1	DATE	02/04/08	BY	R.T.J	CHKD	GS	APPD	PP

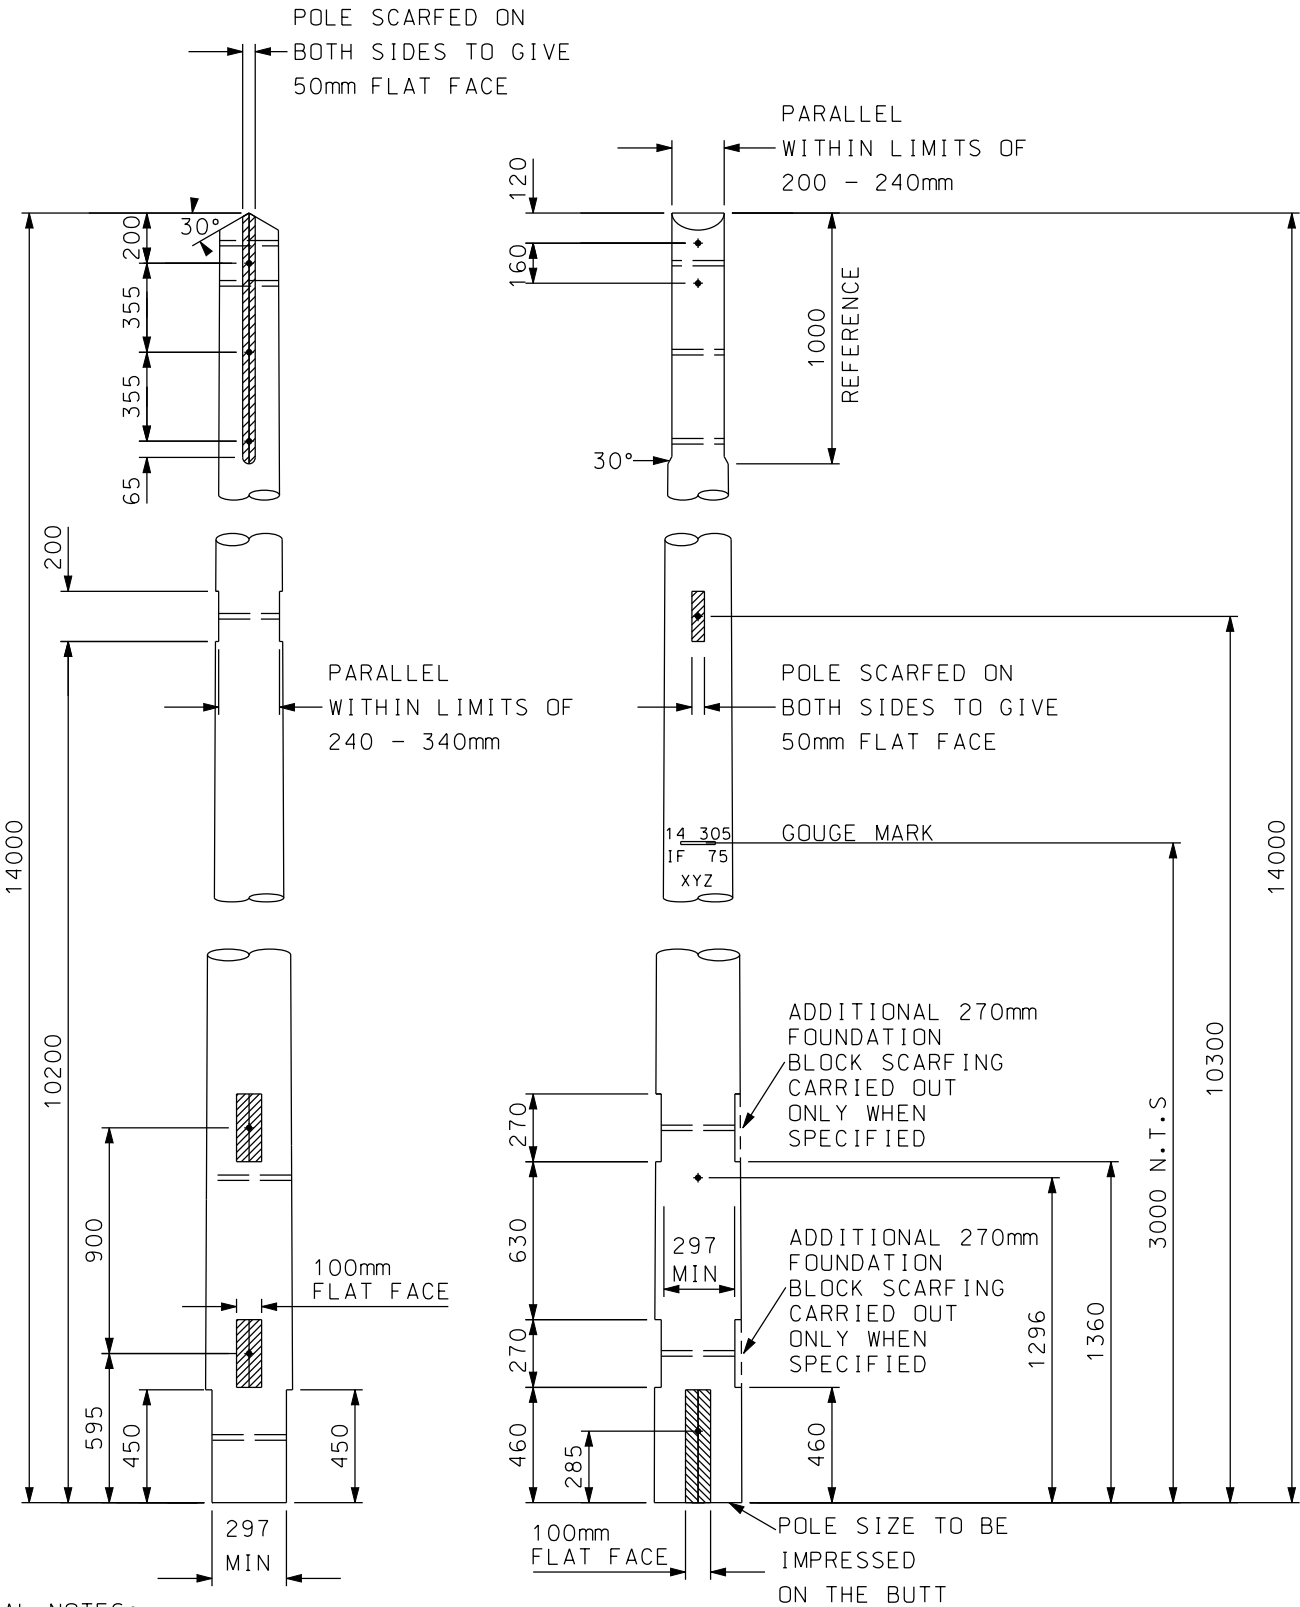

GENERAL NOTES:

- 1. ALL DIMENSIONS ARE IN mm, UNLESS NOTED
- 2. ALL DRILLINGS TO BE 22mm DIAMETER HOLES
- 3. POLE SIZES BASED ON BS1990, EXTRA STOUT POLES RANGE
LENGTH = 14m
MINIMUM TOP DIAMETER = 225mm *
MAXIMUM TOP DIAMETER = 265mm
MINIMUM DIAMETER 1.5m FROM BUTT = 365mm
* VALUE AMENDED FROM THAT SHOWN ON BS1990

REFERENCE

- 14 - POLE LENGTH
- 365 - POLE DIAMETER AT 1.5m FROM BUTT
- IF - IMPORTED REDFIR
- 75 - YEAR OF CREOSOTING
- XYZ - SUPPLIERS NAME OR MARK
- GOUGE MARK 6 WIDE x 6 DEEP 3m FROM POLE BUTT

CLIENT SSE POWER DISTRIBUTION	TITLE WOOD POLE SCARFING 4 POLE ENTRY TERMINAL STRUCTURES 14m POLE	SCALE 1 : 30 (UNLESS OTHERWISE STATED) DATE 07/01/05 DRAWN R.T.J DRAWING NUMBER LSTC/STD/PAR/240	ORIGINAL SIZE A4 CHECKED GS APPROVED PP REV 1	LS TRANSMISSION CONSULTANCY LIMITED PADDOCK HOUSE 10 MIDDLE STREET SOUTH DRIFFIELD EAST YORKSHIRE YO25 6PT TEL: 01377 240047
----------------------------------	--	--	--	---