


DESCRIPTION						
DRAFT ISSUE - REDESIGN OF FOUNDATIONS						
REV	DATE	BY	CHKD	GS	APPD	PP
C	02/08/04	JN				
DESCRIPTION						
DRAFT ISSUE - AMENDED DETAILS						
REV	DATE	BY	CHKD	GS	APPD	PP
D	04/10/04	JN				

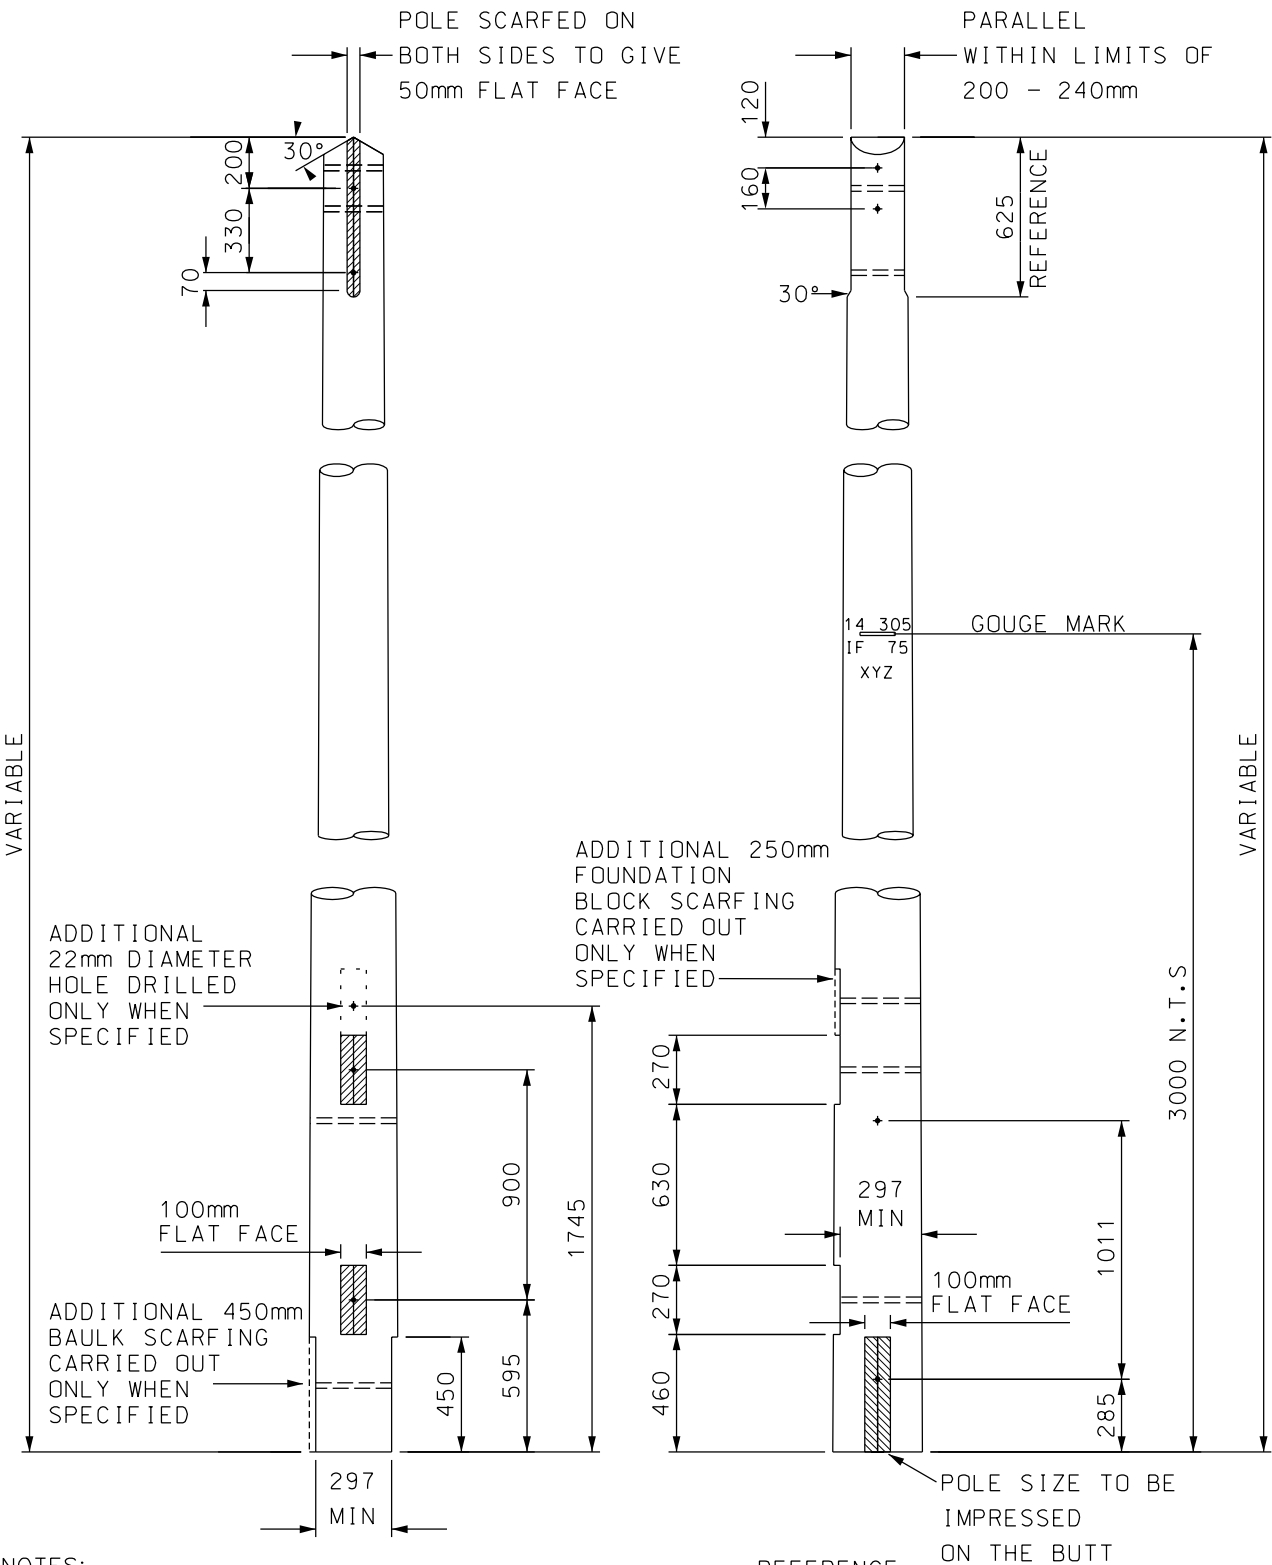

GENERAL NOTES:

- 1. ALL DIMENSIONS ARE IN mm, UNLESS NOTED
- 2. ALL DRILLINGS TO BE 22mm DIAMETER HOLES
- 3. POLE SIZES BASED ON BS1990, EXTRA STOUT POLES RANGE
LENGTH = 10.5m - 17m
MINIMUM TOP DIAMETER = 200mm*
MAXIMUM TOP DIAMETER = 265mm
MINIMUM DIAMETER 1.5m FROM BUTT = 305mm
* VALUE AMENDED FROM THAT SHOWN ON BS1990

- REFERENCE
- 14 - POLE LENGTH
 - 305 - POLE DIAMETER AT 1.5m FROM BUTT
 - IF - IMPORTED REDFIR
 - 75 - YEAR OF CREOSOTING
 - XYZ - SUPPLIERS NAME OR MARK
 - GOUGE MARK 6 WIDE x 6 DEEP 3m FROM POLE BUTT

CLIENT	TITLE	SCALE 1 : 30 (UNLESS OTHERWISE STATED)	ORIGINAL SIZE A4	 LS TRANSMISSION CONSULTANCY LIMITED PADDOCK HOUSE 10 MIDDLE STREET SOUTH DRIFFIELD EAST YORKSHIRE YO25 6PT TEL: 01377 240047	
SSE POWER DISTRIBUTION	WOOD POLE SCARFING FOR INTERMEDIATE STRUCTURES	DATE 02/08/04	CHECKED GS		
PROJECT TRIDENT STRUCTURE SMALL PIECE DETAIL		DRAWN JN	APPROVED PP		
		DRAWING NUMBER			REV
		LSTC_STD_PAR_33			D