


DESCRIPTION		FIRST ISSUE				
REV	DATE	BY	TS	CHKD	GS	APPD
1	APRIL 2007					PP

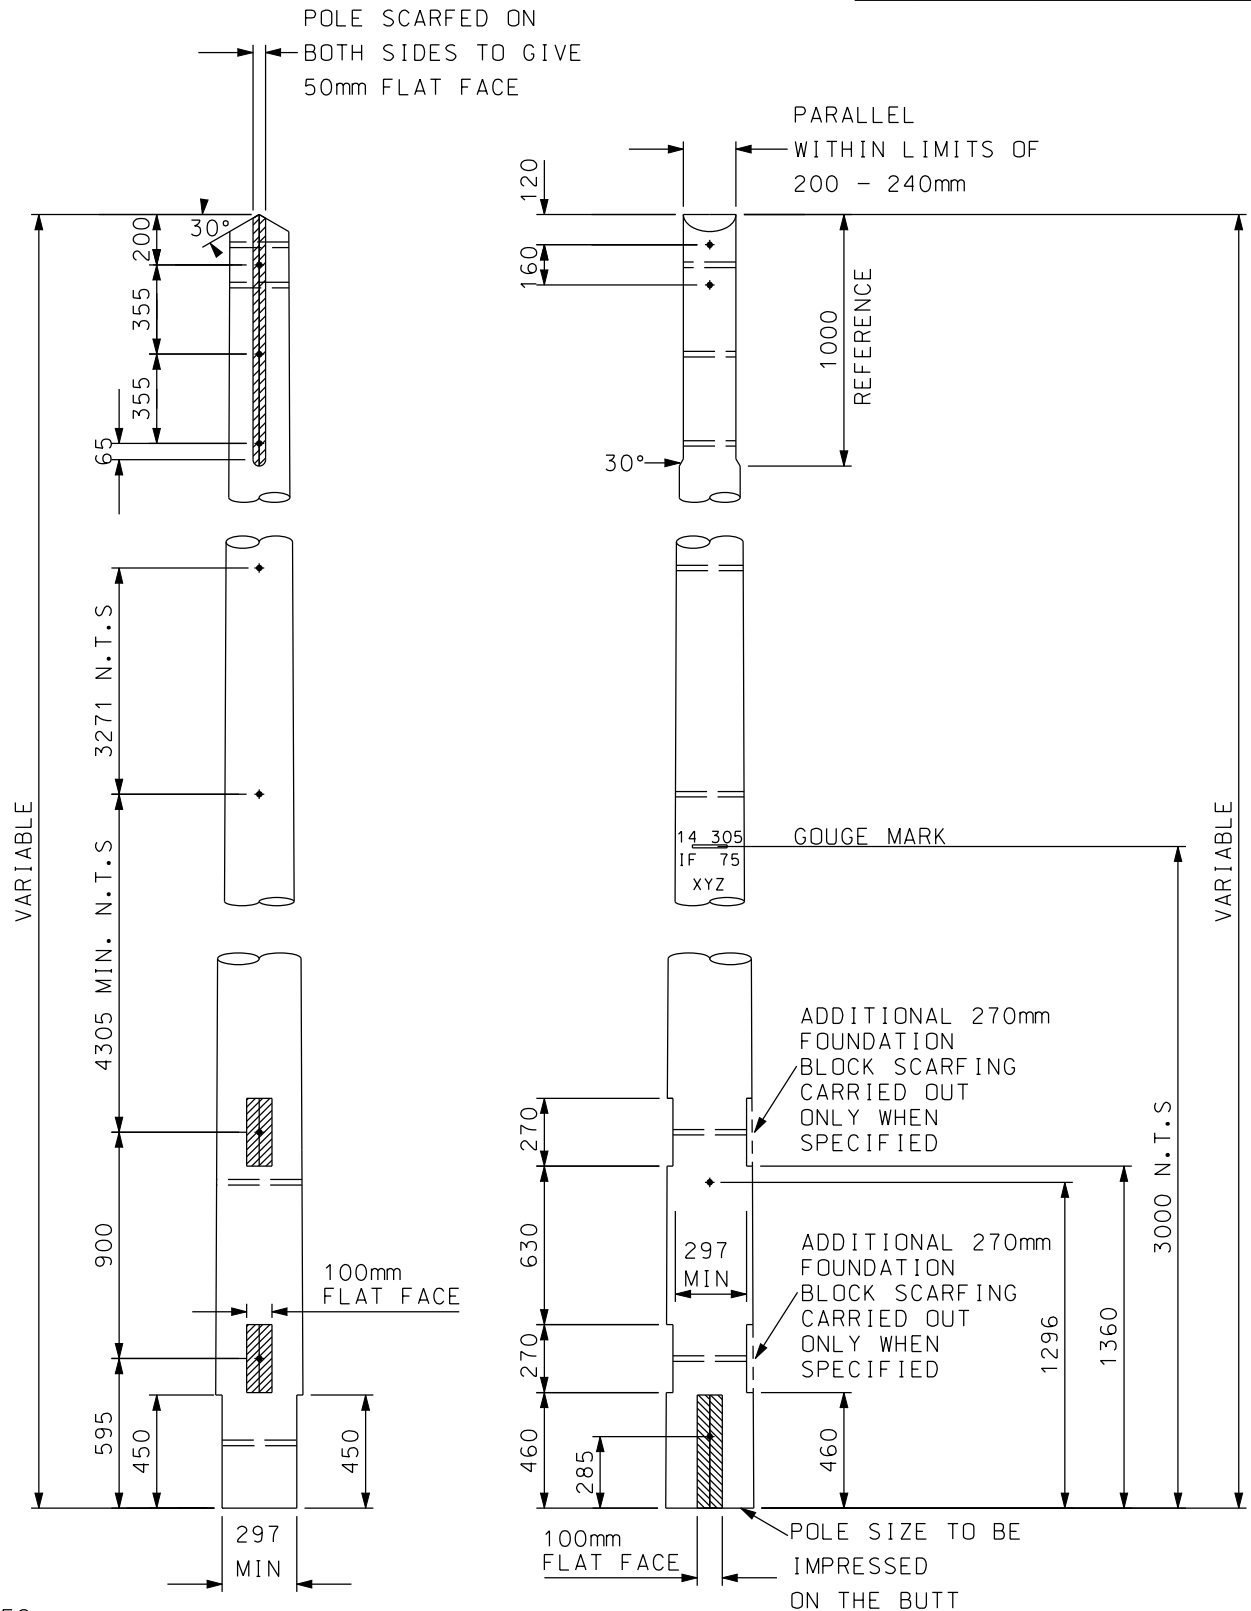

GENERAL NOTES:

1. ALL DIMENSIONS ARE IN mm, UNLESS NOTED
2. ALL DRILLINGS TO BE 22mm DIAMETER HOLES
3. POLE SIZES BASED ON BS1990, EXTRA STOUT POLES
LENGTH = 12m - 14m - REFER TO PROJECT SPECIFICATION
MINIMUM TOP DIAMETER = 200mm *
MAXIMUM TOP DIAMETER = 265mm
MINIMUM DIAMETER 1.5m FROM BUTT = 305mm
* VALUE AMENDED FROM THAT SHOWN ON BS1990

REFERENCE

- 14 - POLE LENGTH
305 - POLE DIAMETER AT 1.5m FROM BUTT
IF - IMPORTED REDFIR
75 - YEAR OF CREOSOTING
XYZ - SUPPLIERS NAME OR MARK
GOUGE MARK 6 WIDE x 6 DEEP 3m FROM POLE BUTT

CLIENT SSE POWER DISTRIBUTION	TITLE WOOD POLE SCARFING BRACED 0° WITH STAYS ENTRY TERMINAL STRUCTURES	SCALE 1 : 30 (UNLESS OTHERWISE STATED)	ORIGINAL SIZE A4	LS TRANSMISSION CONSULTANCY LIMITED YORKSHIRE HOUSE YORK ROAD LITTLE DRIFFIELD EAST YORKSHIRE YO25 5XA TEL: 01377 253617
PROJECT TG-PS-525 STRUCTURE SMALL PIECE DETAIL		DATE 02/08/04	CHECKED GS	
		DRAWN JN	APPROVED PP	
		DRAWING NUMBER LSTC_STD_PAR_34		