


DESCRIPTION					
DRAFT ISSUE - REDESIGN OF FOUNDATIONS					
REV	DATE	BY	CHKD	GS	APPD
C	02/08/04	JN	GS	PP	
DESCRIPTION					
DRAFT ISSUE - AMENDED DETAILS					
REV	DATE	BY	CHKD	GS	APPD
D	04/10/04	JN	GS	PP	

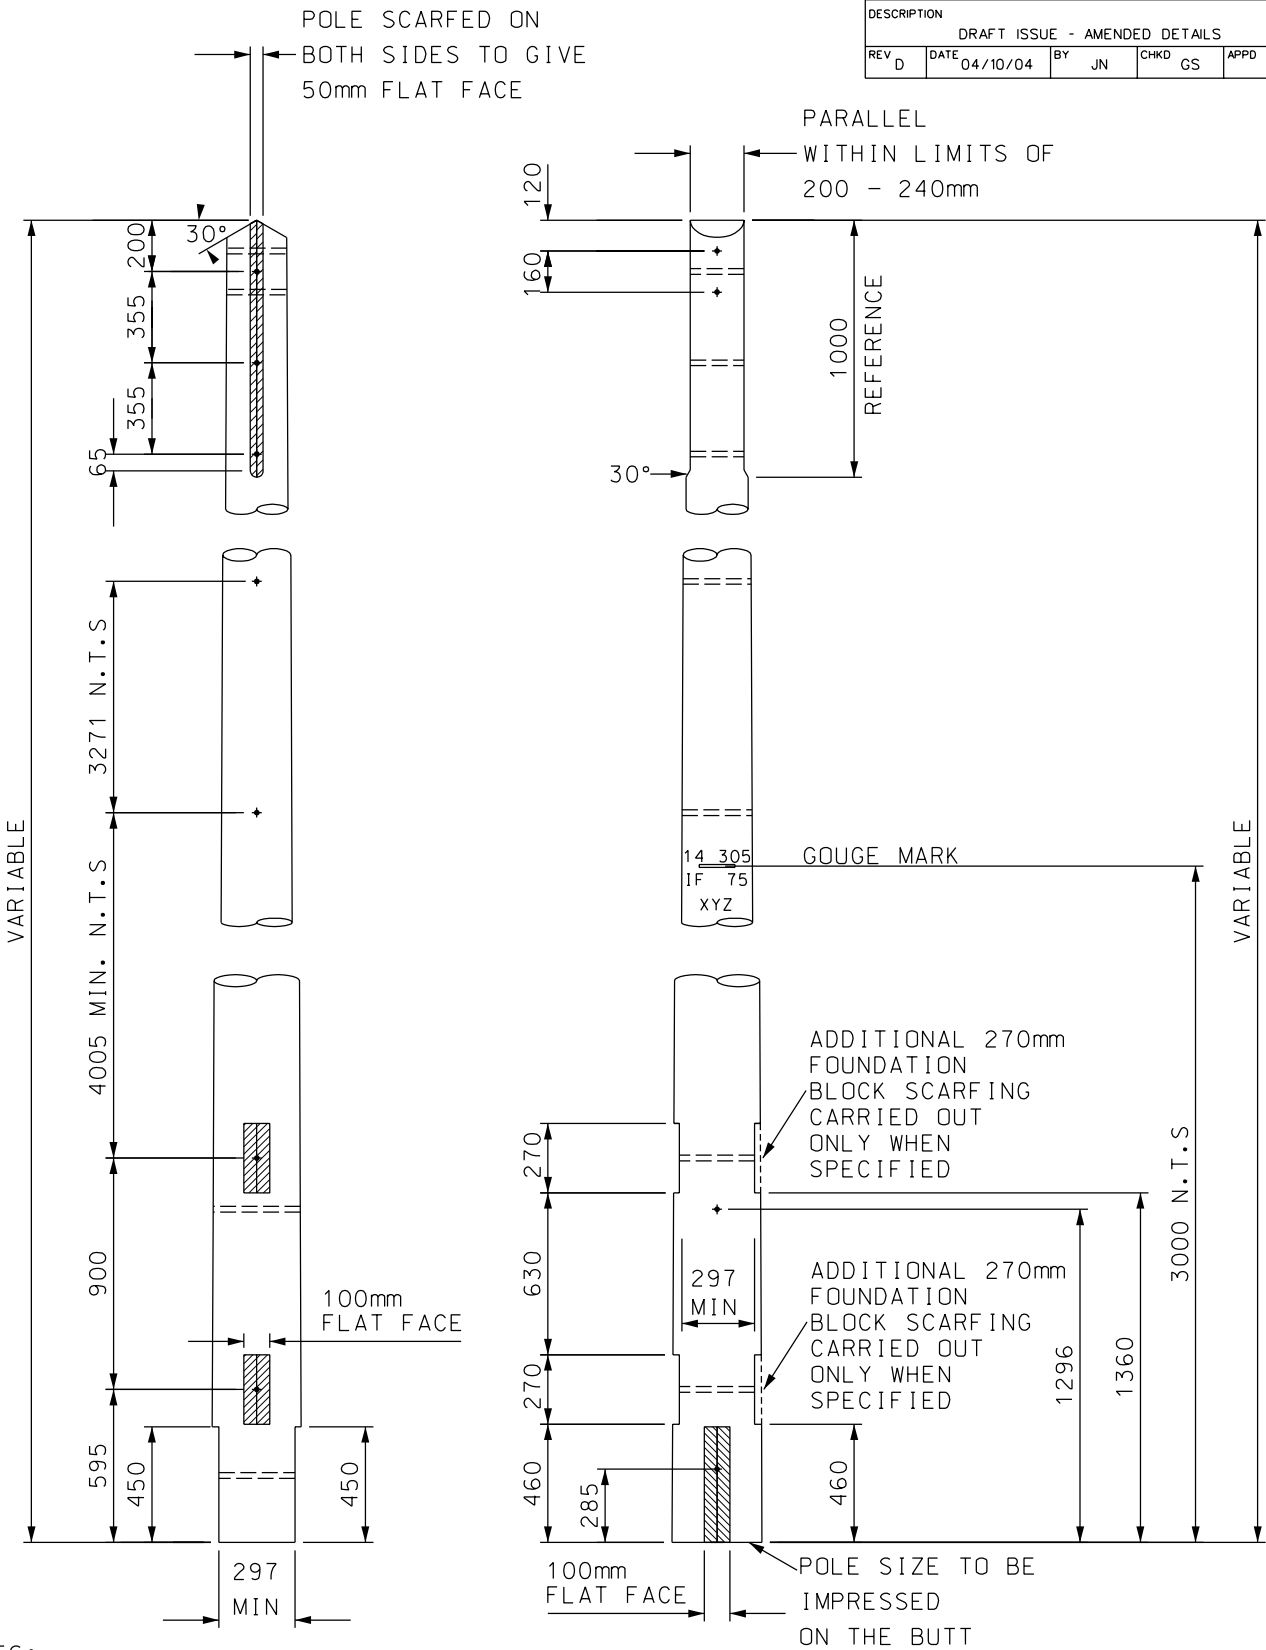

GENERAL NOTES:

1. ALL DIMENSIONS ARE IN mm, UNLESS NOTED
2. ALL DRILLINGS TO BE 22mm DIAMETER HOLES
3. POLE SIZES BASED ON BS1990, EXTRA STOUT POLES RANGE
LENGTH = 10.5m - 17m
MINIMUM TOP DIAMETER = 200mm *
MAXIMUM TOP DIAMETER = 265mm
MINIMUM DIAMETER 1.5m FROM BUTT = 305mm
* VALUE AMENDED FROM THAT SHOWN ON BS1990

REFERENCE

14 - POLE LENGTH
305 - POLE DIAMETER AT 1.5m FROM BUTT
IF - IMPORTED REDFIR
75 - YEAR OF CREOSOTING
XYZ - SUPPLIERS NAME OR MARK
GOUGE MARK 6 WIDE x 6 DEEP 3m FROM POLE BUTT

CLIENT	TITLE	SCALE 1 : 30 (UNLESS OTHERWISE STATED)	ORIGINAL SIZE A4	LS TRANSMISSION CONSULTANCY LIMITED PADDOCK HOUSE 10 MIDDLE STREET SOUTH DRIFFIELD EAST YORKSHIRE YO25 6PT TEL: 01377 240047 	
SSE POWER DISTRIBUTION	WOOD POLE SCARFING BRACED 0° WITH STAYS ENTRY TERMINAL STRUCTURES	DATE 02/08/04	CHECKED GS		
PROJECT		DRAWN JN	APPROVED PP		
		DRAWING NUMBER			REV
		LSTC_STD_PAR_34			D
TRIDENT STRUCTURE SMALL PIECE DETAIL					