


DESCRIPTION						
FIRST ISSUE						
REV	DATE	BY	TS	CHKD	GS	APPD
1	APRIL 2007					

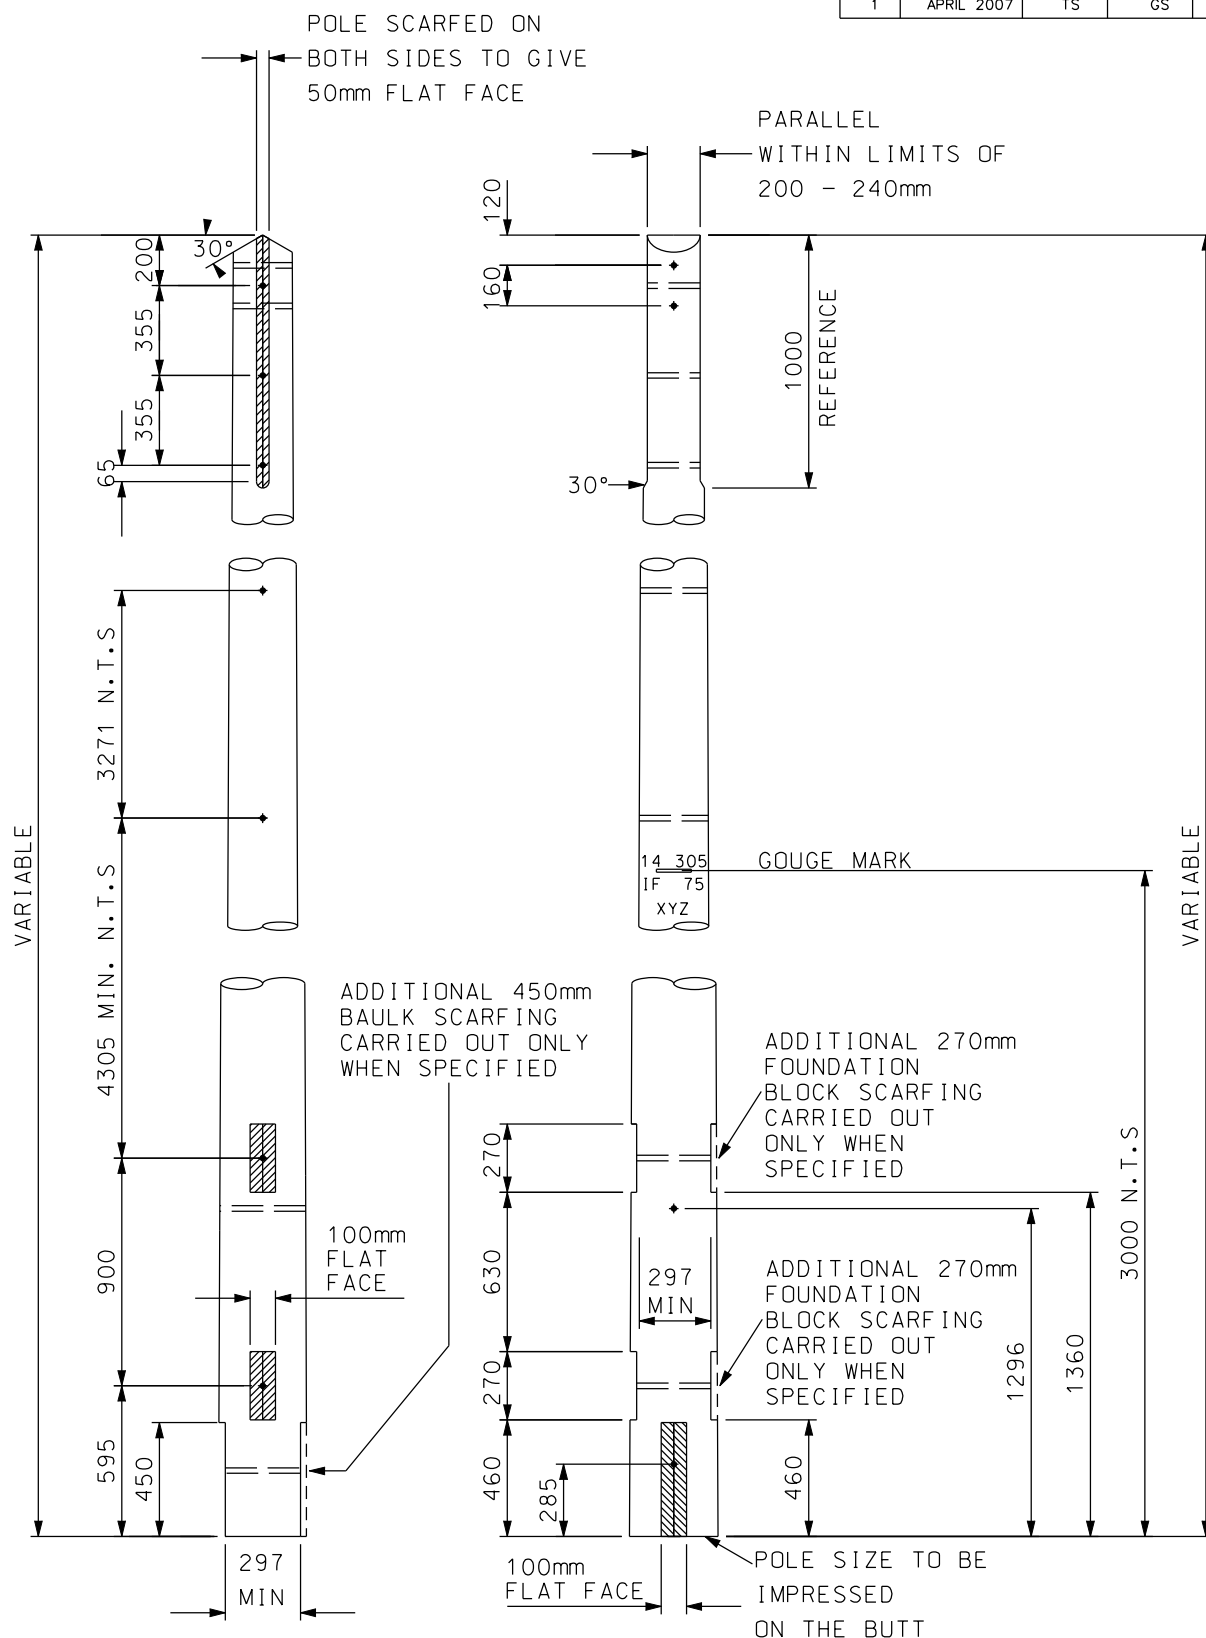

GENERAL NOTES:

- ALL DIMENSIONS ARE IN mm, UNLESS NOTED
- ALL DRILLINGS TO BE 22mm DIAMETER HOLES
- POLE SIZES BASED ON BS1990, EXTRA STOUT POLES RANGE
LENGTH = 12m - 14m - REFER TO PROJECT SPECIFICATION
MINIMUM TOP DIAMETER = 200mm*
MAXIMUM TOP DIAMETER = 265mm
MINIMUM DIAMETER 1.5m FROM BUTT = 305mm
* VALUE AMENDED FROM THAT SHOWN ON BS1990

REFERENCE

- 14 - POLE LENGTH
305 - POLE DIAMETER AT 1.5m FROM BUTT
IF - IMPORTED REDFIR
75 - YEAR OF CREOSOTING
XYZ - SUPPLIERS NAME OR MARK
GOUGE MARK 6 WIDE x 6 DEEP
3m FROM POLE BUTT

CLIENT	TITLE	SCALE	ORIGINAL SIZE	LS TRANSMISSION CONSULTANCY LIMITED YORKSHIRE HOUSE YORK ROAD LITTLE DRIFFIELD EAST YORKSHIRE YO25 5XA TEL: 01377 253617
SSE POWER DISTRIBUTION	WOOD POLE SCARFING BRACED 0° STAYED AND UNSTAYED TRIDENT SECTION STRUCTURES	1 : 30 (UNLESS OTHERWISE STATED)	A4	
PROJECT	TG-PS-525 STRUCTURE SMALL PIECE DETAIL	DATE	CHECKED	
		02/08/04	GS	
		DRAWN	APPROVED	
		JN	PP	
		DRAWING NUMBER	REV	
		LSTC_STD_PAR_45	1	