


DESCRIPTION						
FIRST ISSUE						
REV 1	DATE	APRIL 2007	BY	RF	CHKD	SP
					APPD	GS

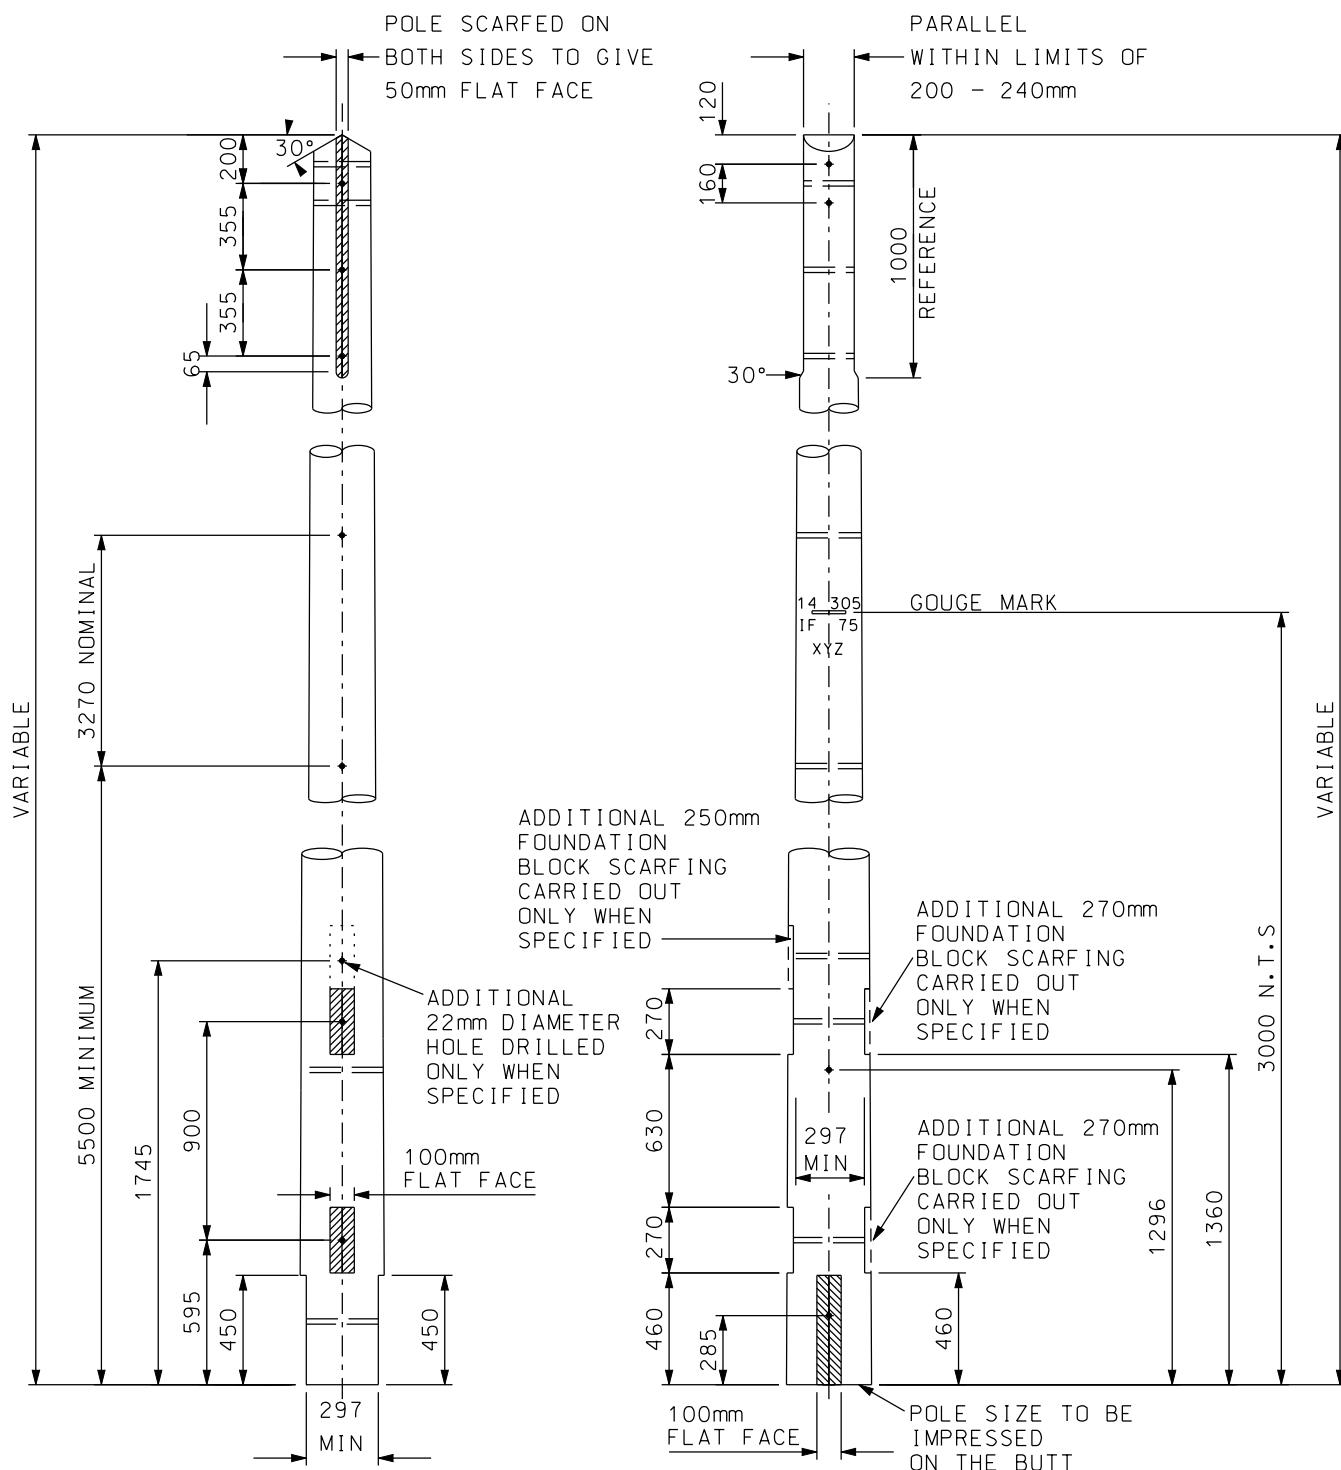

GENERAL NOTES:

1. ALL DIMENSIONS ARE IN mm, UNLESS NOTED
2. ALL DRILLINGS TO BE 22mm DIAMETER HOLES
3. POLE SIZES BASED ON BS1990, EXTRA STOUT POLES RANGE
LENGTH = 11m - 13m - REFER TO PROJECT SPECIFICATION
MINIMUM TOP DIAMETER = 200mm *
MAXIMUM TOP DIAMETER = 265mm
MINIMUM DIAMETER 1.5m FROM BUTT = 305mm
* VALUE AMENDED FROM THAT SHOWN ON BS1990

REFERENCE

- 14 - POLE LENGTH
305 - POLE DIAMETER AT 1.5m FROM BUTT
IF - IMPORTED REDFIR
75 - YEAR OF CREOSOTING
XYZ - SUPPLIERS NAME OR MARK
GOUGE MARK 6 WIDE x 6 DEEP
3m FROM POLE BUTT

CLIENT SSE POWER DISTRIBUTION		TITLE WOOD POLE SCARFING UNBRACED ANGLED STRUCTURES	SCALE 1:30 (UNLESS OTHERWISE STATED)		ORIGINAL SIZE A4	 Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA Tel 01377 253617 Fax 01377 259555
PROJECT IG-PS-525 STRUCTURE SMALL PIECE DETAIL			DATE 02/08/04	CHECKED GS		
			DRAWN JN	APPROVED PP		
			DRAWING NUMBER LSTC_STD_PAR_50		REV 1	