


DESCRIPTION					
DRAFT ISSUE - REDESIGN OF FOUNDATIONS					
REV	DATE	BY	CHKD	APPD	PP
C	02/08/04	JN	GS		PP
DESCRIPTION					
DRAFT ISSUE - AMENDED DETAILS					
REV	DATE	BY	CHKD	APPD	PP
D	04/10/04	JN	GS		PP

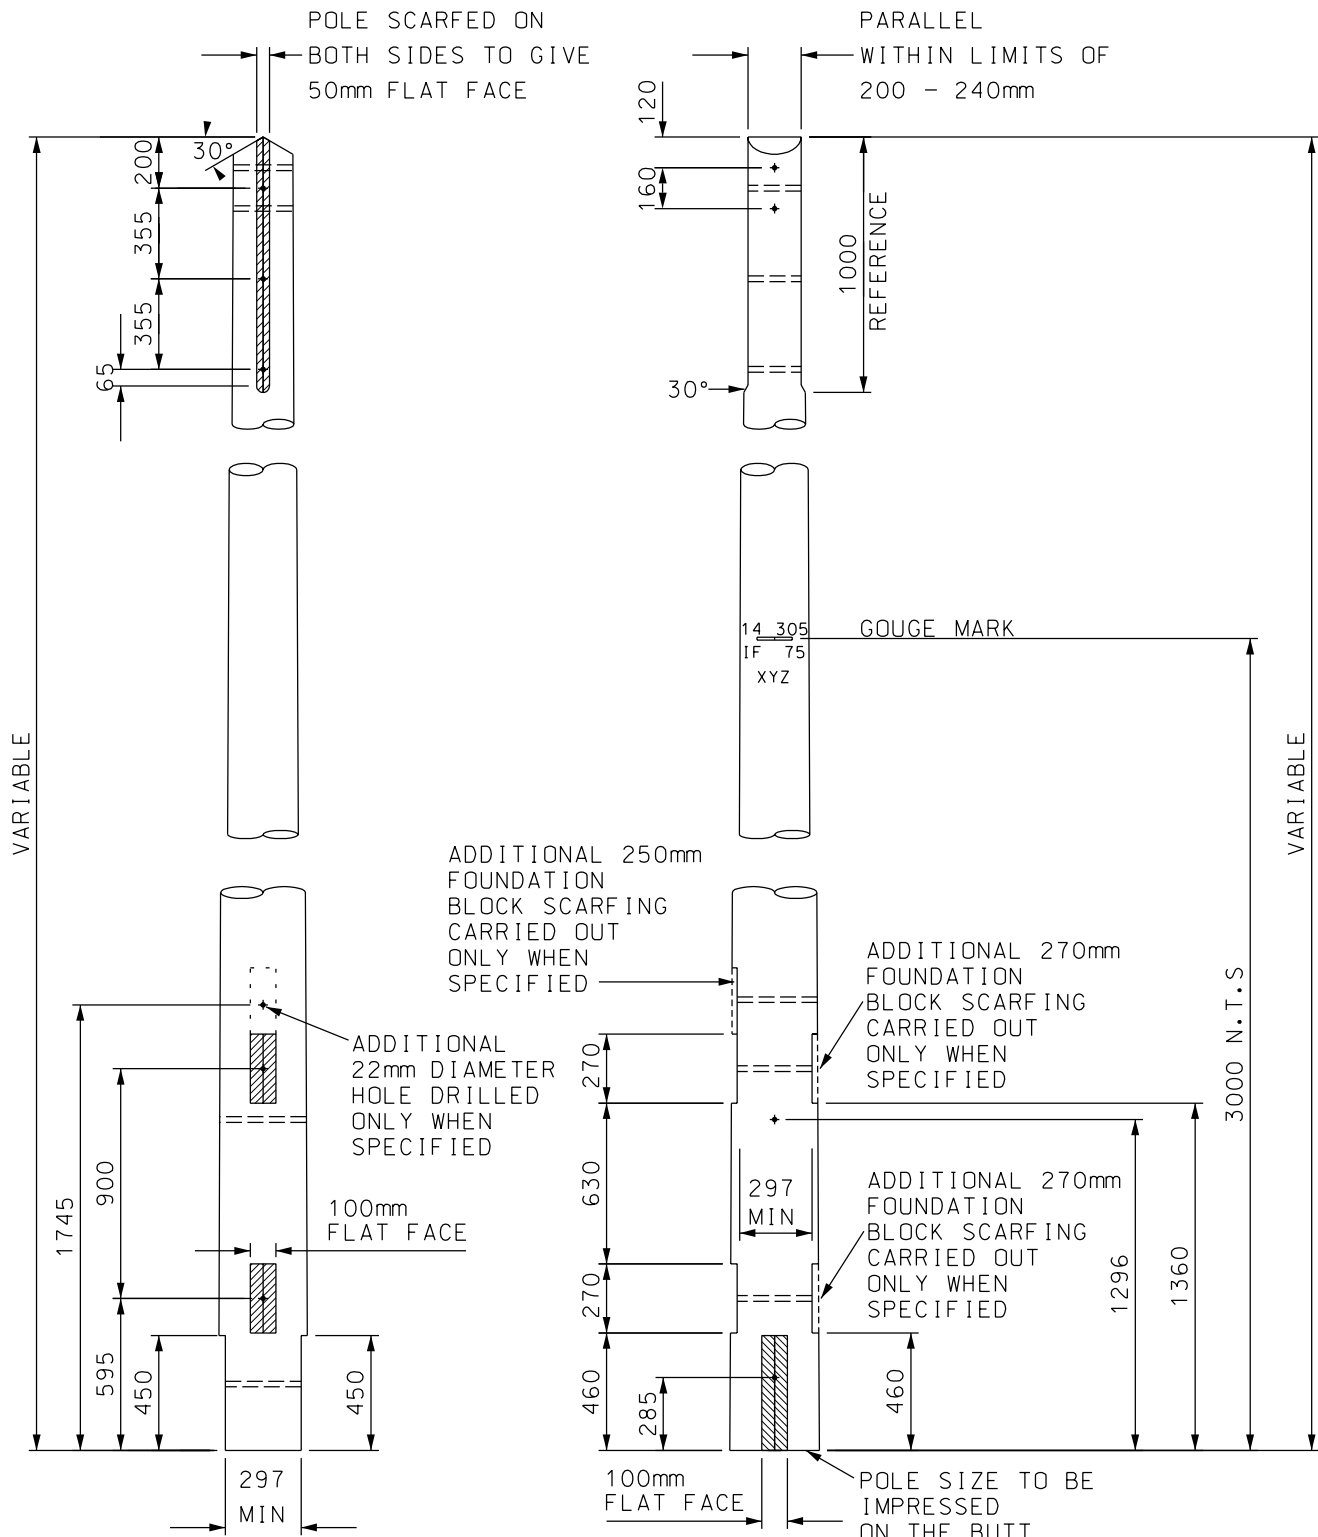

GENERAL NOTES:

1. ALL DIMENSIONS ARE IN mm, UNLESS NOTED
2. ALL DRILLINGS TO BE 22mm DIAMETER HOLES
3. POLE SIZES BASED ON BS1990, EXTRA STOUT POLES RANGE
LENGTH = 10.5m - 17m
MINIMUM TOP DIAMETER = 200mm *
MAXIMUM TOP DIAMETER = 265mm
MINIMUM DIAMETER 1.5m FROM BUTT = 305mm
* VALUE AMENDED FROM THAT SHOWN ON BS1990

CLIENT SSE POWER DISTRIBUTION		TITLE WOOD POLE SCARFING UNBRACED ANGLED STRUCTURES	SCALE 1 : 30 (UNLESS OTHERWISE STATED)		ORIGINAL SIZE A4		LS TRANSMISSION CONSULTANCY LIMITED PADDOCK HOUSE 10 MIDDLE STREET SOUTH DRIFFIELD EAST YORKSHIRE YO25 6PT TEL : 01377 240047 	
PROJECT TRIDENT STRUCTURE SMALL PIECE DETAIL			DATE 02/08/04		CHECKED GS			
			DRAWN JN		APPROVED PP			
			DRAWING NUMBER					REV
			LSTC_STD_PAR_50					D