


DESCRIPTION					FOR ISSUE				
REV 3	DATE 23/07/07	BY MA	CHKD SP	APPD PP					

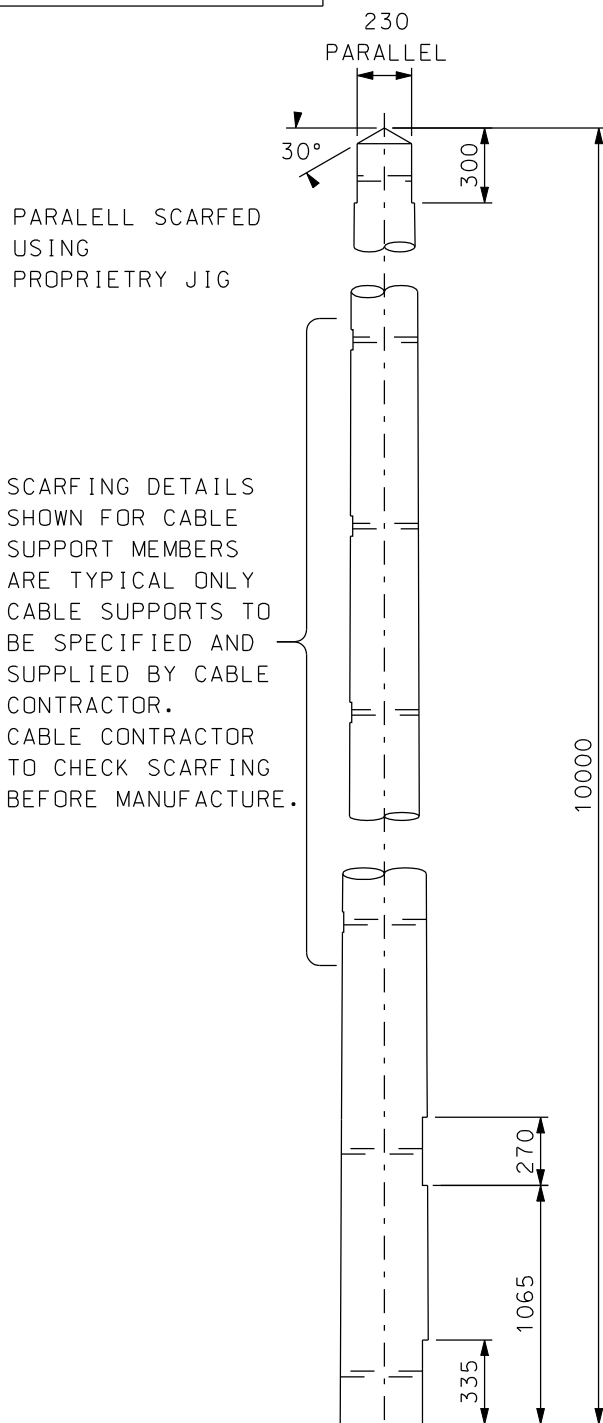

PARALELL SCARFED
USING
PROPRIETRY JIG

SCARFING DETAILS SHOWN FOR CABLE SUPPORT MEMBERS ARE TYPICAL ONLY. CABLE SUPPORTS TO BE SPECIFIED AND SUPPLIED BY CABLE CONTRACTOR. CABLE CONTRACTOR TO CHECK SCARFING BEFORE MANUFACTURE.


BAR MARK / ITEM NUMBER
TE709

POLE SIZE TO BE
IMRESSED
ON THE BUTT

GENERAL NOTES:

1. ALL DIMENSIONS ARE IN mm, UNLESS NOTED
2. ALL DRILLINGS TO BE 24mm DIAMETER HOLES
3. POLE SIZES BASED ON BS1990, STOUT POLES RANGE

LENGTH = 10m & PARALLEL WITHIN LIMITS
MINIMUM TOP DIAMETER = 235mm
MINIMUM DIA 1.5m FROM BUTT = 285mm

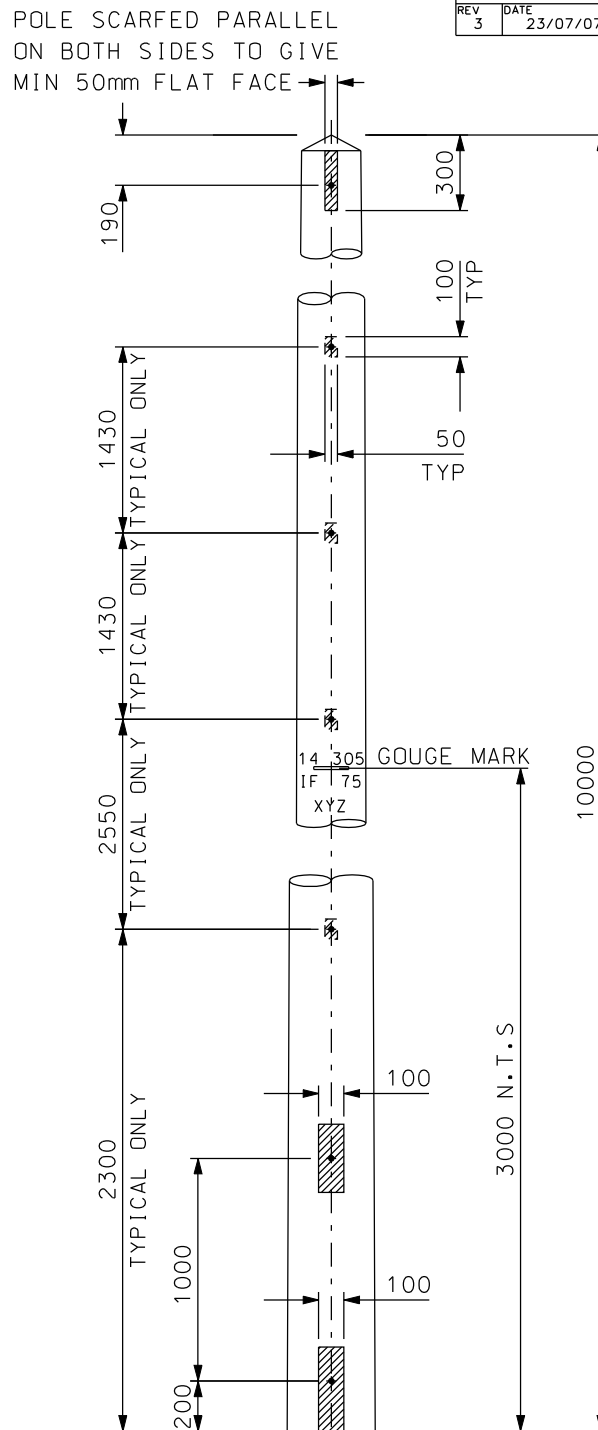

POLE SCARFED PARALLEL
ON BOTH SIDES TO GIVE
MIN 50mm FLAT FACE →

REFERENCE (typical only)
ACTUAL POLE VALUES TO BE USED
 10 - POLE LENGTH
 285 - POLE DIA. 1.5m FROM BUTT
 IF - IMPORTED REDFIR
 75 - YEAR OF CREOSOTING
 XYZ - SUPPLIERS NAME OR MARK
 GOUGE MARK 6 WIDE x 6 DEEP
 3m FROM POLE BUTT

SUPPLIER TO NOTE THESE DIMENSIONS ARE FOR GENERIC POLE DRILLING AND SCARFING ONLY TO SUIT A RANGE OF POLE SIZES, ACTUAL POLE MINIMUM DIMENSIONS TO BE SPECIFIED AT TIME OF ORDERING. ORDER VALUES WILL SUPERSEDE THESE STATED VALUES. MAXIMUM VALUE NOT TO BE EXCEEDED

CLIENT	PowerSystems	TITLE	PART - WOOD POLE SCARFING 4 POLE ENTRY TERMINAL STRUCTURES 10m AUX. POLE	SCALE	NTS (UNLESS OTHERWISE STATED)	ORIGINAL SIZE	A4	LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617
SPECIFICATION	OHL-03-132			DATE	27/01/05	CHECKED	GS	
				DRAWN	R.T.J	APPROVED	PP	
				DRAWING NUMBER	LSTC/STD/PAR/709		REV	3