



DESCRIPTION					
DRAFT ISSUE					
REV	DATE	BY	CHKD	APPD	PP
2	24/05/05	R.T.J	GS		

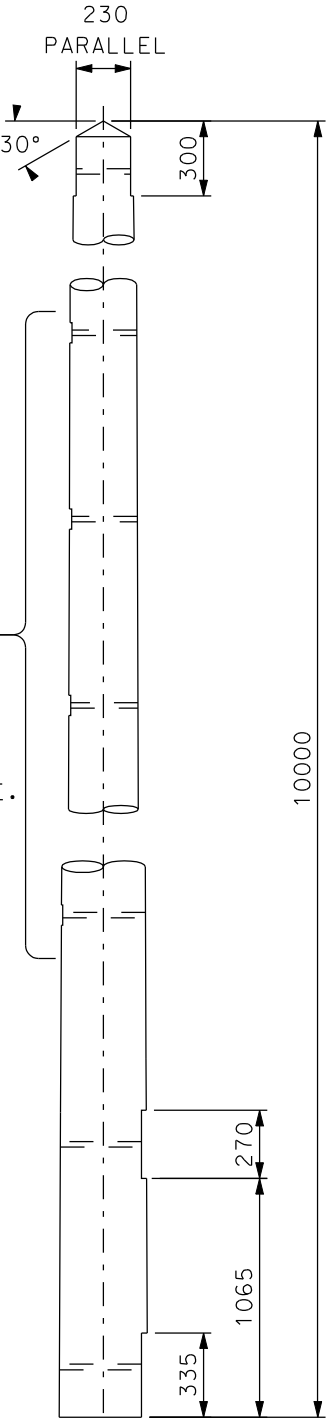

POLE SCARFED ON BOTH SIDES TO GIVE MIN 50mm FLAT FACE

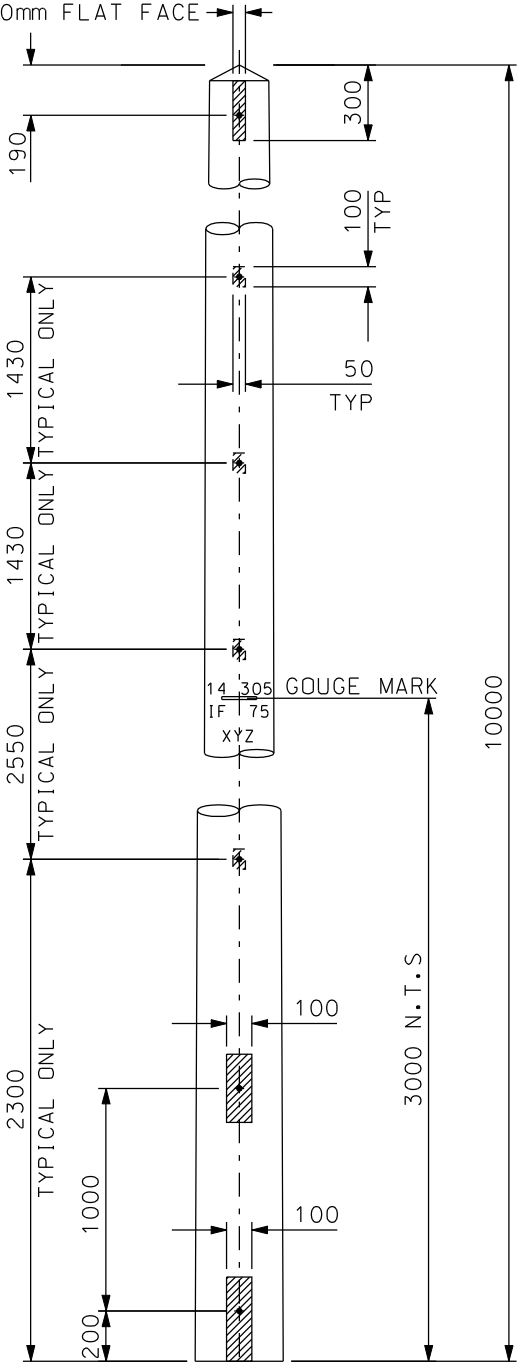

SCARFING DETAILS SHOWN FOR CABLE SUPPORT MEMBERS ARE TYPICAL ONLY CABLE SUPPORTS TO BE SPECIFIED AND SUPPLIED BY CABLE CONTRACTOR. CABLE CONTRACTOR TO CHECK SCARFING BEFORE MANUFACTURE.

BAR MARK / ITEM NUMBER
TE709

POLE SIZE TO BE IMPRESSED ON THE BUTT

REFERENCE (typical only)
ACTUAL POLE VALUES TO BE USED
10 - POLE LENGTH
285 - POLE DIA. 1.5m FROM BUTT
IF - IMPORTED REDFIR
75 - YEAR OF CREOSOTING
XYZ - SUPPLIERS NAME OR MARK
GOUGE MARK 6 WIDE x 6 DEEP
3m FROM POLE BUTT

- GENERAL NOTES:
1. ALL DIMENSIONS ARE IN mm, UNLESS NOTED
 2. ALL DRILLINGS TO BE 22mm DIAMETER HOLES
 3. POLE SIZES BASED ON BS1990, STOUT POLES RANGE
LENGTH = 10m
MINIMUM TOP DIAMETER = 235mm
MINIMUM DIA 1.5m FROM BUTT = 285mm

SUPPLIER TO NOTE THESE DIMENSIONS ARE FOR GENERIC POLE DRILLING AND SCARFING ONLY TO SUIT A RANGE OF POLE SIZES, ACTUAL POLE MINIMUM AND MAXIMUM DIMENSIONS TO BE SPECIFIED AT TIME OF ORDERING. ORDER VALUES WILL SUPERSEDE THESE STATED VALUES.

CLIENT PowerSystems	TITLE WOOD POLE SCARFING 4 POLE ENTRY TERMINAL STRUCTURES 10m AUX. POLE	SCALE (UNLESS OTHERWISE STATED) DATE 27/01/05	ORIGINAL SIZE A4 CHECKED GS	LS TRANSMISSION CONSULTANCY LIMITED Yorkshire House York Road Little Driffield East Yorkshire YO25 5XA 01377 253617
		DRAWN R.T.J	APPROVED PP	
PROJECT NEW TRIDENT DESIGN		DRAWING NUMBER LSTC/STD/PAR/709	REV 2	