
DESCRIPTION				
FOR ISSUE				
REV	DATE	BY	CHKD	APPD
7	22/11/07	RF	SP	GS

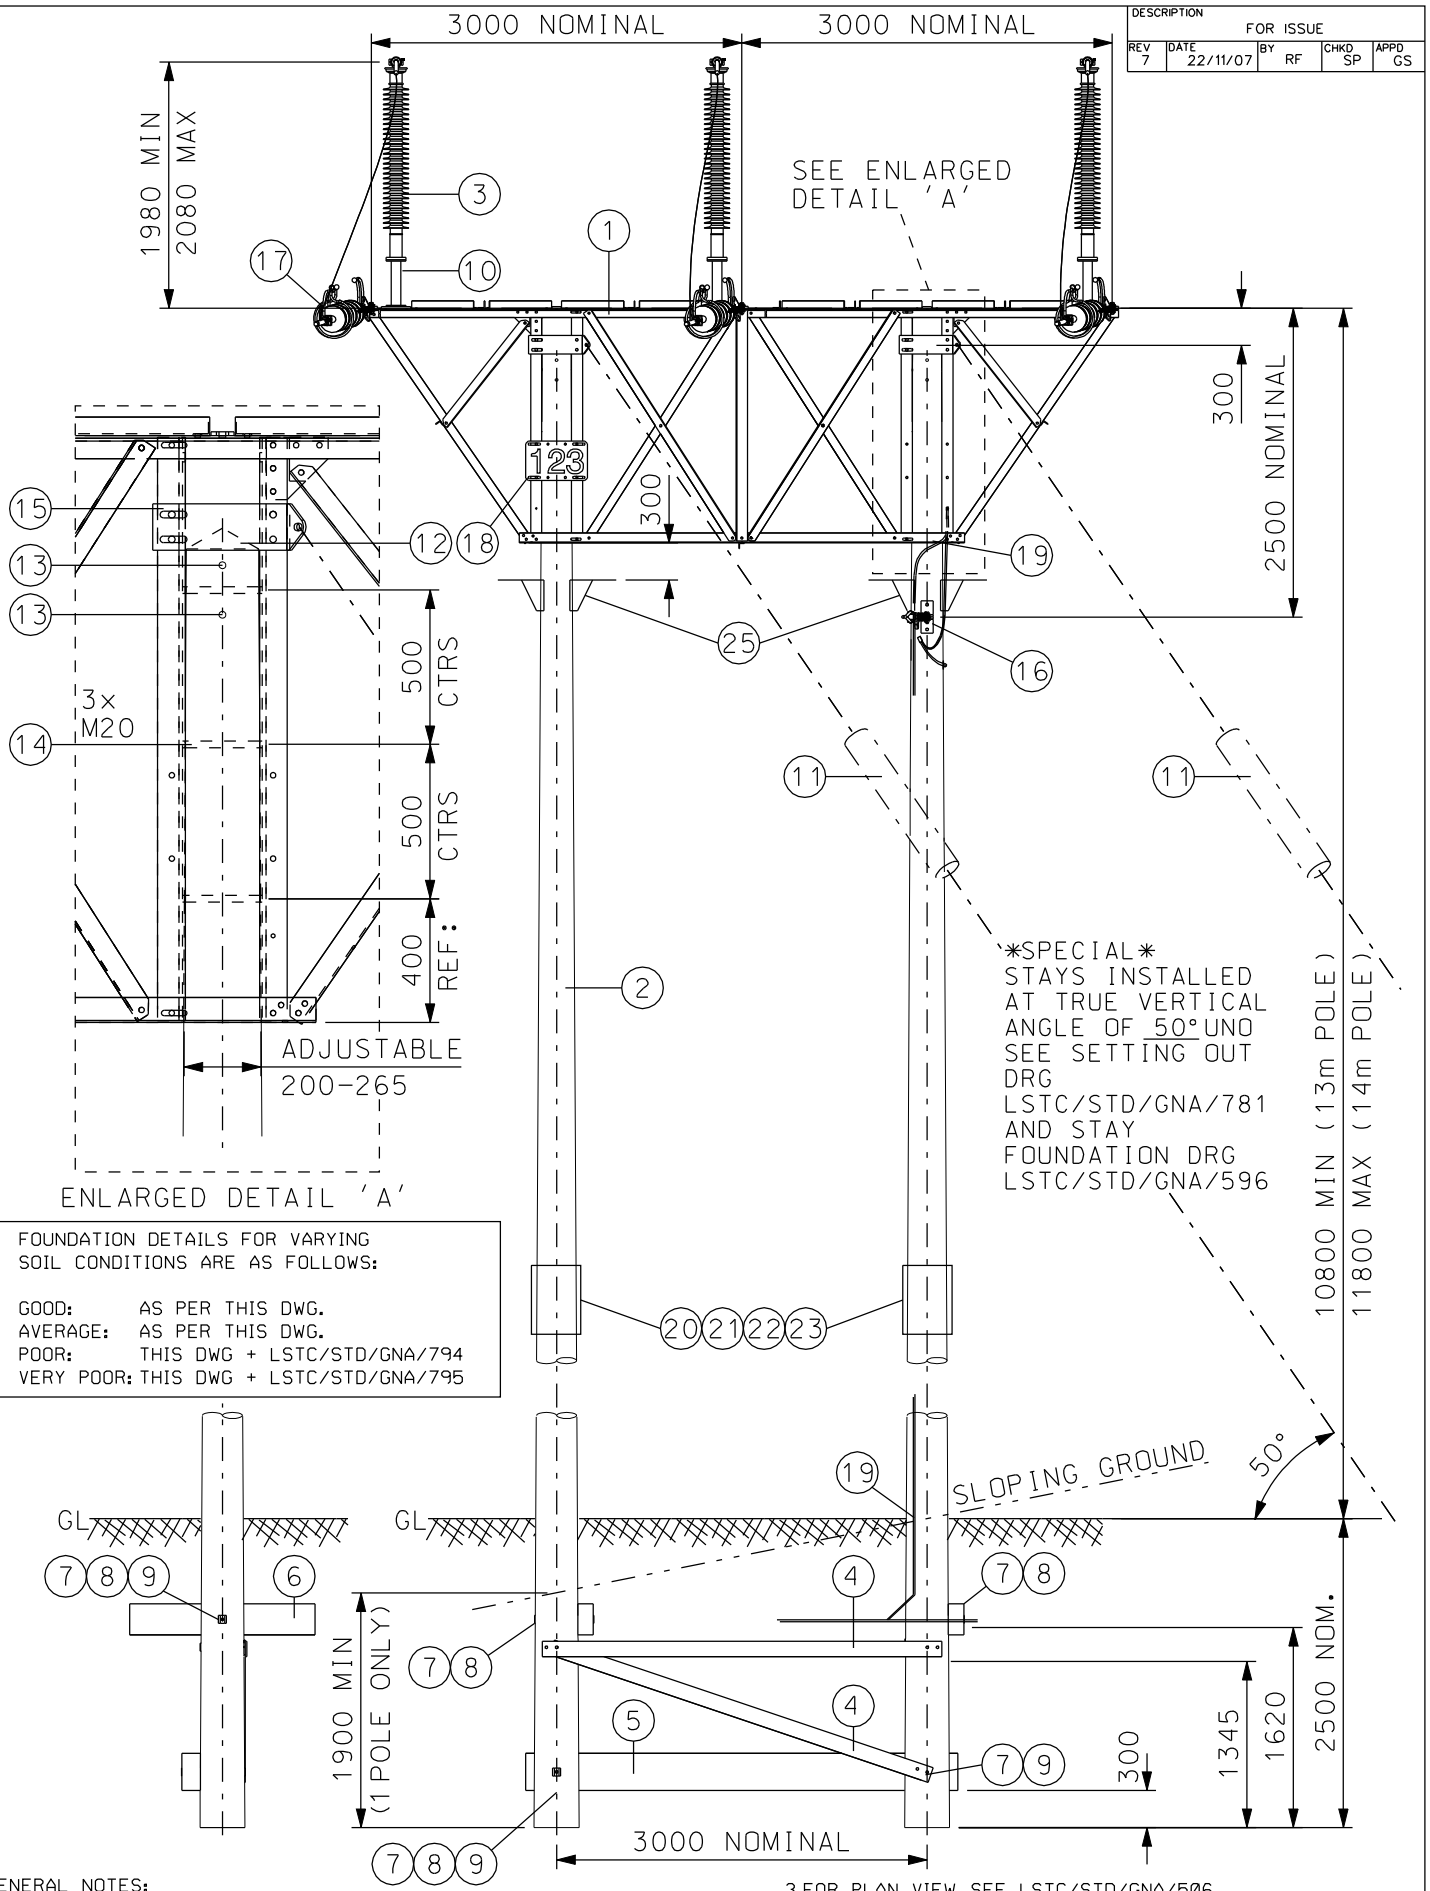

FOUNDATION DETAILS FOR VARYING SOIL CONDITIONS ARE AS FOLLOWS:

GOOD:	AS PER THIS DWG.
AVERAGE:	AS PER THIS DWG.
POOR:	THIS DWG + LSTC/STD/GNA/794
VERY POOR:	THIS DWG + LSTC/STD/GNA/795

GENERAL NOTES:

1. ALL STEELWORK TO BE PROTOTYPE CHECK ERECTED BEFORE MASS PRODUCTION.
2. SAFETY SIGNS TO BE INSTALLED TO CONFORM TO POWER SYSTEMS PROCEDURES
3. FOR PLAN VIEW SEE LSTC/STD/GNA/506
4. FOR MATERIAL LIST SEE LSTC/STD/GNA/507
5. OPGW TO BE INSTALLED ON THE SAME SIDE OF STRUCTURES THROUGHOUT. NO CROSSING OF OPGW AND PHASE CONDUCTORS PERMITTED.

CLIENT: PowerSystems	TITLE: GA - 5-20° ANGLE STRUCTURE	SCALE: 1:60 (UNLESS OTHERWISE STATED)	ORIGINAL SIZE: A4
SPECIFICATION: OHL-03-132		DATE: 28/10/04	CHECKED: GS
		DRAWN: R.T.J	APPROVED: PP
		DRAWING NUMBER: LSTC/STD/GNA/505	REV: 7

LS TRANSMISSION CONSULTANCY LIMITED
Yorkshire House
York Road
Little Driffield
East Yorkshire
YO25 5XA
01377 253617