


See ME 90/2 & ME 90/3  
for conductor termination

| Dimension | 33kV         | 66kV         |
|-----------|--------------|--------------|
| A         | 3'-6" (1-07) | 5'-0" (1-53) |
| B         | 1'-5" (430)  | 2'-11" (650) |

Spacing Blocks:- 12" (305) x 5" (125) cut 2" (50)  
longer than dressed face. Pole dressing 1/2" (13)  
deep, square cut & drilled for two bolts 5" (150) centres at  
positions shown. Poles to be matched & assembled at suppliers yard.

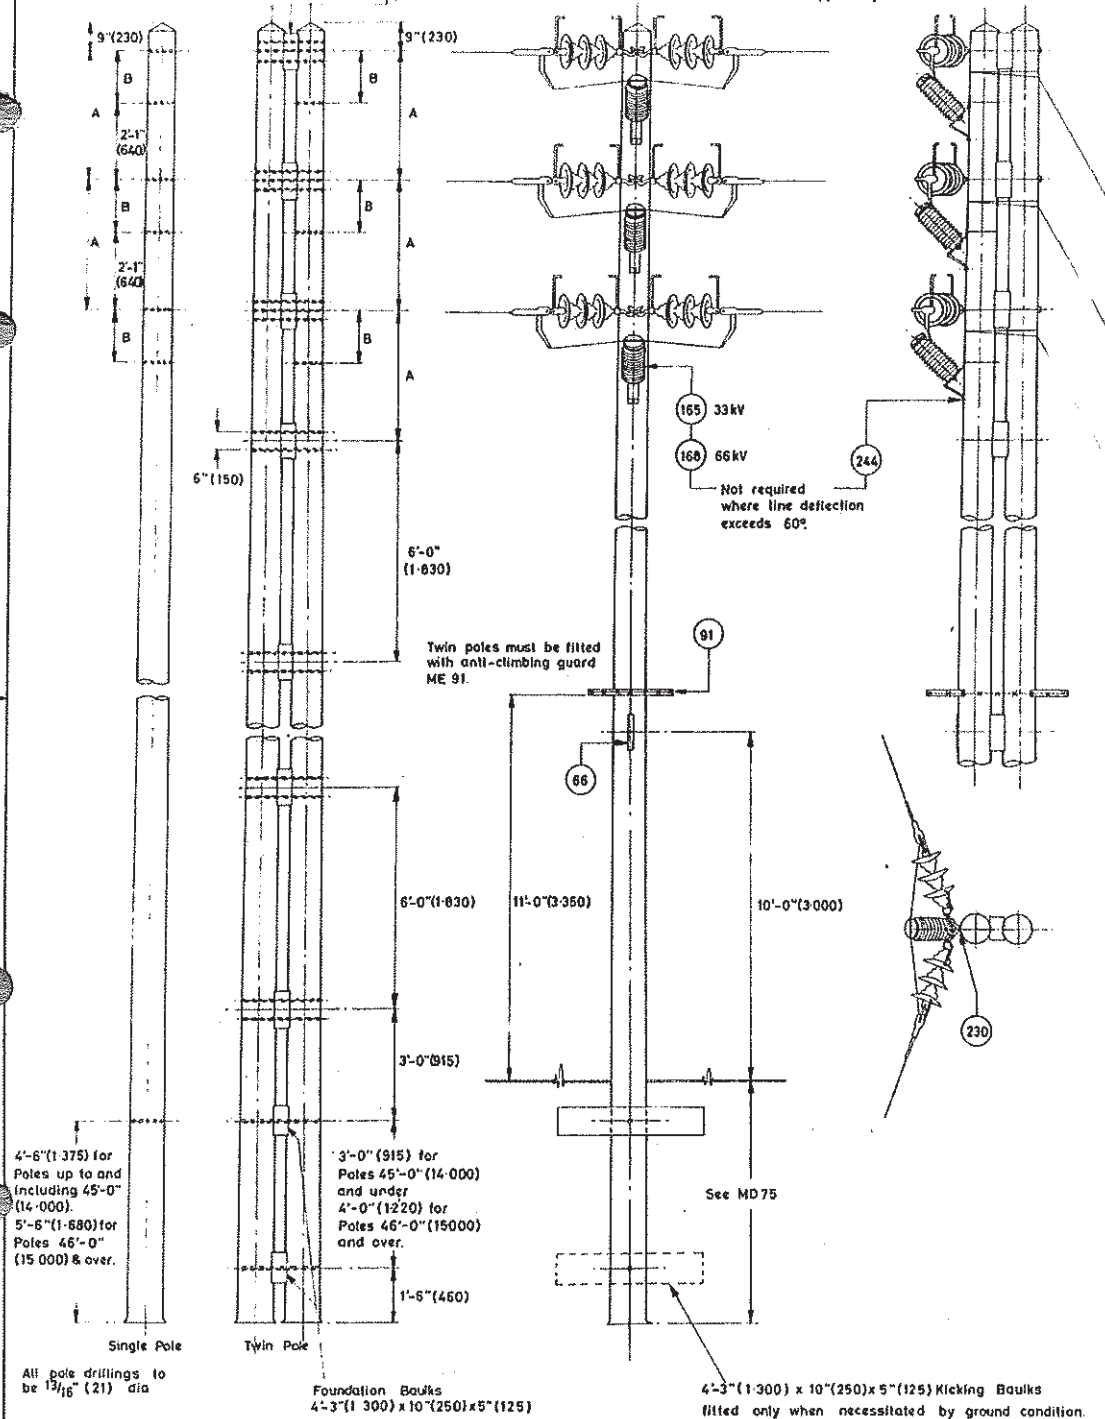

|          |         |
|----------|---------|
| SCALE    | 1/50    |
| DATE     | 8-10-74 |
| DRAWN    | WB      |
| TRACED   | PG      |
| CHECKED  |         |
| APPROVED |         |

### 33kV & 66kV CONSTRUCTION VERTICAL SECTION ANGLE POLE

| ISSUE                                  | ISSUE                                           |
|----------------------------------------|-------------------------------------------------|
| D                                      | E                                               |
| Redrawn & metricated<br>A.R.B. 28-2-76 | Conductor termination note added<br>RAC 25-1-78 |

|                               |
|-------------------------------|
| MIDLANDS<br>ELECTRICITY BOARD |
| DRG. No.<br>MP 21.            |