


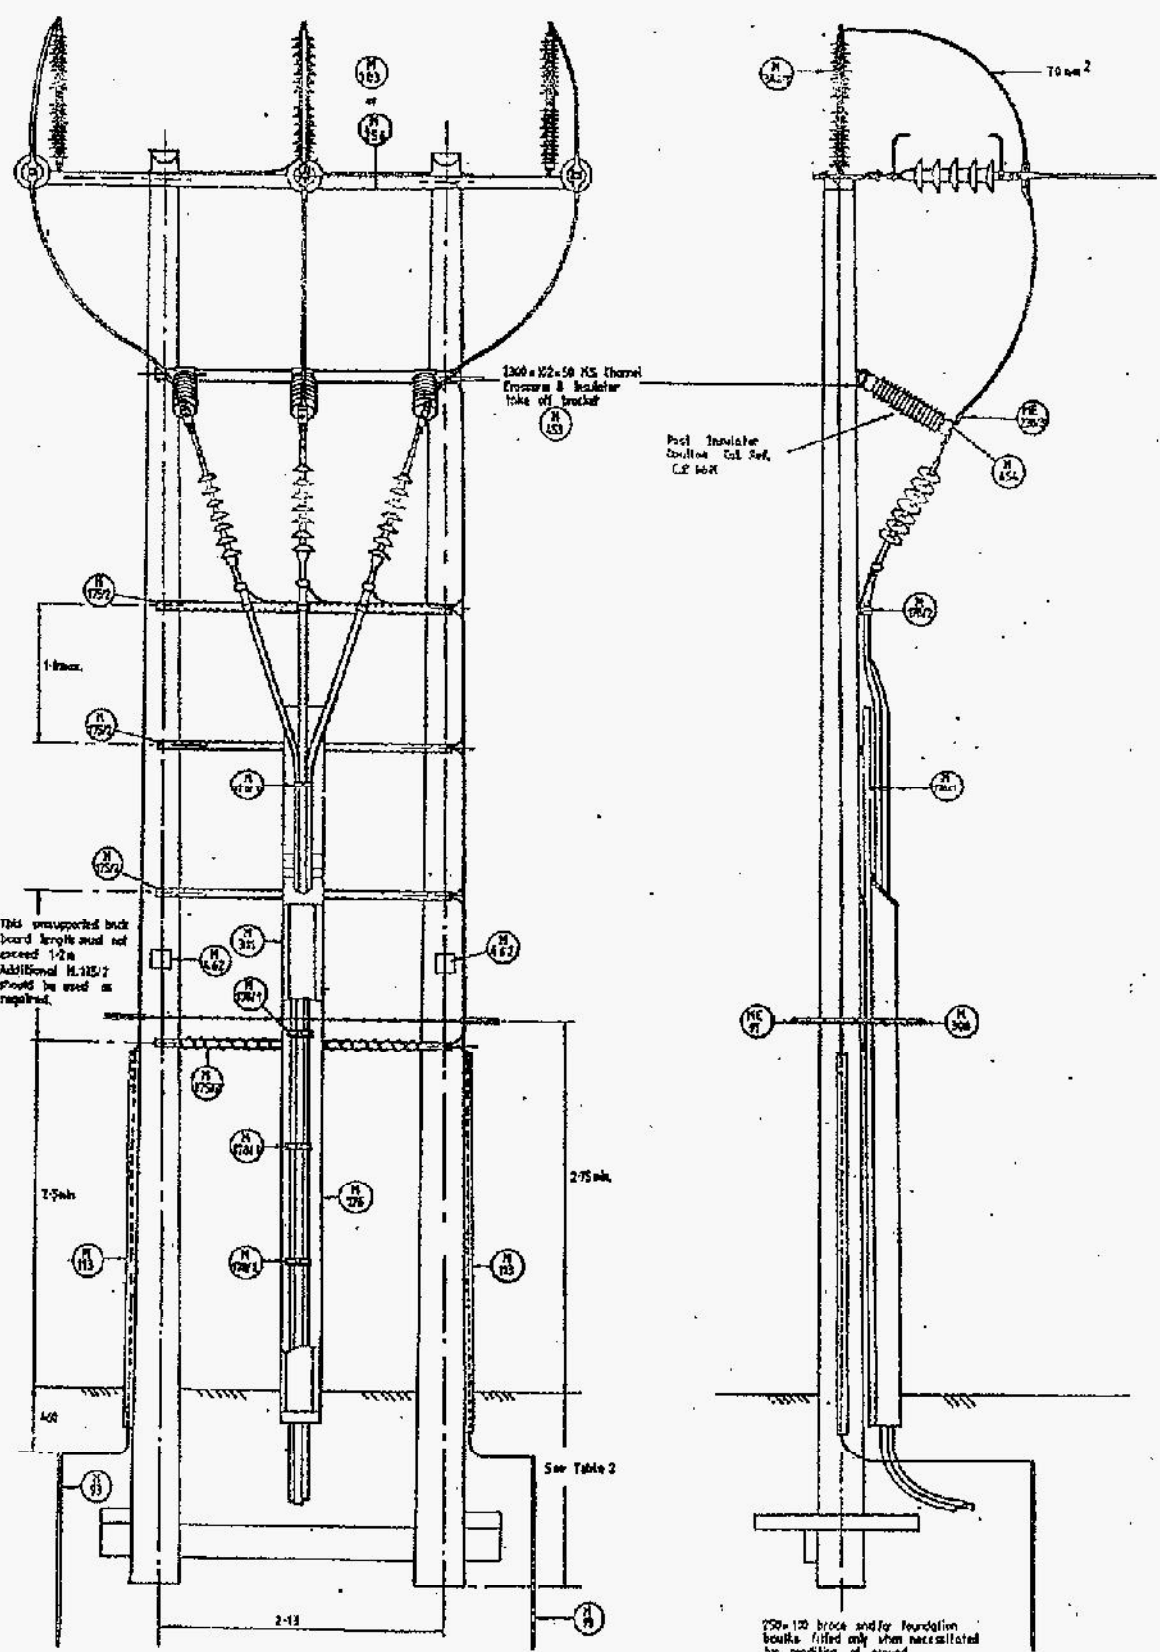

SCALE	
DATE	17-5-92
DRAWN	
CHECKED	
APPROVED	

66 KV. CONSTRUCTION
CABLE TERMINAL POLES XLP CABLES

MEB
Midlands Electricity plc

FIG. 6

MATERIAL SCHEDULE FIG 6

ITEM	MIN	QUANTITY
NOTE: For Pole, Terminal Crossarm, Insulator Assembly Foundation Blocks refer to Fig 5 Material List.		
Post Insulator Support Crossarm	3454530	1
Cable Support Crossarm	3451752	AR
Cable Back Board	3451760	AR
Cable Trunking	3453110	AR
Cable Cleats	3451781	AR
Post Insulator	345	3
Cable Connector Bar	3454540	3
Compression Dead End 200 AAAC	3455667	) 3
300 AAAC	3455669	
400 ACSR	3452534	
Earth Conductor	345	
Earth Rod	345	
Earth Conductor Cover Board	345	