



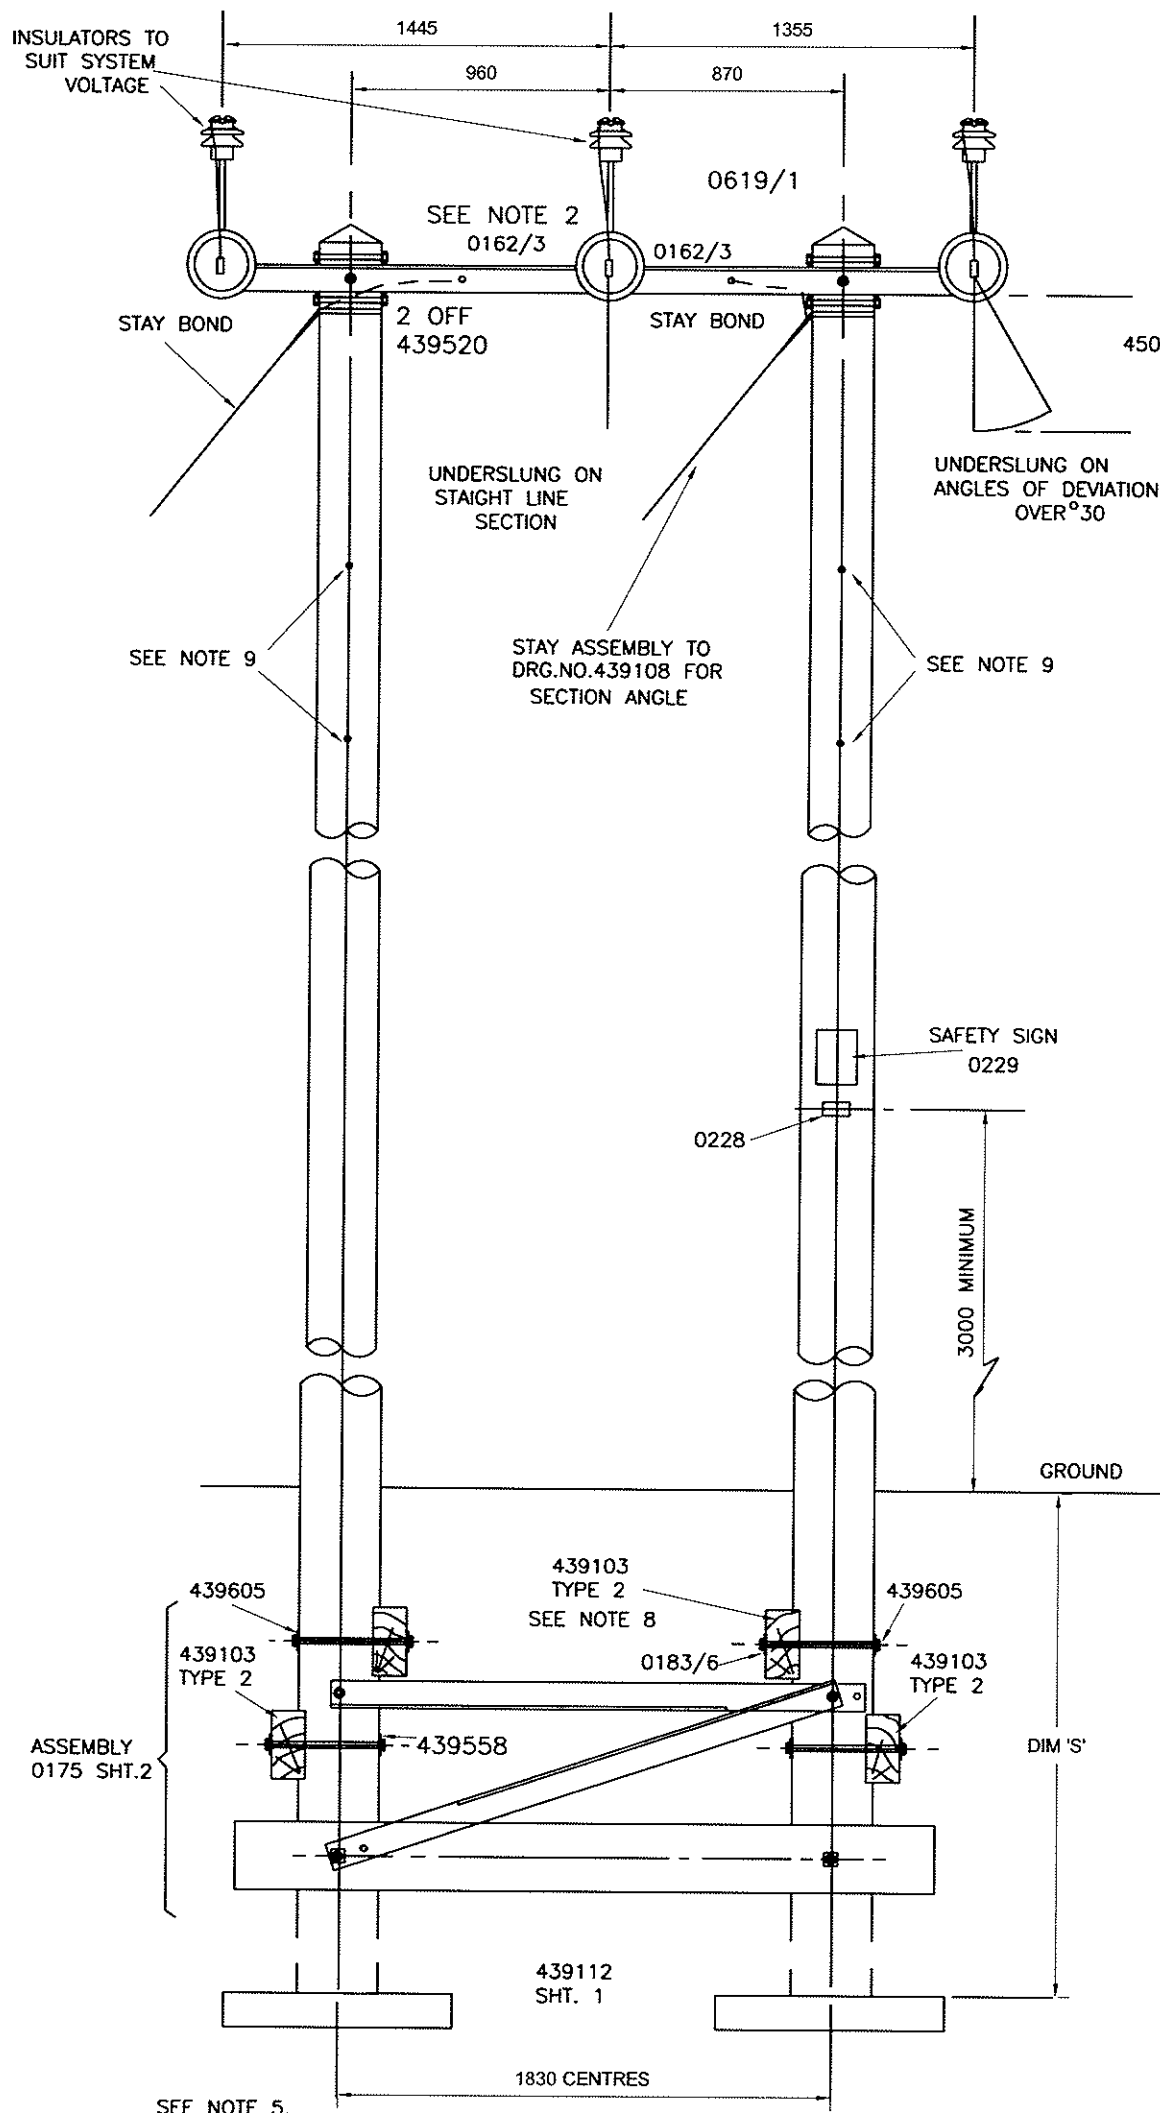

NON TENSION JOINTS WHERE
REQUIRED IN JUMPERS
(ALUMINIUM 439204)
(COPPER 439202)

BINDINGS AS SPECIFIED. { 0660 (STRAIGHT LINE)
0662 (ANGLE)
(TO SUIT CONDUCTOR)

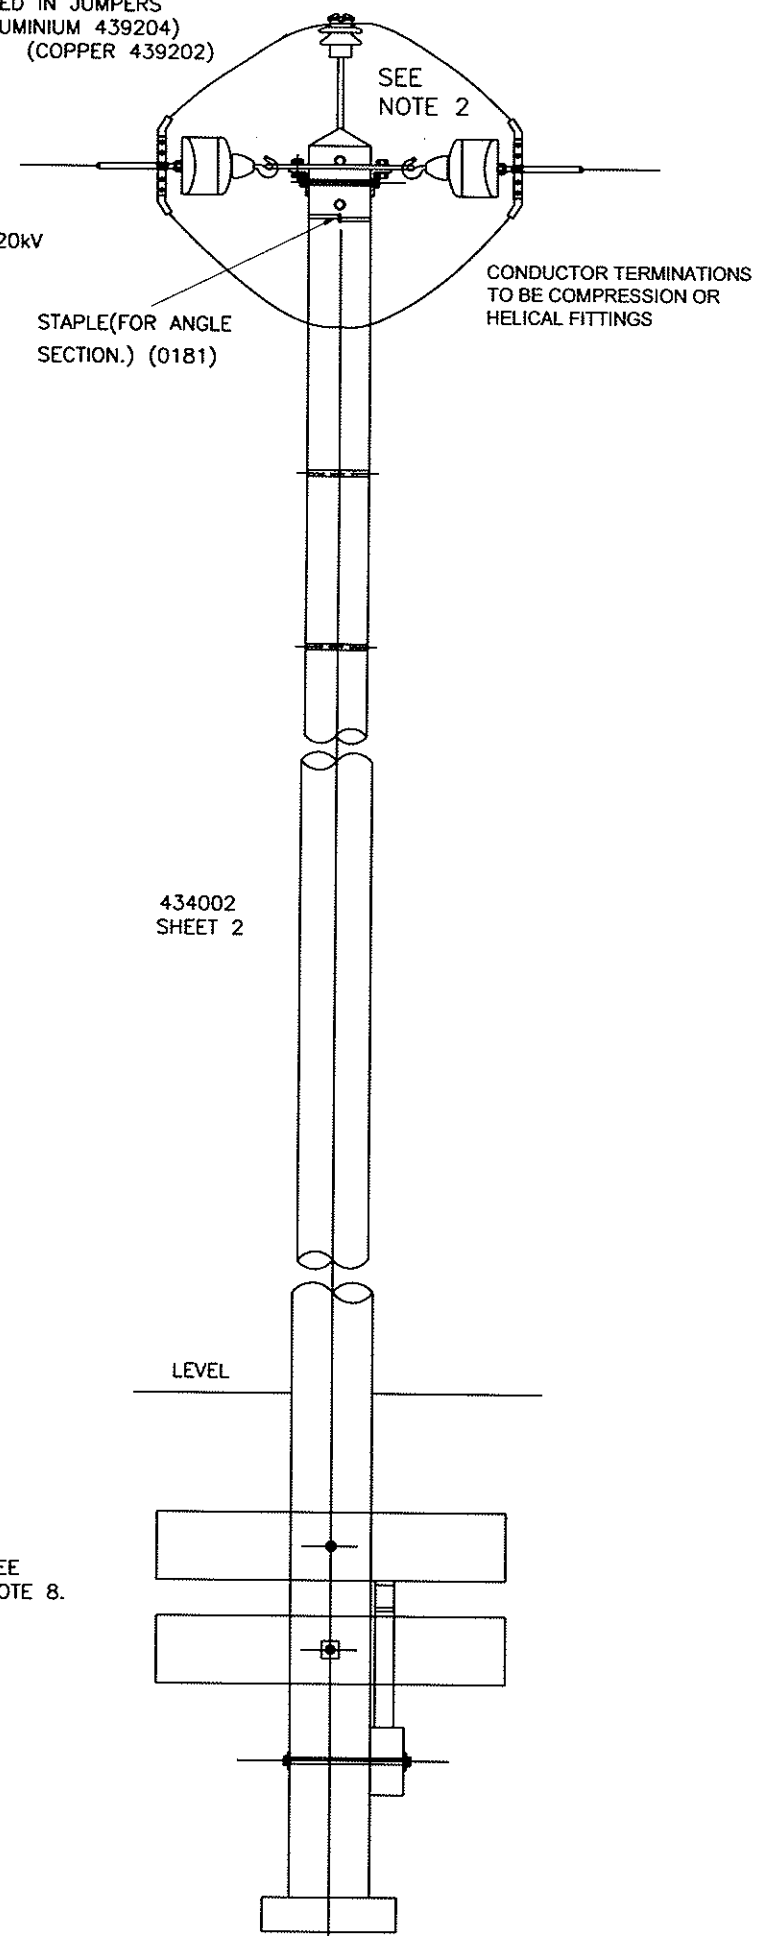


POLE LENGTH (m)	DIM 'S' (m)
9.0 - 11.5 INCLUSIVE	1.9
12.0 - 14.0 INCLUSIVE	2.1
14.0 - 18.0 INCLUSIVE	2.4
19.0 - 24.0	3.0

NOTES:

- STANDARD STOCKED POLE HEIGHT - 11.0m STOUT.
- ALL GALVANISED BOLTS TO BE M20 DIA.EACH WITH NUT TO BS 4190..
- FIT 2 M20 POLE BOLTS WITH 2 WASHERS 439605 AT POLE TOP.
- INSULATOR PIN TO BE 500mm PILOT PIN TO BS 3288, REF.No.50.
- 439103 TYPE 2 BLOCKS LAID TOGETHER TO FORM A FOOTING WHERE UNSUITABLE GROUND CONDITIONS EXIST.
- WHEN A SINGLE PHASE LINE IS REQUIRED,THE STANDARD OF CONSTRUCTION TO BE APPROPRIATE TO THREE PHASE OPERATION, THE CENTRE CONDUCTOR BEING OMITTED.
- DETAIL DRGS.PREFIXED 43.... REFER TO E.S.I. BASED DRGS. OTHER DRG.NOS.REFER TO 1.09.101.SERIES.
- TOP AND BOTTOM TYPE 2 SIDE BAULKS SHALL BE FITTED AS STANDARD. HOWEVER IN GOOD GROUND THE LOWER BAULKS MAY BE OMITTED.
- ALL UNUSED HOLES TO BE PLUGGED.

THIS DRAWING ALSO REFERRED TO IN WORK SPEC.REF.NO. 04/183.

* MAY BE INCREASED TO 90° DEPENDING ON CONDUCTOR TYPE AND WEATHER ZONE. SEE SPEC. FOR DETAILS.

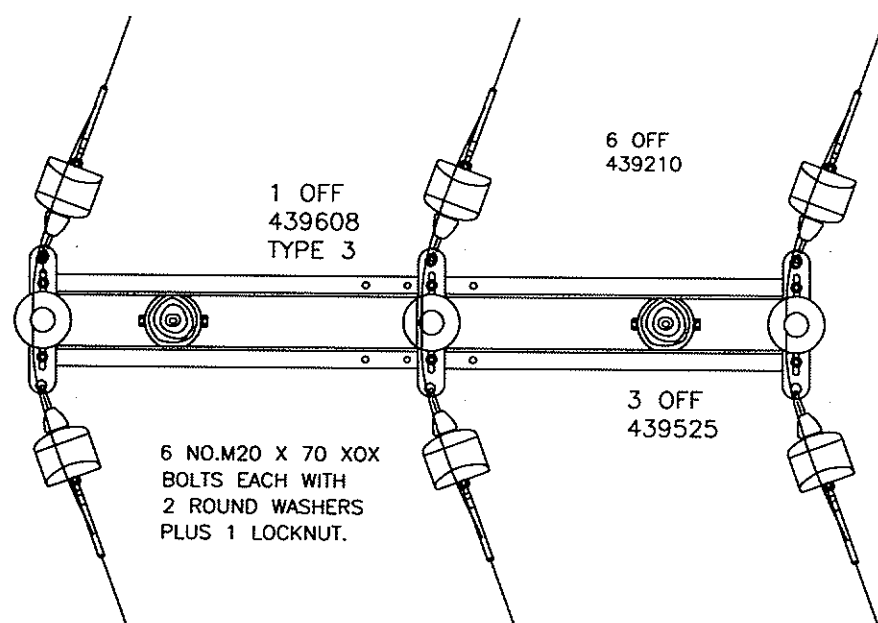

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

CE Electric UK

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF

Manufacturer Details

Sheet No.

Scale

Prepared By

Revised

Date Issued

Grid Reference

Checked By

Ref No.

Type

Revision

Notes

HV OVERHEAD LINES
(11, 20 AND 33KV SYSTEMS)
'H' POLE STRAIGHT LINE SECTION
OR SECTION ANGLE UP TO 60°

ESI

ESI

Ref No.

Historic

Drg.No.

C147664

1000434006