


Document reference		NSP/004/042					
Version:-	1.0	Date of Issue:-	Jan 07	Page	70	of	113

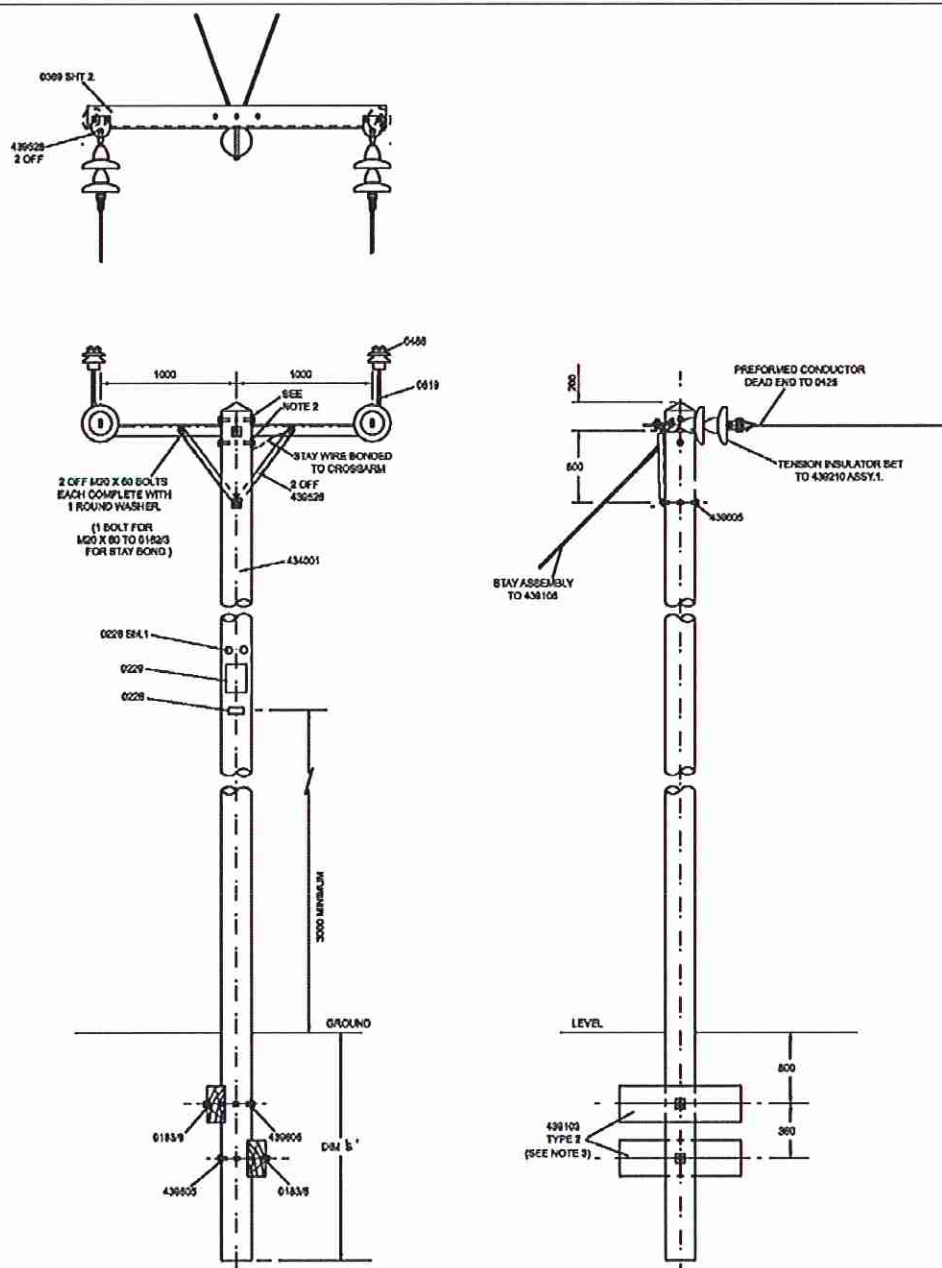

NOTES

1. ALL GALVANISED BOLTS TO BE M20 DIA. EACH WITH NUT TO B.8.4190.
2. FIT 2 - M20 POLE BOLTS WITH 2 WASHERS 4336605 AT POLE TOP.
3. FIT TWO BALUN'S ON ALL POLES EXCEPT WHERE A MEDIUM GRADE POLE IS INSTALLED IN GOOD GROUND, WHERE THE LOWER BALUN MAY BE OMITTED.
4. DETAIL DRAWINGS PREFIXED 43... REFER TO E.S.I. BASED DRAWINGS OTHER DETAIL DRAWINGS REFER TO 1.09.101... SER.23.
5. MAXIMUM CONDUCTOR 50mm² AAC.

POLE LENGTH (m)	D.W.'S' (m)
9.0 - 11.5 INCLUSIVE	1.0
12.0 - 14.0 INCLUSIVE	2.1
14.0 - 18.0 INCLUSIVE	2.4
19.0 - 24.0	3.0

THIS DRAWING ALSO REFERRED TO IN WORKS SPEC. REF. No 04/0189

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

	Lloyd Court, 78, Grey Street, Newcastle upon Tyne NE1 6AF H.V. OVERHEAD LINES (11kV & 20kV SYSTEMS) TERMINAL POLE (SINGLE MEMBER CROSSARM) SINGLE PHASE ONLY									
	Drawn by J.L.W. Checked G.S. 12/05/00									
	Orig No. 1		00		043		4009		Eshed No. 4	
	Made At. C		D		F		F		Recd. 19.5.2000 Issue 1:20	

...\\drg100\\new100\\1000434009s4.dwg 17/11/2005 10:56:39

CAUTION! - This document may be out of date if printed