

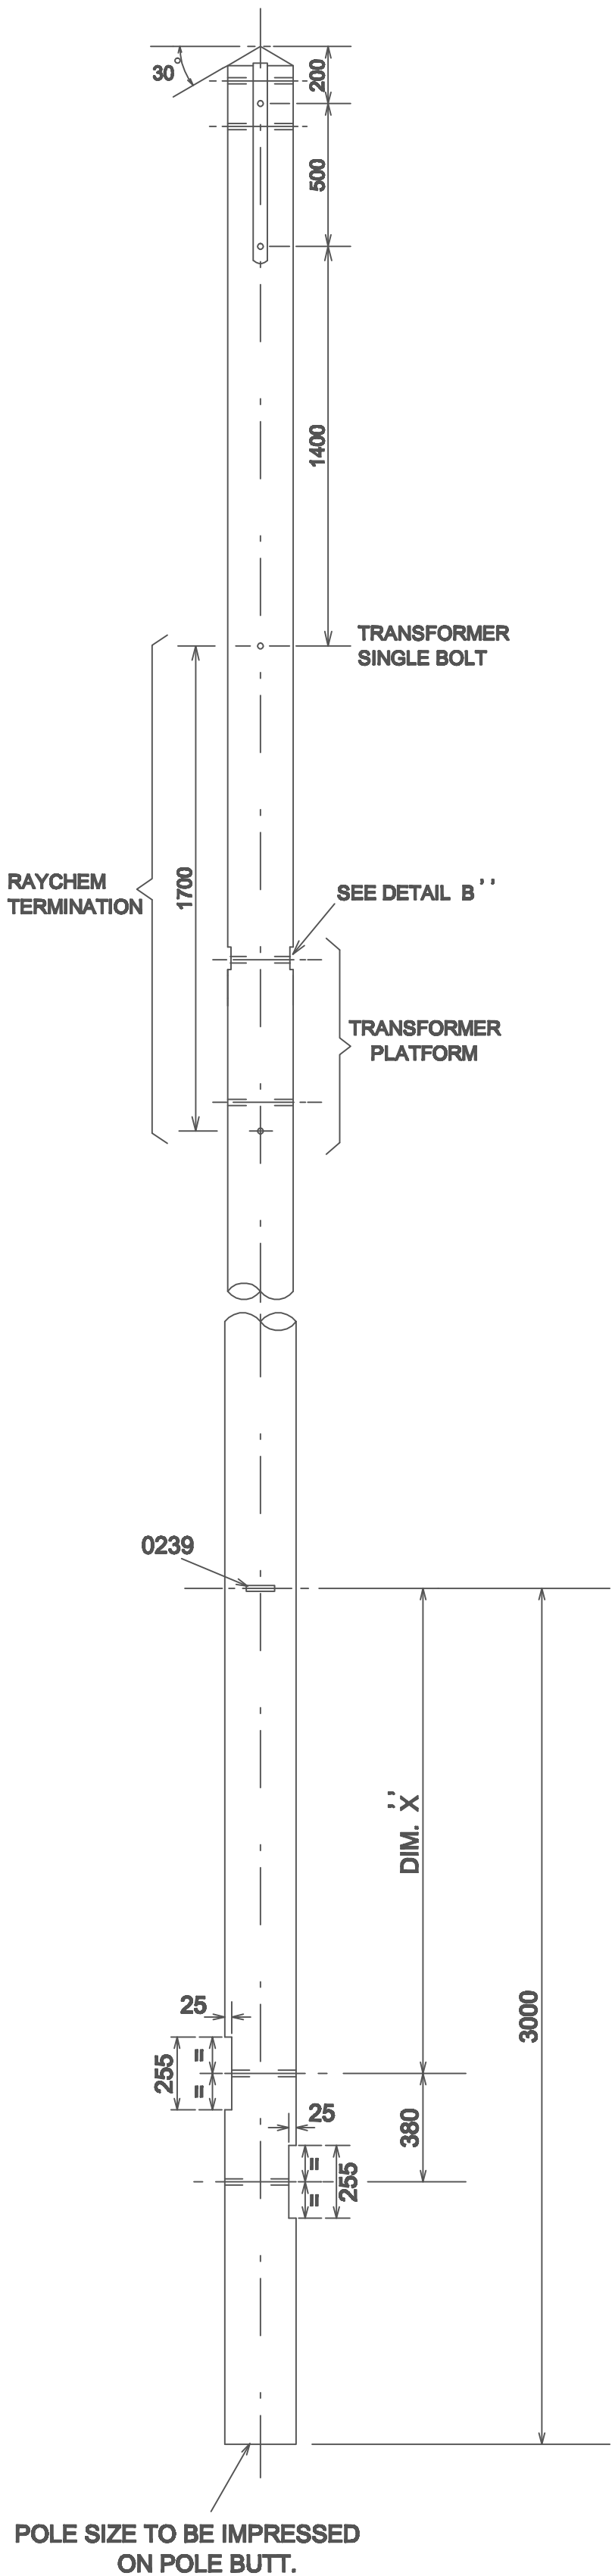


SCARFING TO BE CUT TO GIVE A FLAT ON BOTH FACES OF POLE THE ENDS CHAMFERED OFF AS SHOWN.

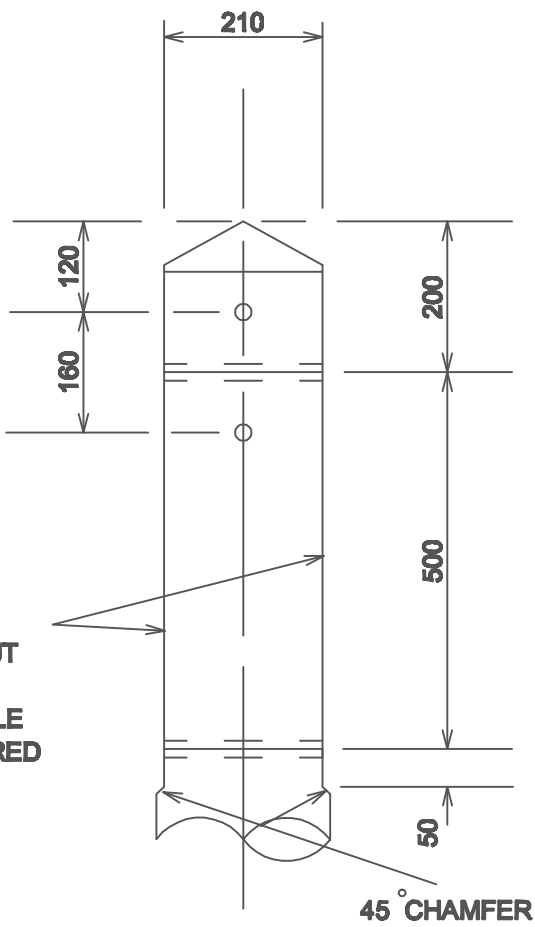

DETAIL A' '
SCALE 1:10

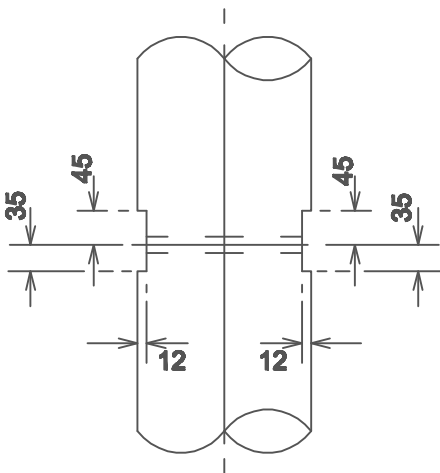

DETAIL B' '
SCALE 1:10

NOTES:

- * 1. STANDARD 11.0m POLE TO BE USED WHEREVER POSSIBLE.
- 2. CLASS OF POLE TO BE STOÚT, POLÈ TOP 210mm AFTER FABRICATION.
- 3. ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO PRESERVATION TREATMENT.
- 4. POLE BUTT TO BE CUT AT RIGHT ANGLES TO AXIS OF POLE.
- 5. POLE TO BE NOTCHED AND DRILLED FOR DUPLICATE 250 x 125 BAULKS.

(SEE NOTE 1)

*

POLE LENGTH. (m)	DIM. X' (mm)
9.0 - 11 INCLUSIVE	1900
12.0	1700
13 - 15 INCLUSIVE	1400
16 - 18 INCLUSIVE	1100

NOTE:-

FABRICATION DRAWING FOR USE WITH THE FOLLOWING ARRANGEMENT DRAWINGS.

DRG.No.1.00.043.4010 SHT.1
DRG.No.1.00.043.4010 SHT.6
DRG.No.1.09.107.0810 SHT.1
DRG.No.1.09.107.0810 SHT.2
DRG.No.1.09.107.0811 SHT.1
DRG.No.1.09.107.0811 SHT.2
DRG.No.1.09.107.0814 SHT.1
DRG.No.1.09.107.0814 SHT.2

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		HV OVERHEAD LINES MULTI – FABRICATION FOR SINGLE POLE TERMINAL OR STRAIGHT LINE S/S USED FOR CABLE, SINGLE BOLT OR PLATFORM MOUNTED TRANSFORMER ARRANGEMENTS	
Sheet No. 2	Scale 1:20	Type ESI	ESI
Prepared By Janis.Webb	Grid Reference	Ref No. C147683	Historic Drg.No. 1000434010
Revised 25/04/06	Checked By G HAMMEL	Revision D	Notes
Date Issued 23/02/05			