




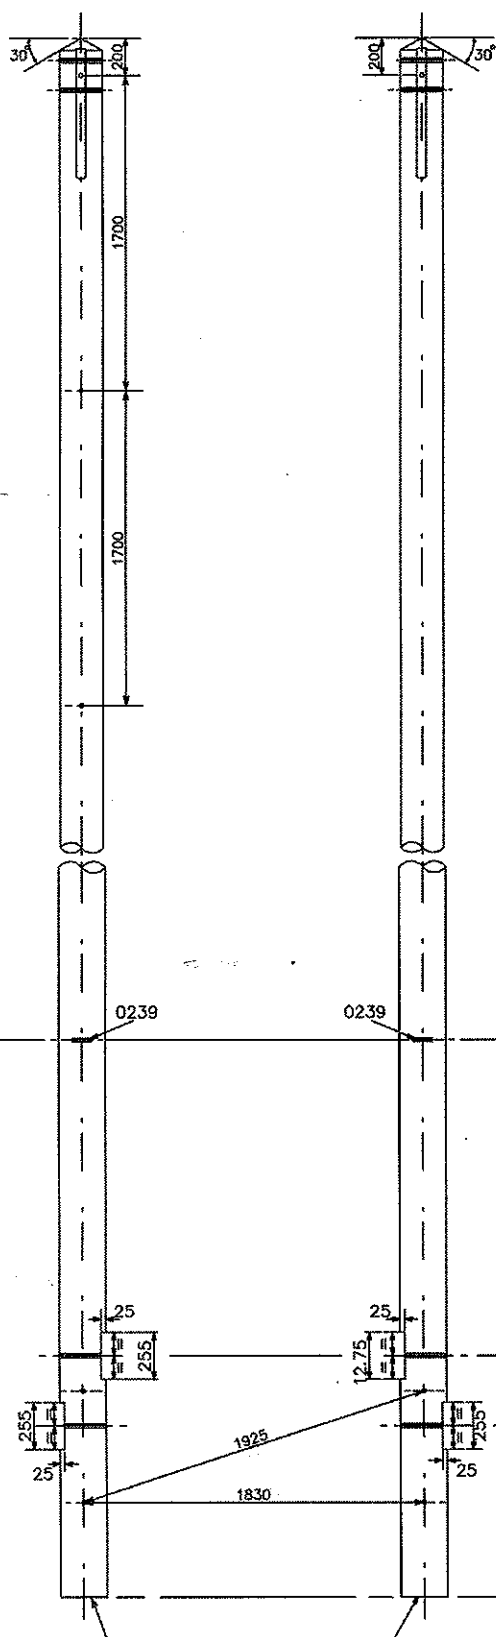

POLE SIZE TO BE IMPRESSED
ON POLE BUTT.




SCARFING TO BE CUT
TO GIVE A 50mm
WIDE FLAT ON
BOTH FACES OF
MEDIUM AND STOUT
POLES. THE ENDS
CHAMFERED OFF AS
SHOWN.

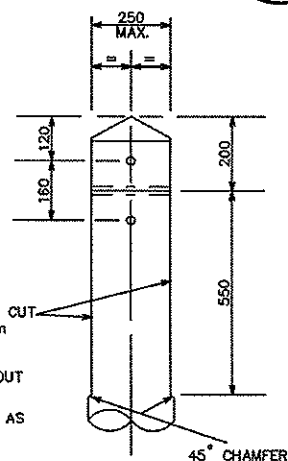

DETAIL A
SCALE 1:10

NOTES:

1. CLASS OF POLE TO BE MEDIUM OR STOUT AS SPECIFIED.
2. 'MEDIUM' CLASS POLES TO HAVE MINIMUM DIA. OF 175mm AT TOP.
'STOUT' CLASS POLES TO HAVE MINIMUM DIA. OF 210mm AT TOP.
3. POLES TO BE MATCHED.
4. ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO PRESERVATION TREATMENT.
5. POLE BUTT TO BE CUT AT RIGHT ANGLES TO AXIS OF POLE.
6. POLE TO BE NOTCHED AND DRILLED FOR DUPLICATE 250 x 125 BAULKS.

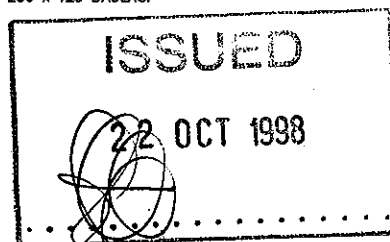

POLE LENGTH (m)	DIM. 'X' (mm)
8.5 - 11 INCLUSIVE.	1900
11.5 - 12 INCLUSIVE.	1700
13 - 15 INCLUSIVE.	1400
16 - 18 INCLUSIVE.	1100
20	500

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

NORTHERN ELECTRIC 		Northern Electric, Carliel House, Newcastle upon Tyne NE1 6NE H.V. OVERHEAD LINES. H POLE FABRICATION FOR DRG. NO. 1.00.043.4011 SHEET 6.	
Drawn J.B. Checked G.M.H.	Traced Date Issued MAR 91	Drg.No. 1 00 043 4011 Mod. [A]	Sheet No. 7 Revised 14.10.91 Scale 1:20 & 1:10