

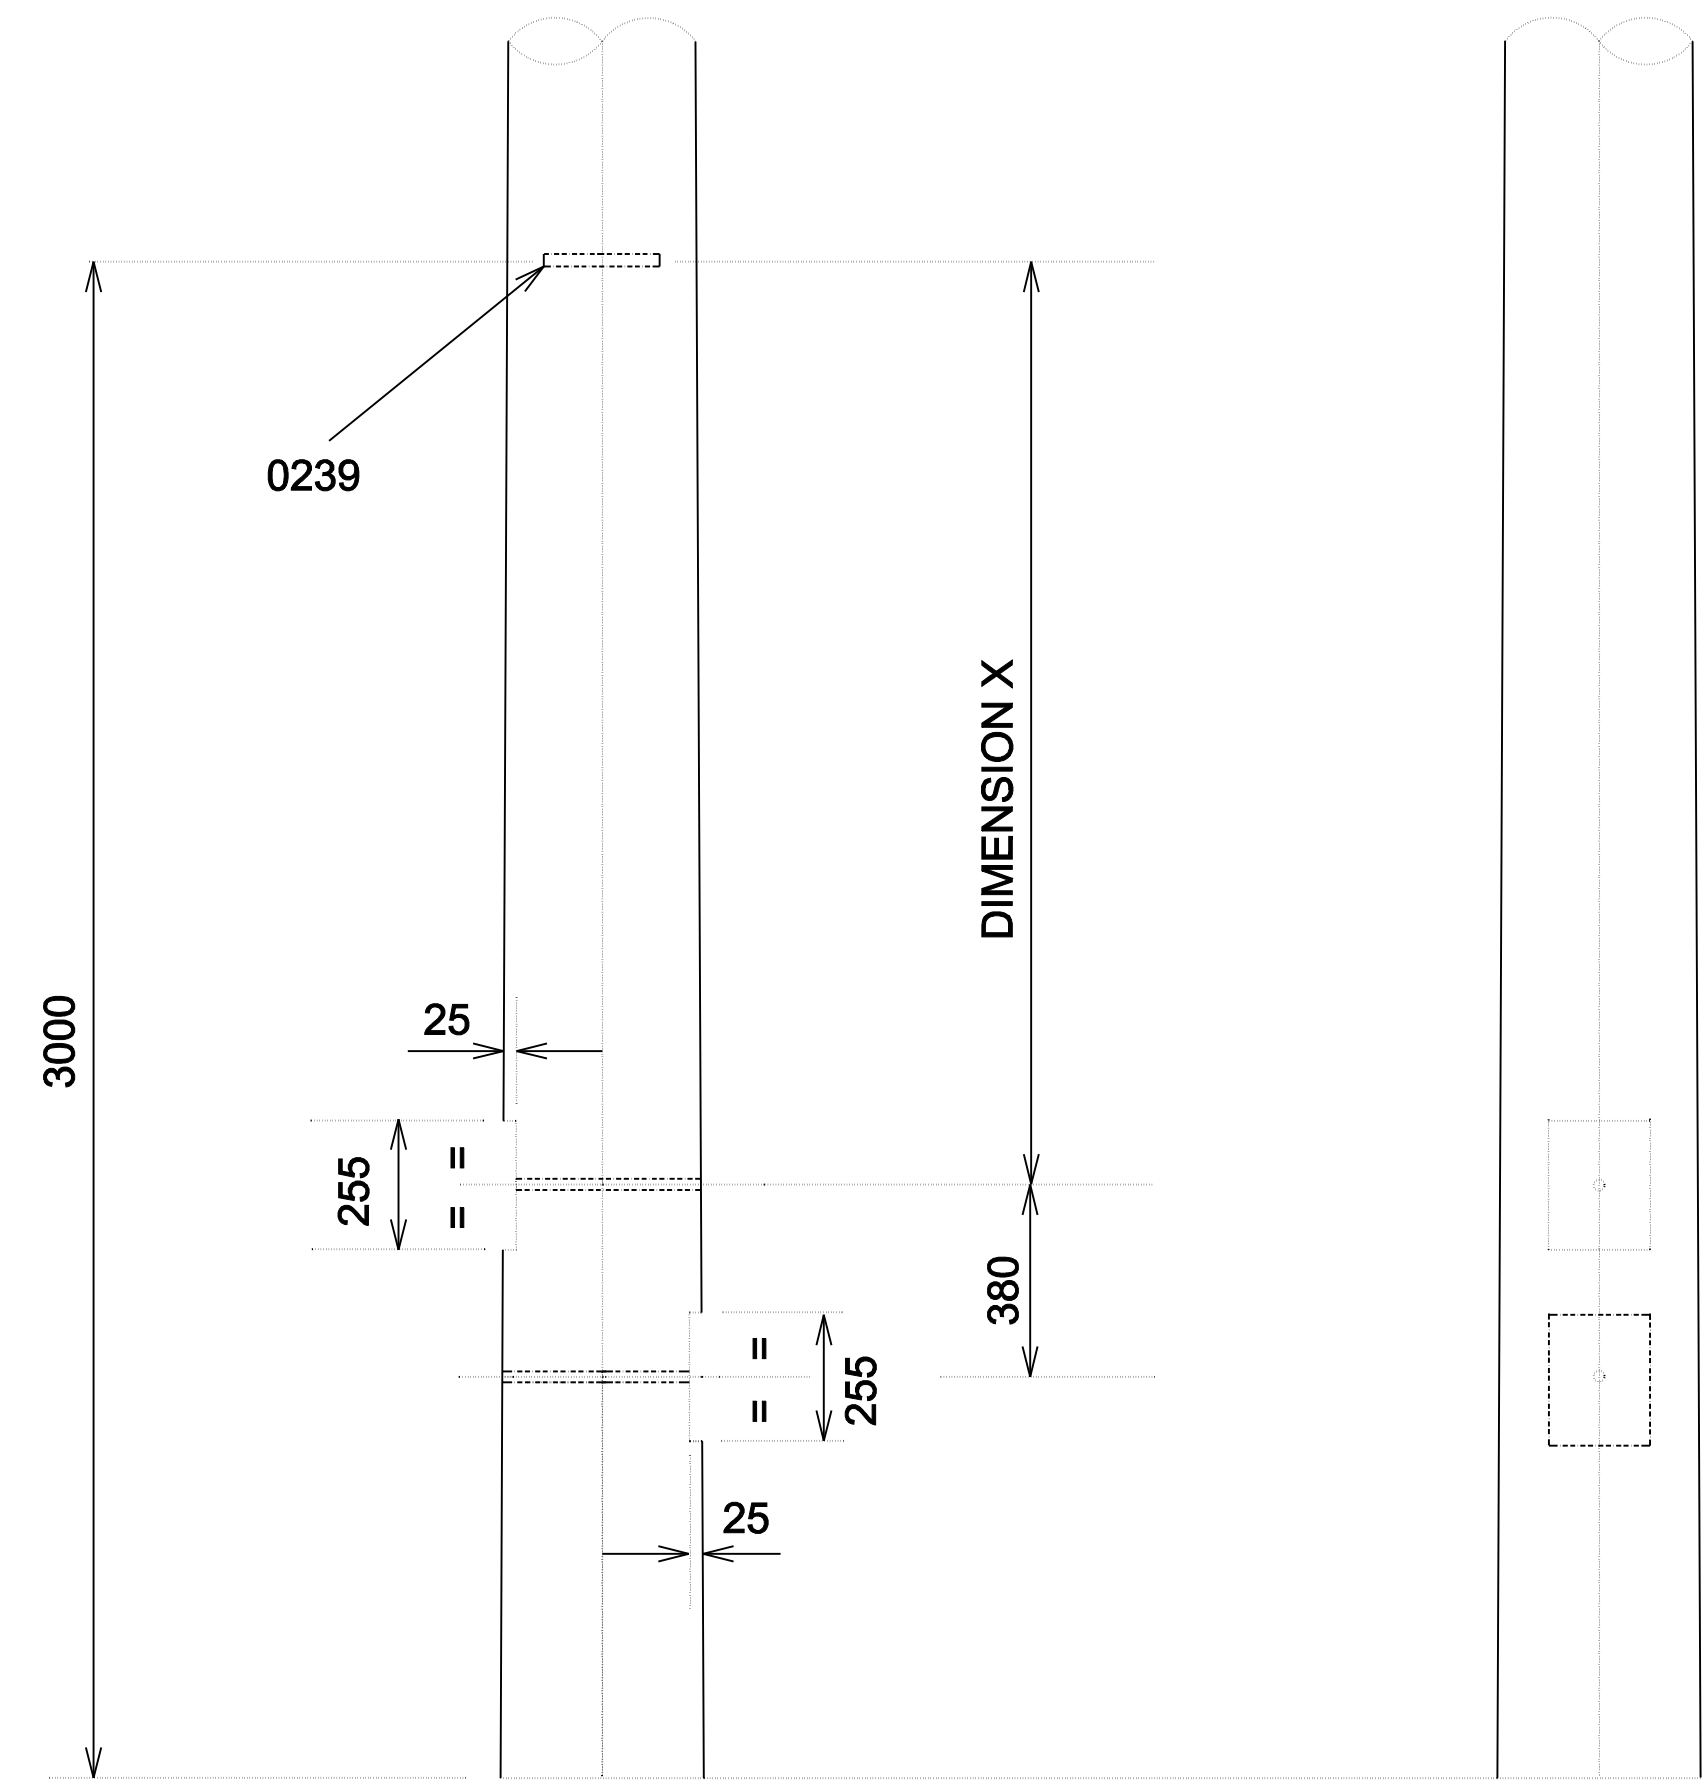
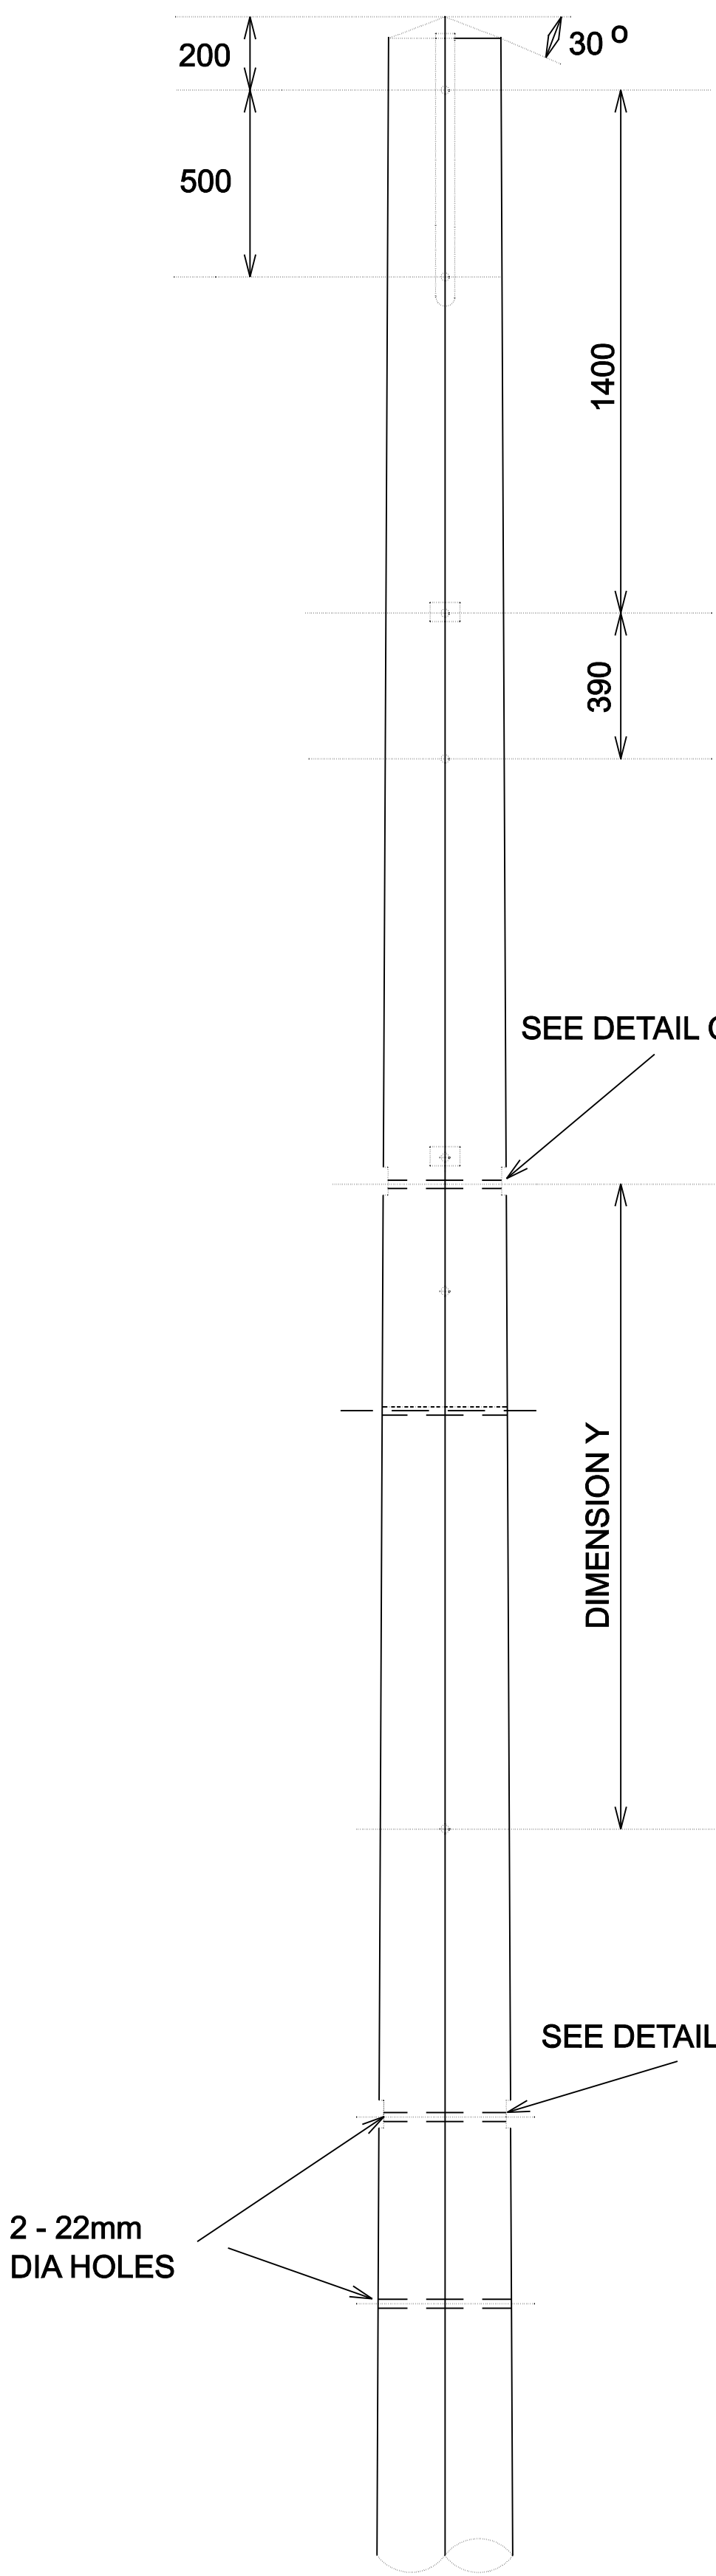
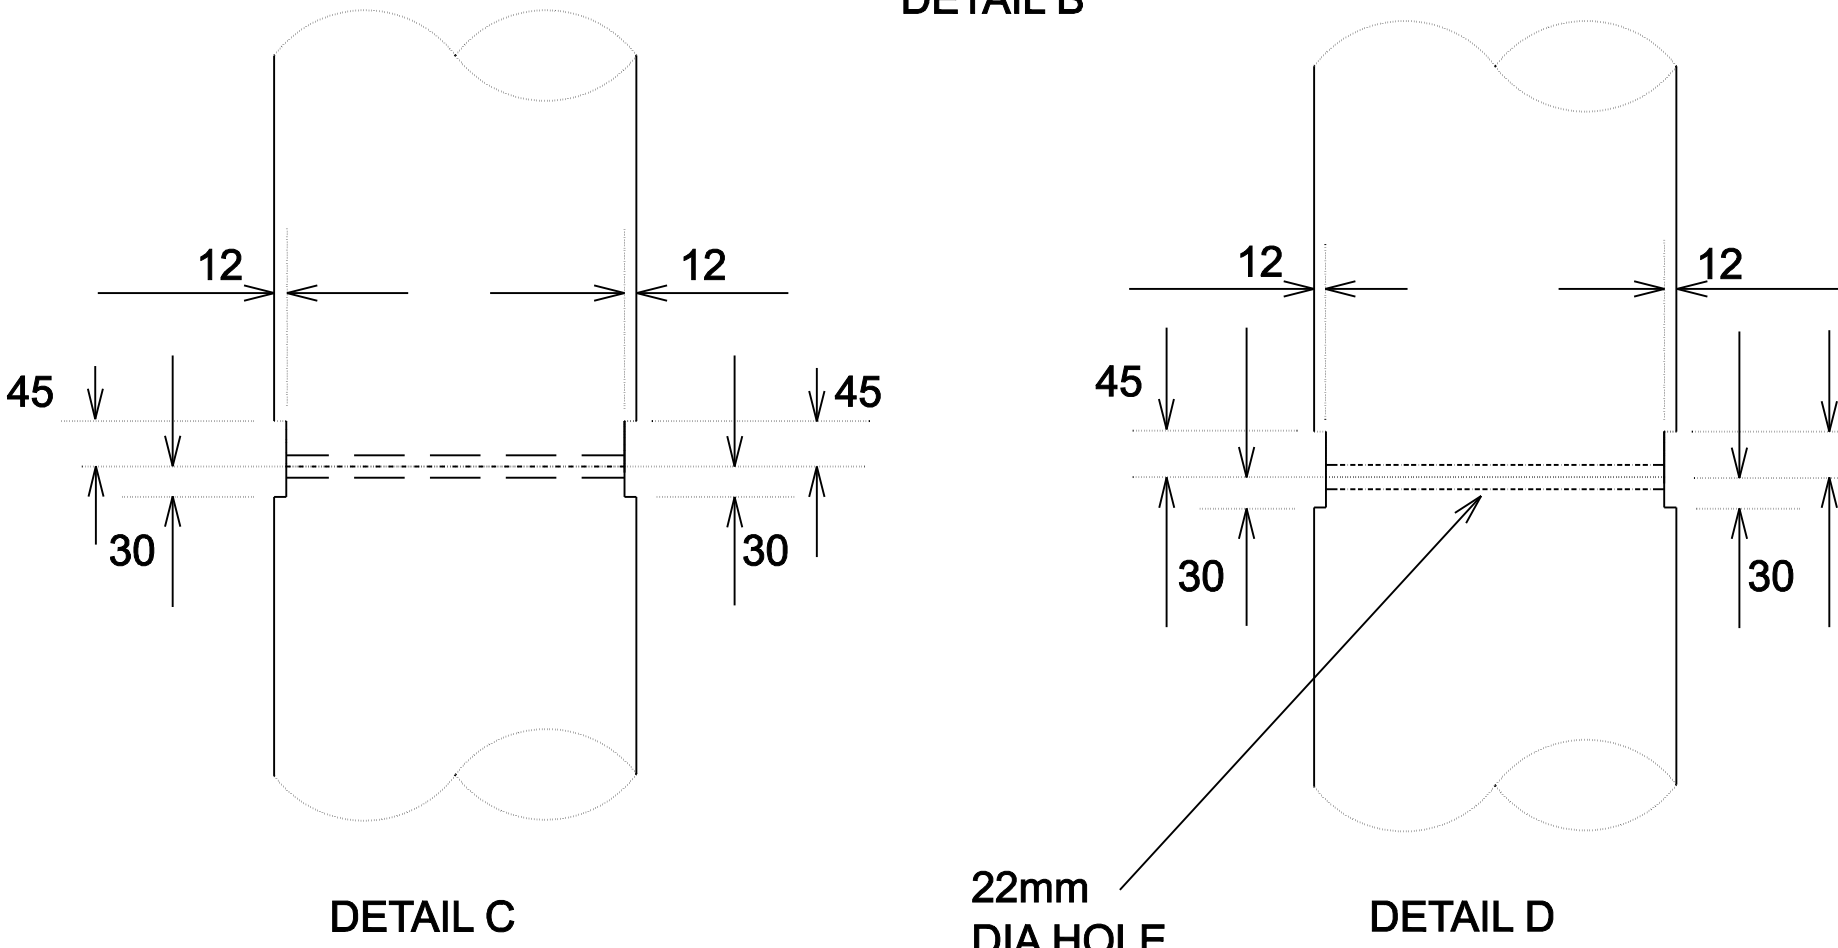
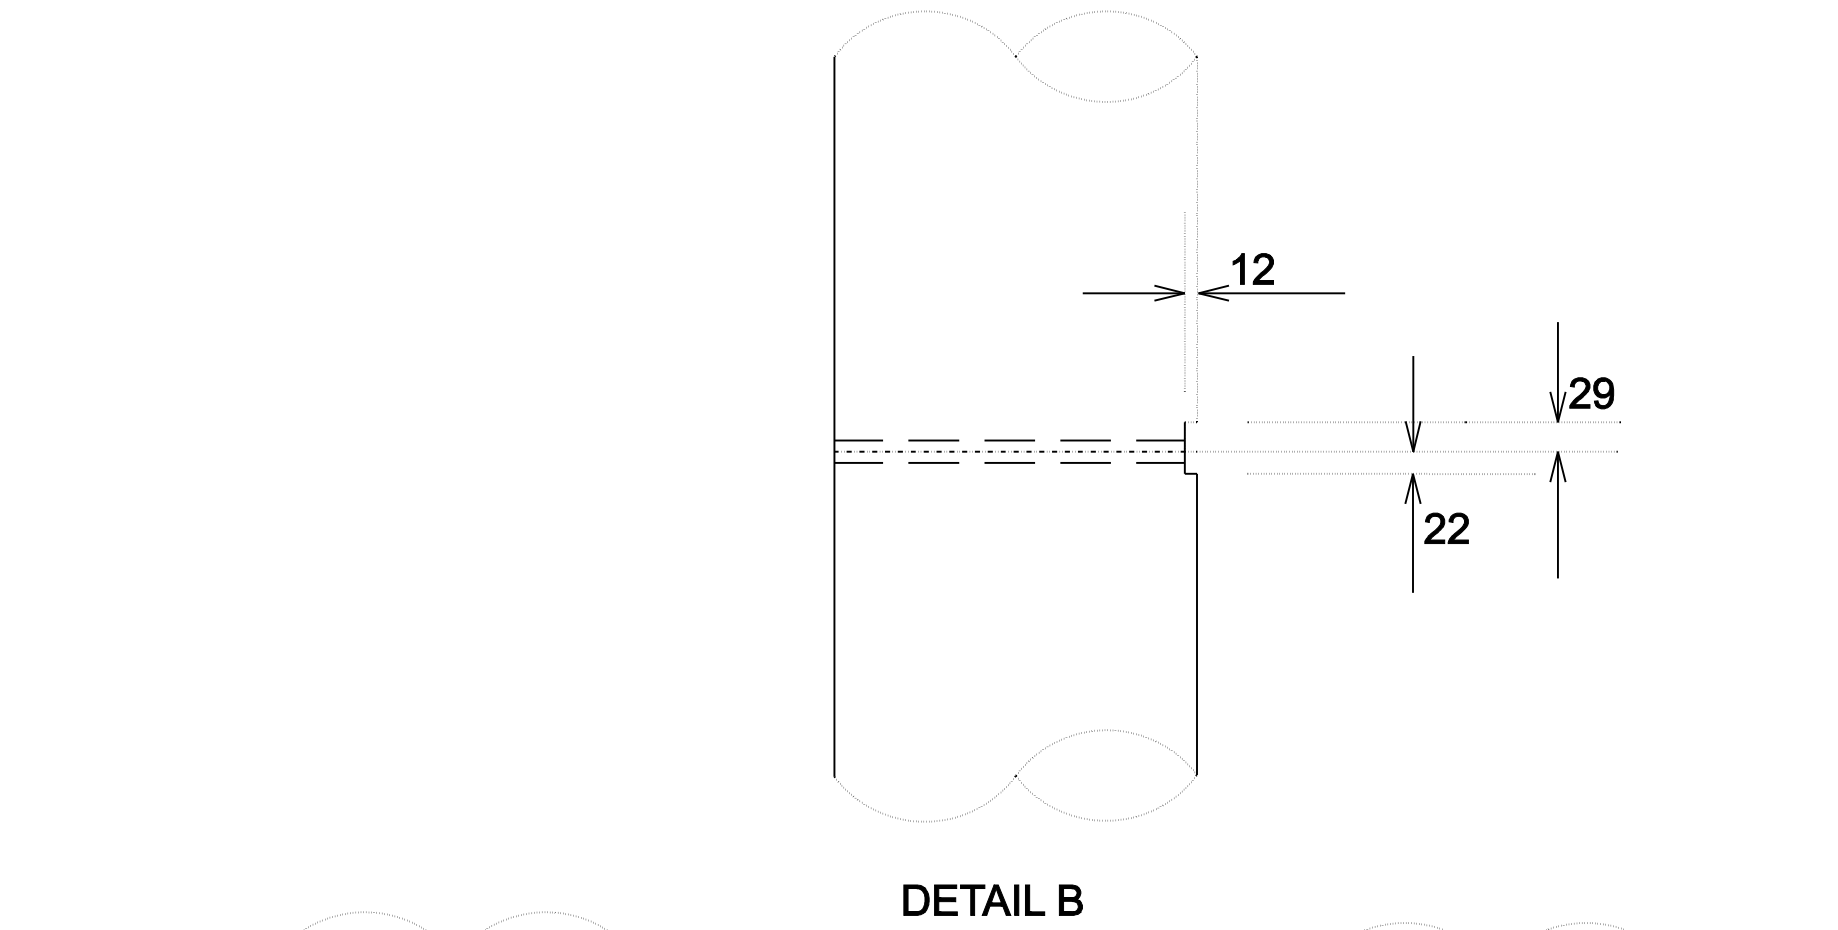


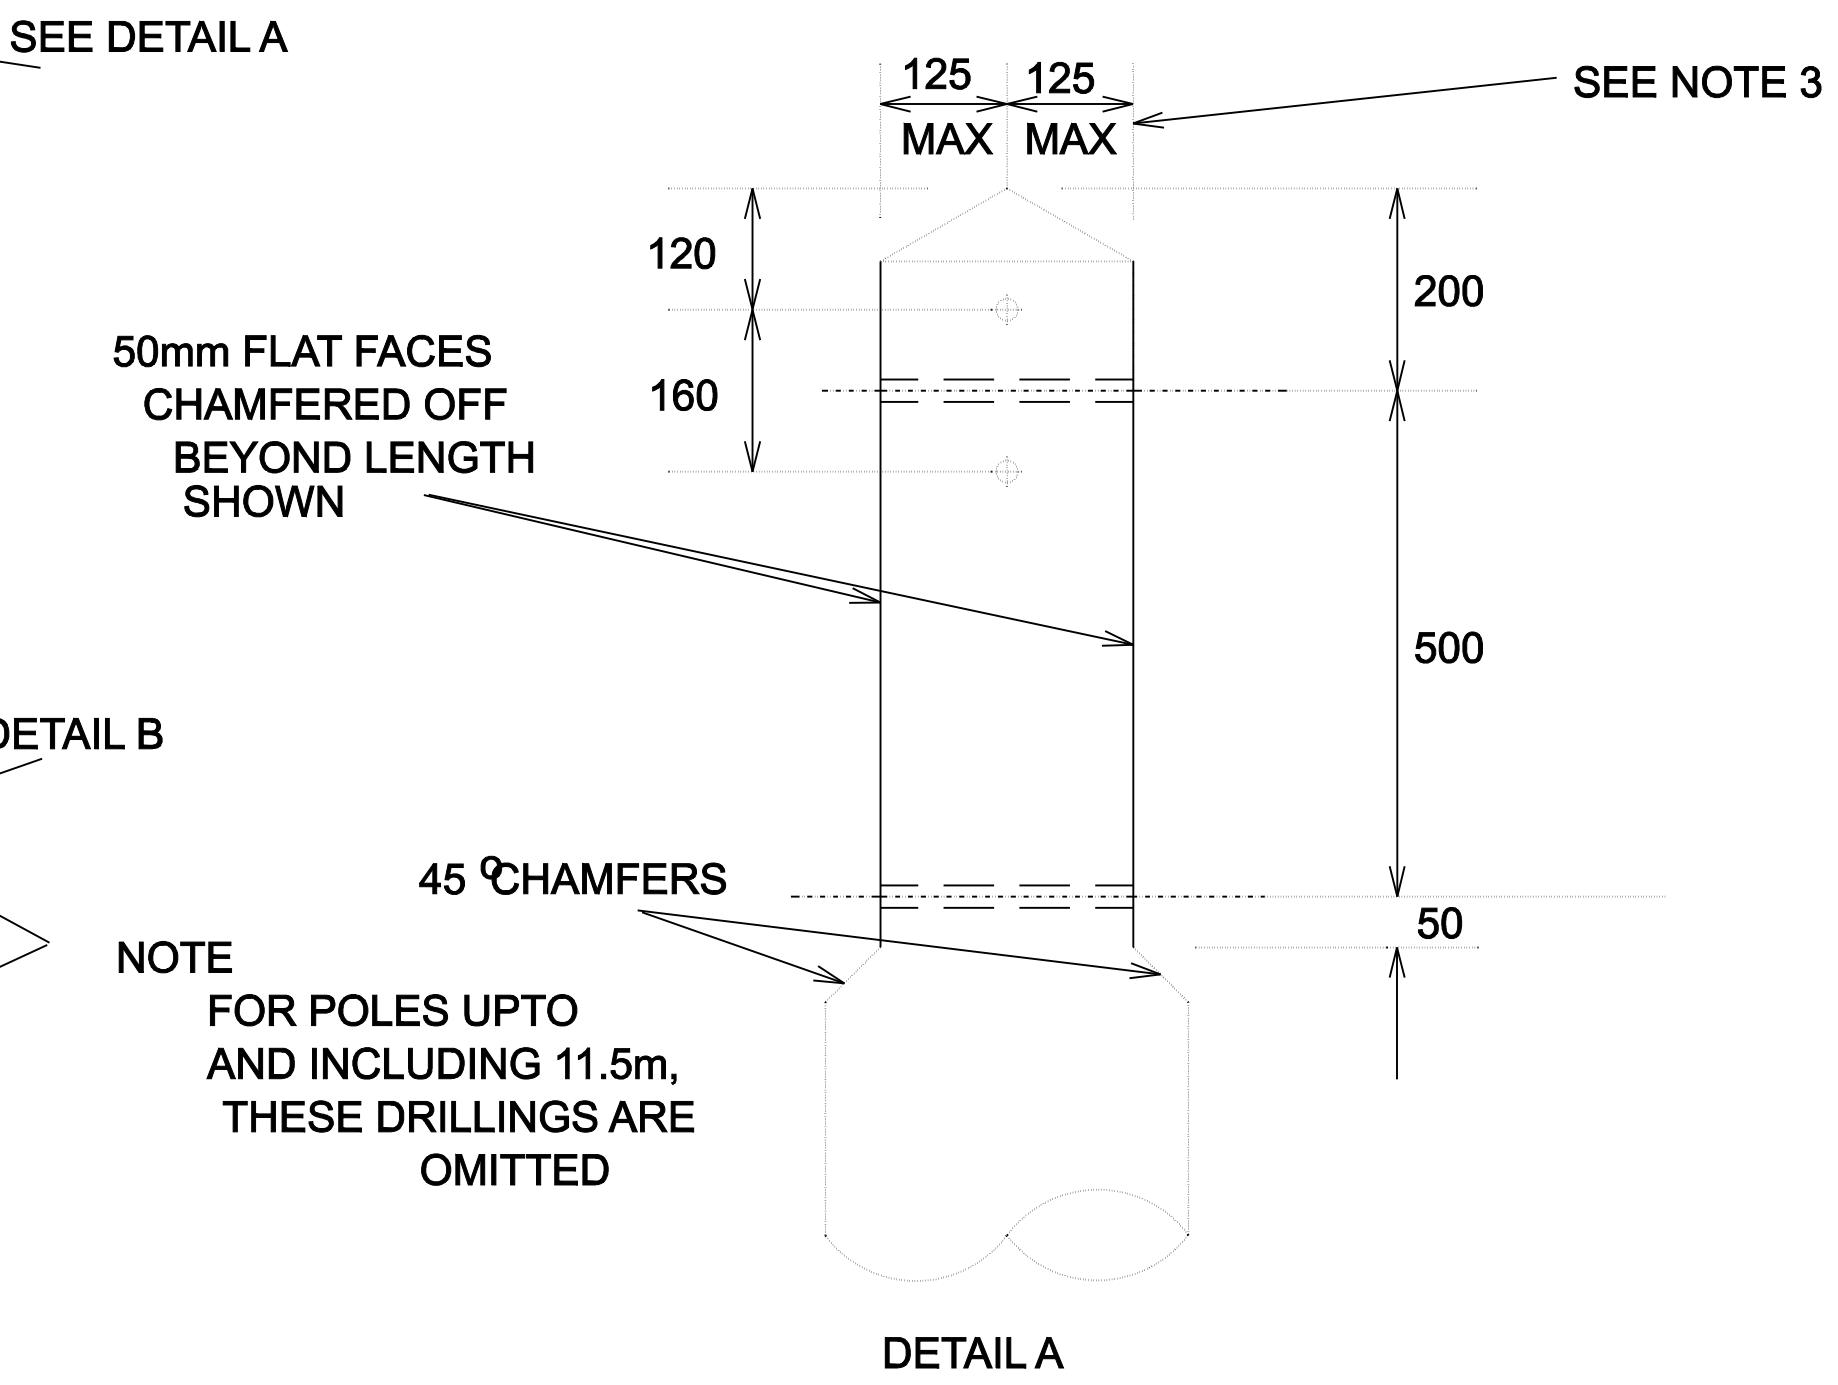

FIGS 1,2,3 AND 4
FOR SHEETS 1 AND 3

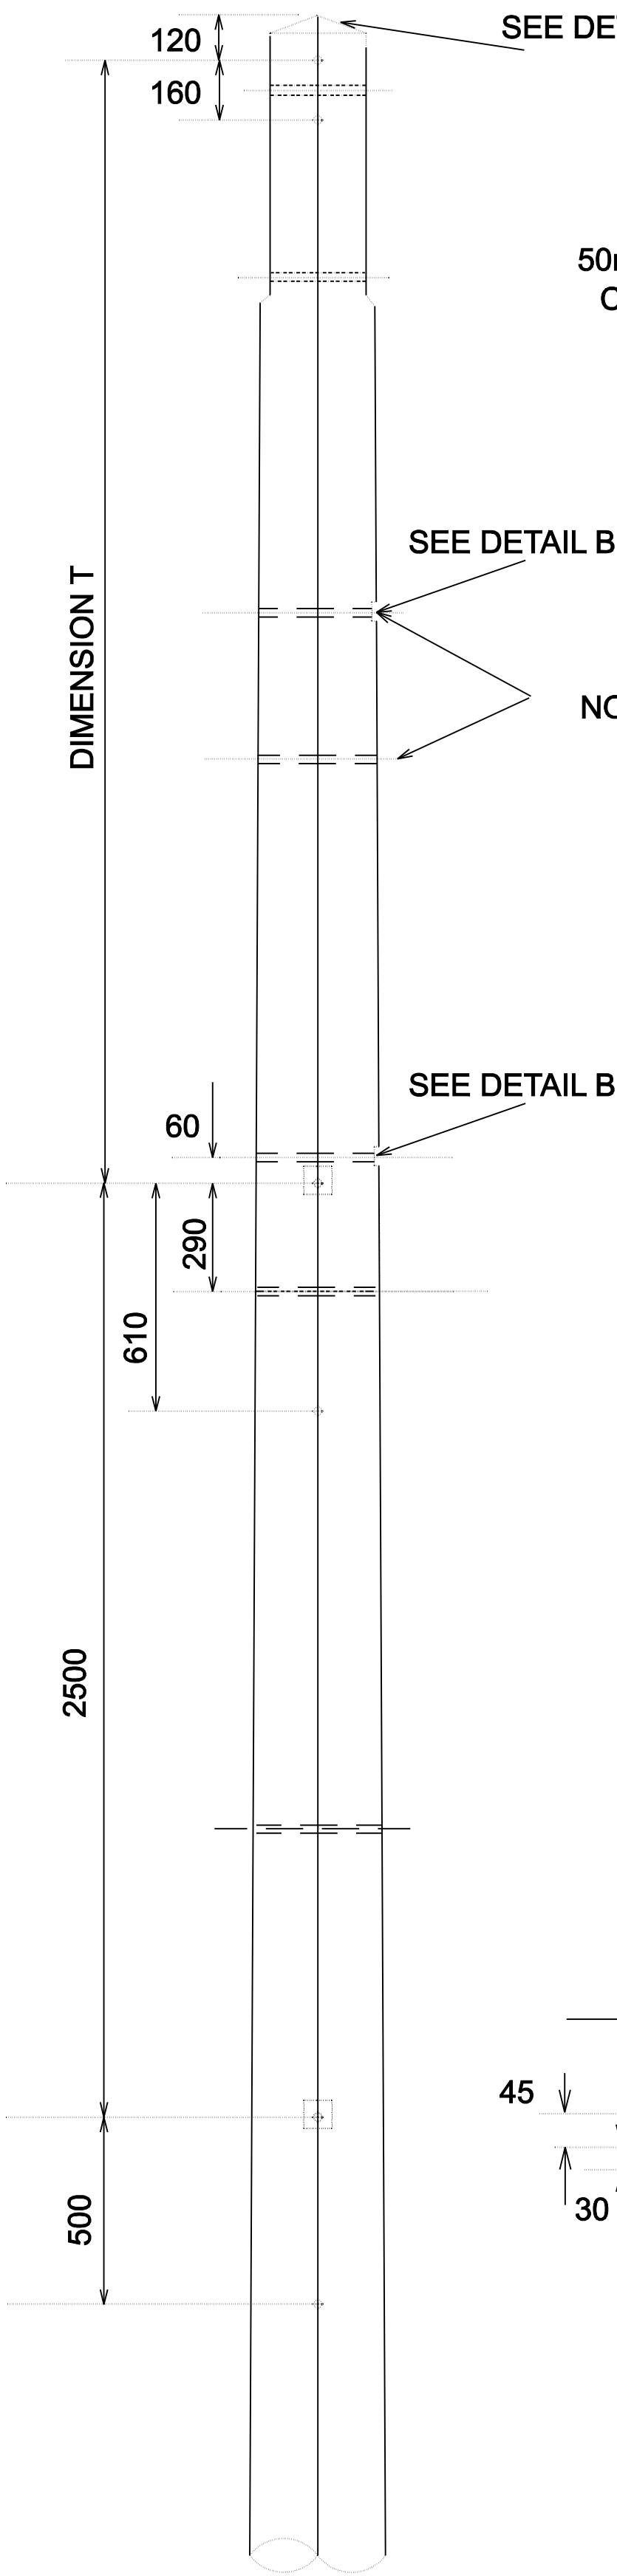

- NOTES
1. MINIMUM POLE LENGTH 11.0m
 2. CLASS OF POLE STOUT
 3. MINIMUM POLE TOP DIAMETER TO BE 210m AFTER FABRICATION
 4. HOLES TO BE 22mm DIA. UNLESS OTHERWISE STATED, DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREOSOTING.
 5. POLE BUTT TO BE CUT AT RIGHT ANGLES TO AXIS OF POLE

POLE LENGTH metres	DIMENSION T metres	DIMENSION X metres	DIMENSION Y metres
11.0	1.95	1.9	2.05
12.0	2.95	1.7	1.85
13.0	3.65	1.4	1.85
14.0	3.65	1.4	1.85

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		11KV OVERHEAD LINES. HV CONSTRUCTION DRILLING, SCARFING & MARKING IN LINE TERMINAL & LAYPOLE S/S WITH HV FUSE UNITS (SEE DRG. 1091080821 S1 & 3)	
Sheet No. 2	Scale 1:20	Type OVERHEAD	
Prepared By Barbara.Simpson		Ref No.	1091080821
Revised 06/03/06	Grid Reference	Ref No.	1091080821
Date Issued 19/08/99	Checked By G HAMMEL	Revision	Notes