

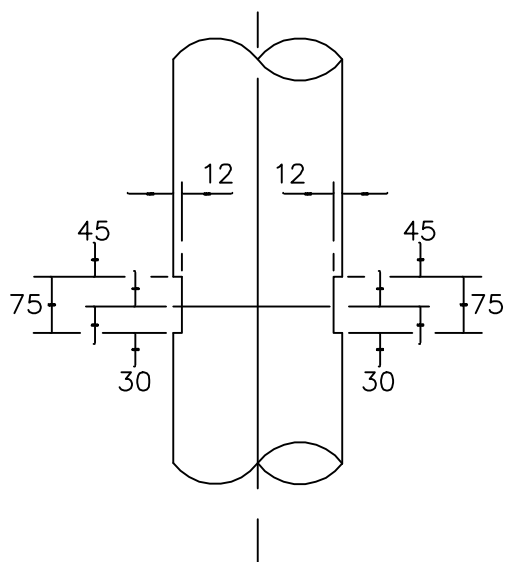


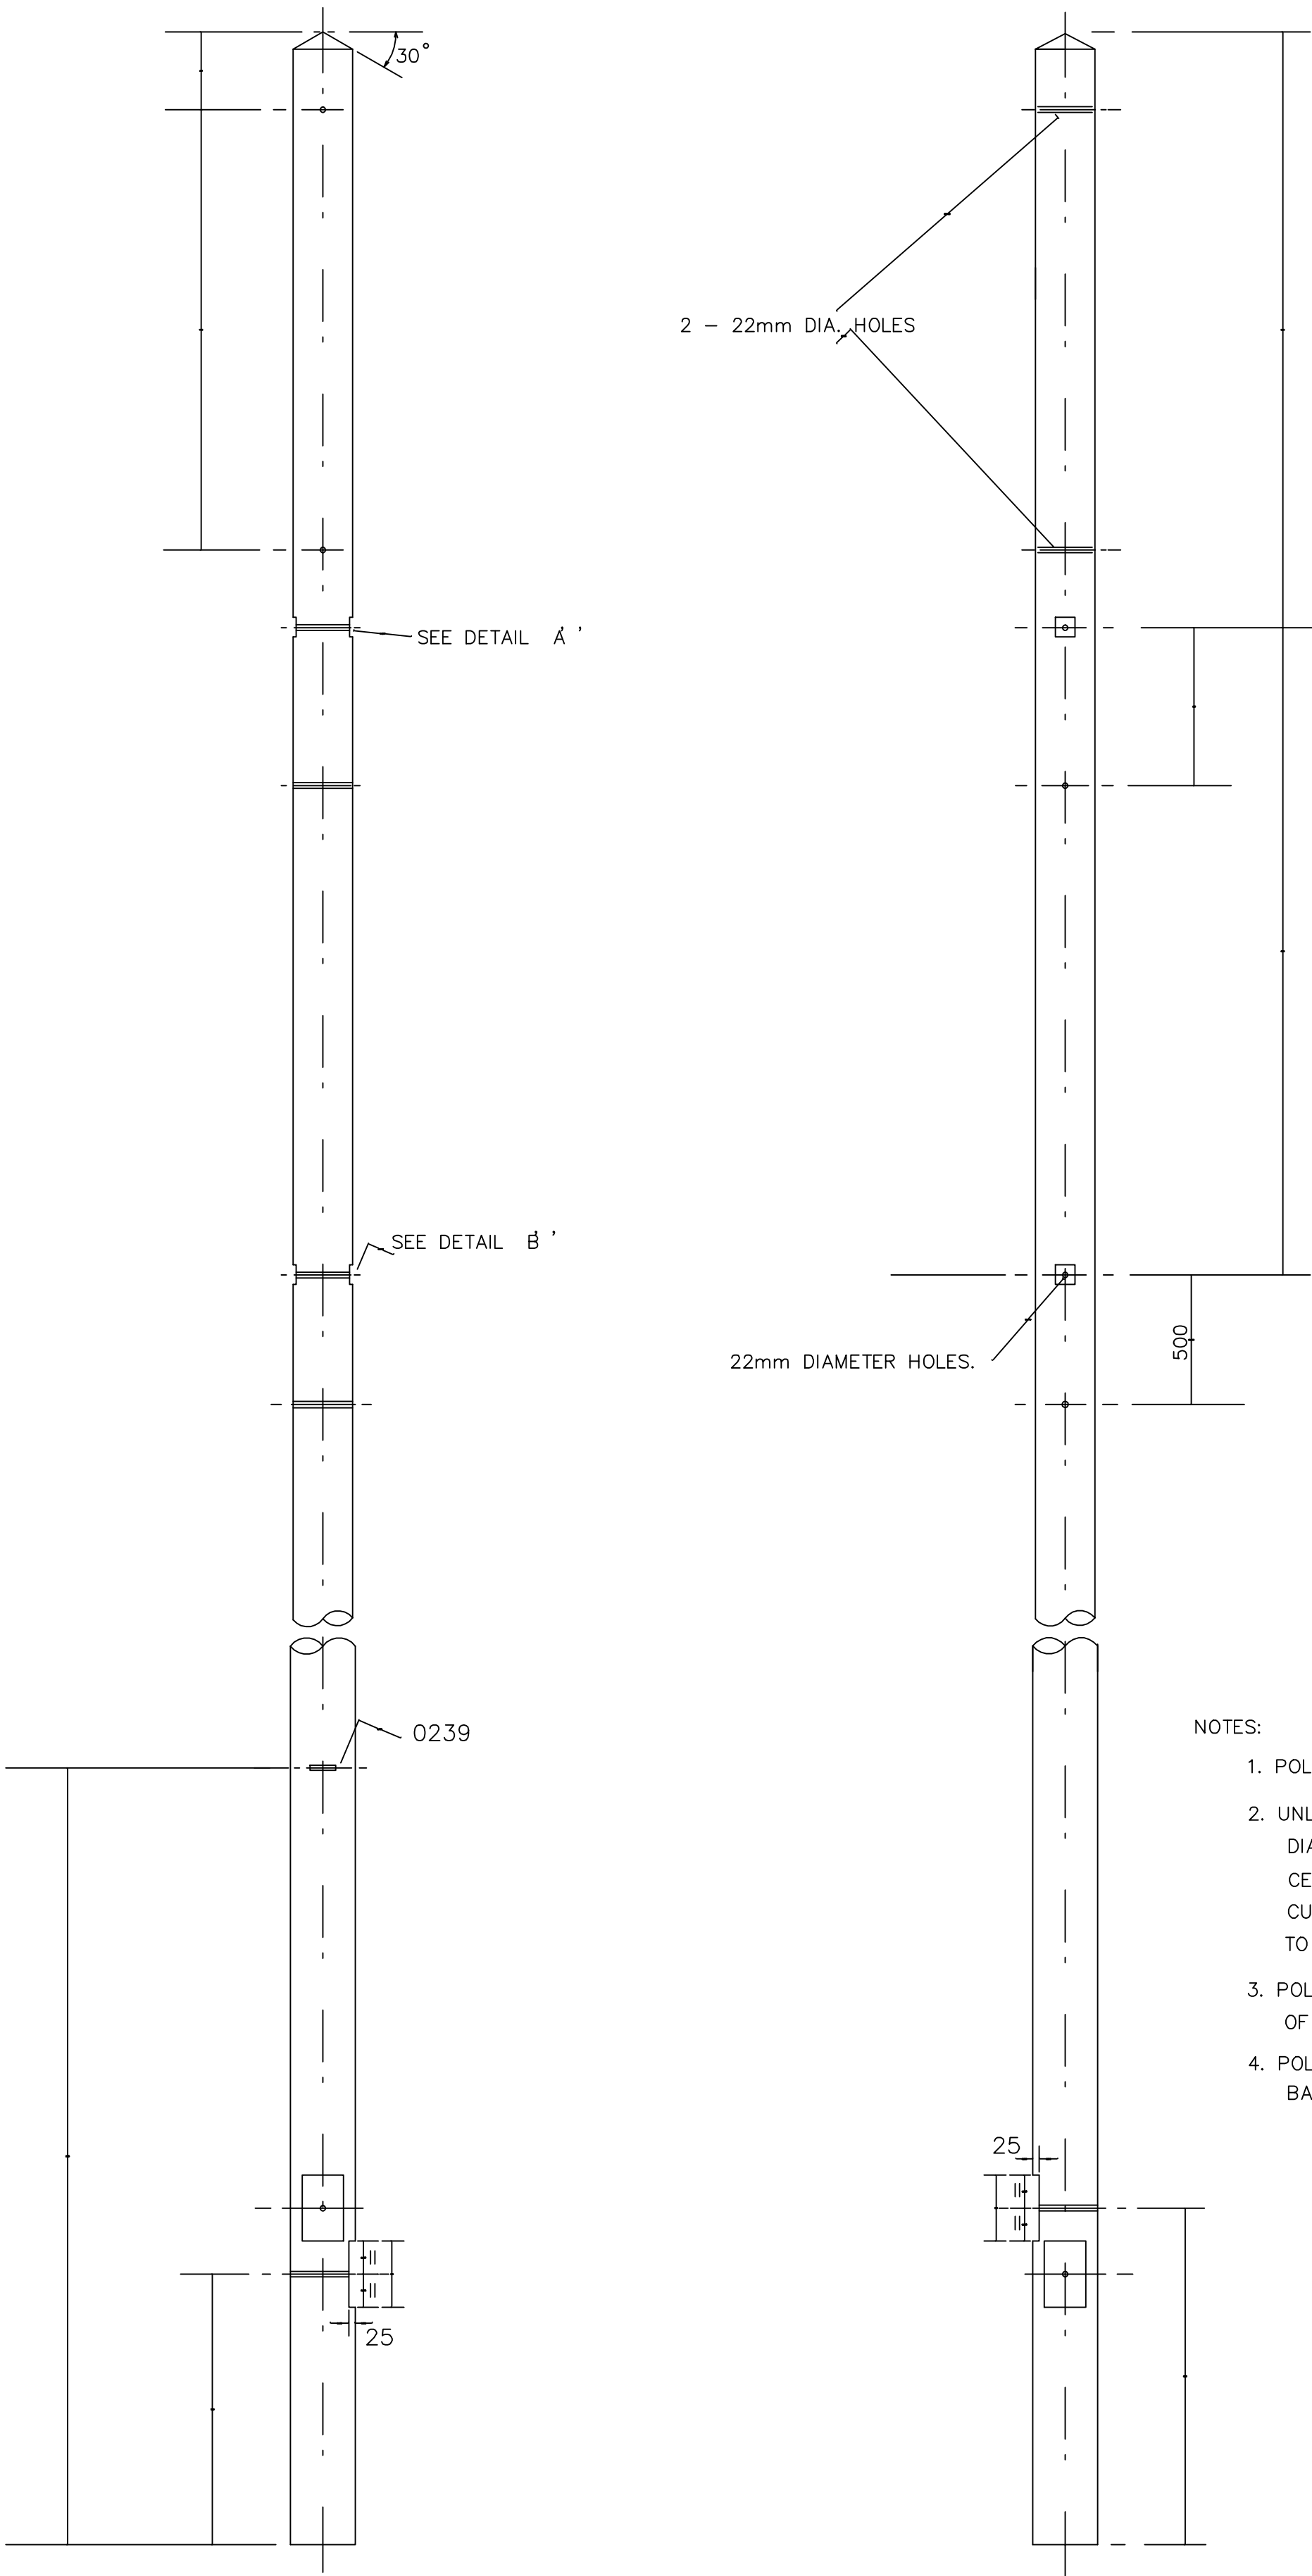

DETAIL A '
SCALE 1:10

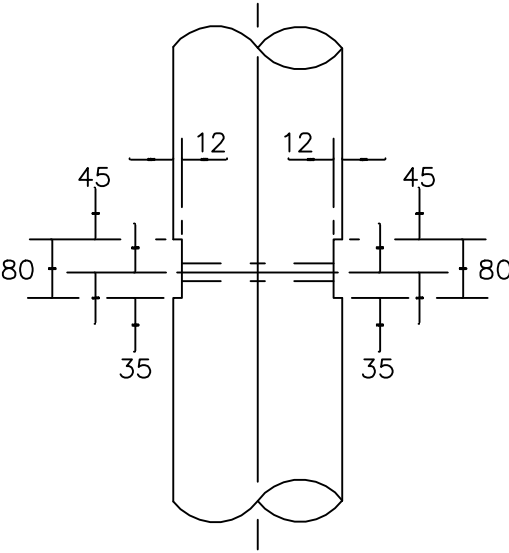

DETAIL B '
SCALE 1:10

- NOTES:
1. POLE LENGTH 11.0m CLASSIFIED STOUT . '
 2. UNLESS STATED OTHERWISE, ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO THE VERTICAL CENTRE LINE OF THE POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO PRESERVATION TREATMENT.
 3. POLE BUTT TO BE CUT AT RIGHT ANGLES TO AXIS OF POLE.
 4. POLE TO BE DRILLED AND NOTCHED FOR 250 X 125 BAULKS.

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

NORTHERN ELECTRIC 		Northern Electric, Carliol House, Newcastle upon Tyne NE1 6NE 11kV AND 20kV OVERHEAD LINES. FABRICATION FOR THREE PHASE TOTEM POLE SUBSTATION H.V. FUSE UNITS & H.V. SUPPLY OFF U/G CABLE & U/G SUPPLY TO L.V. NETWORK. (DRG No. 1.09.108.0865 SHEET 2)									
Drawn J.B.	Traced	Drg.No.	1 09 108 0865						Sheet No.	2	
Checked M.W.	Date Issued 17.05.93								Revised	20.05.97	
Mads. A									Scale	1:20 & 1:10	