



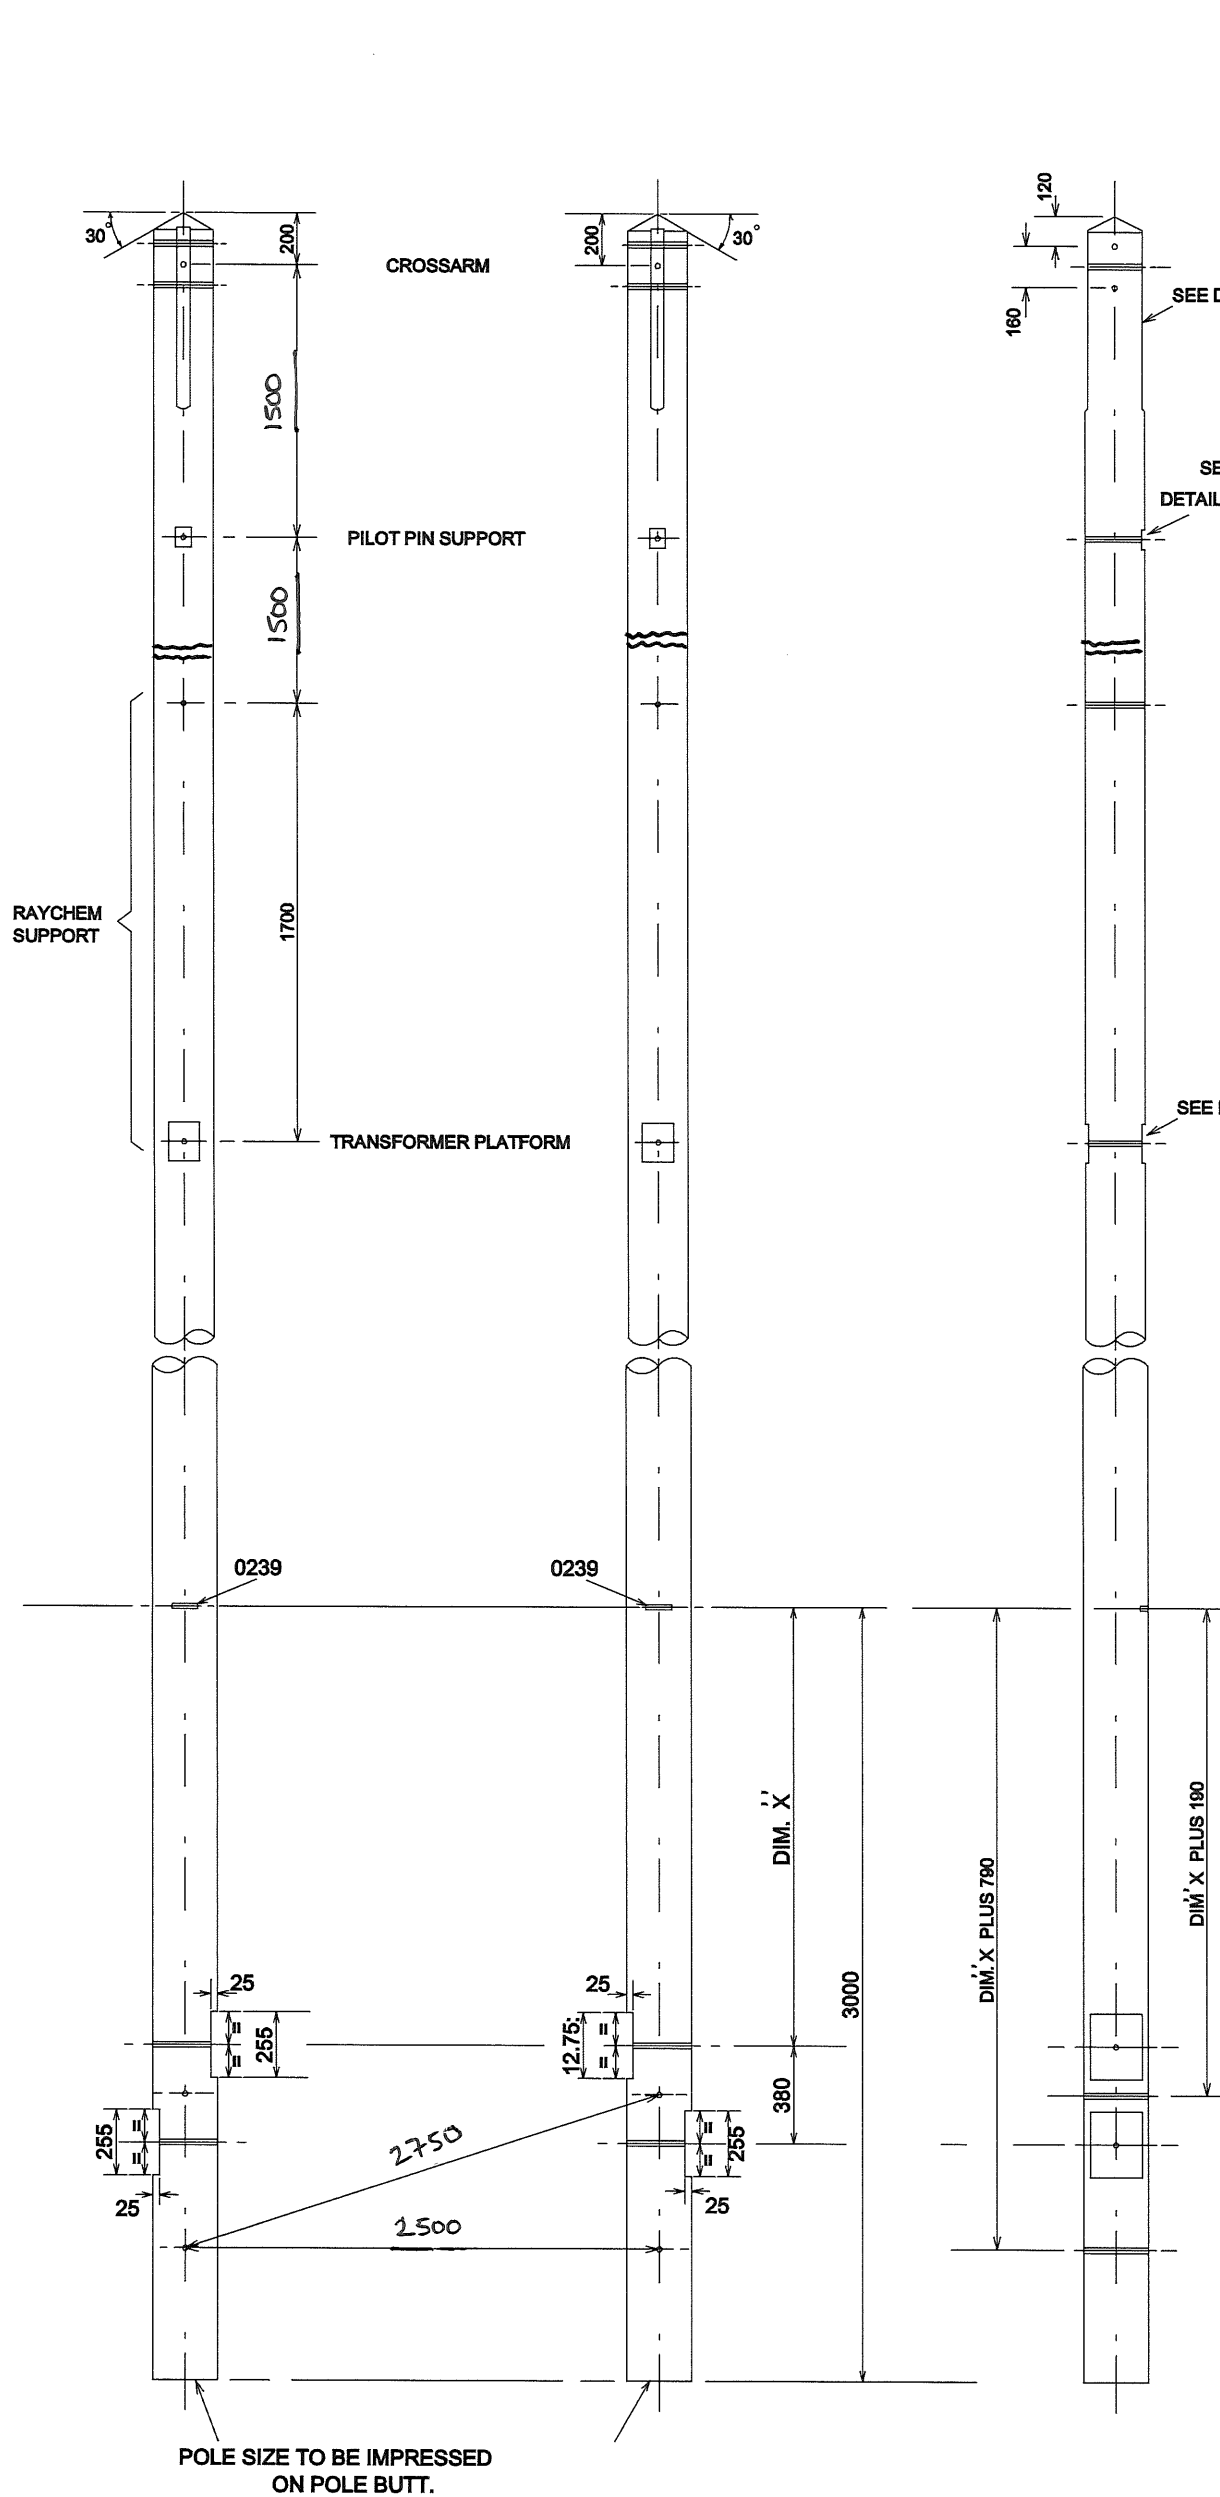


SCARFING TO BE CUT TO GIVE A 50mm WIDE FLAT ON BOTH FACES OF THE POLES AND THE ENDS CHAMFERED OFF AS SHOWN.

DETAIL A ''
SCALE 1:10



DETAIL B ''
SCALE 1:10

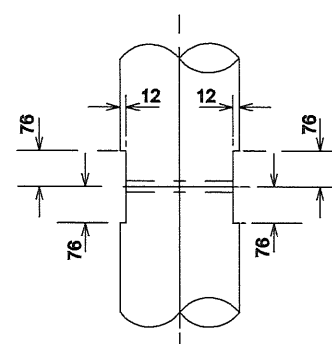

DETAIL C ''
SCALE 1:10

NOTES:

1. STANDARD 11.0m POLE TO BE USED WHEREVER POSSIBLE.
2. CLASS OF POLE TO BE 'STOUT' AS SPECIFIED WITH A MINIMUM 210mm POLE TOP DIAMETER AFTER FABRICATION.
3. POLES TO BE MATCHED.
4. ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO PRESERVATION TREATMENT.
5. POLE BUTT TO BE CUT AT RIGHT ANGLES TO AXIS OF POLE.
6. POLE TO BE NOTCHED AND DRILLED FOR DUPLICATE 250 x 125 BAULKS.

POLE LENGTH. (m)	DIM. X' (mm)
11.0	1900

POLE SIZE TO BE IMPRESSED ON POLE BUTT.

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED.

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		HV OVERHEAD LINES - TOTEM 'H' WITH 2 CABLE TERMINATIONS AND ABSD	
Sheet No. 17	Scale 1:20	Type ESI	ESI
Prepared By Janis Webb		Ref No.	Historic Drg.No. 1091090907
Revised 24/04/06	Grid Reference	Revision	Notes
Date Issued 23/02/05	Checked By G HAMMEL		