

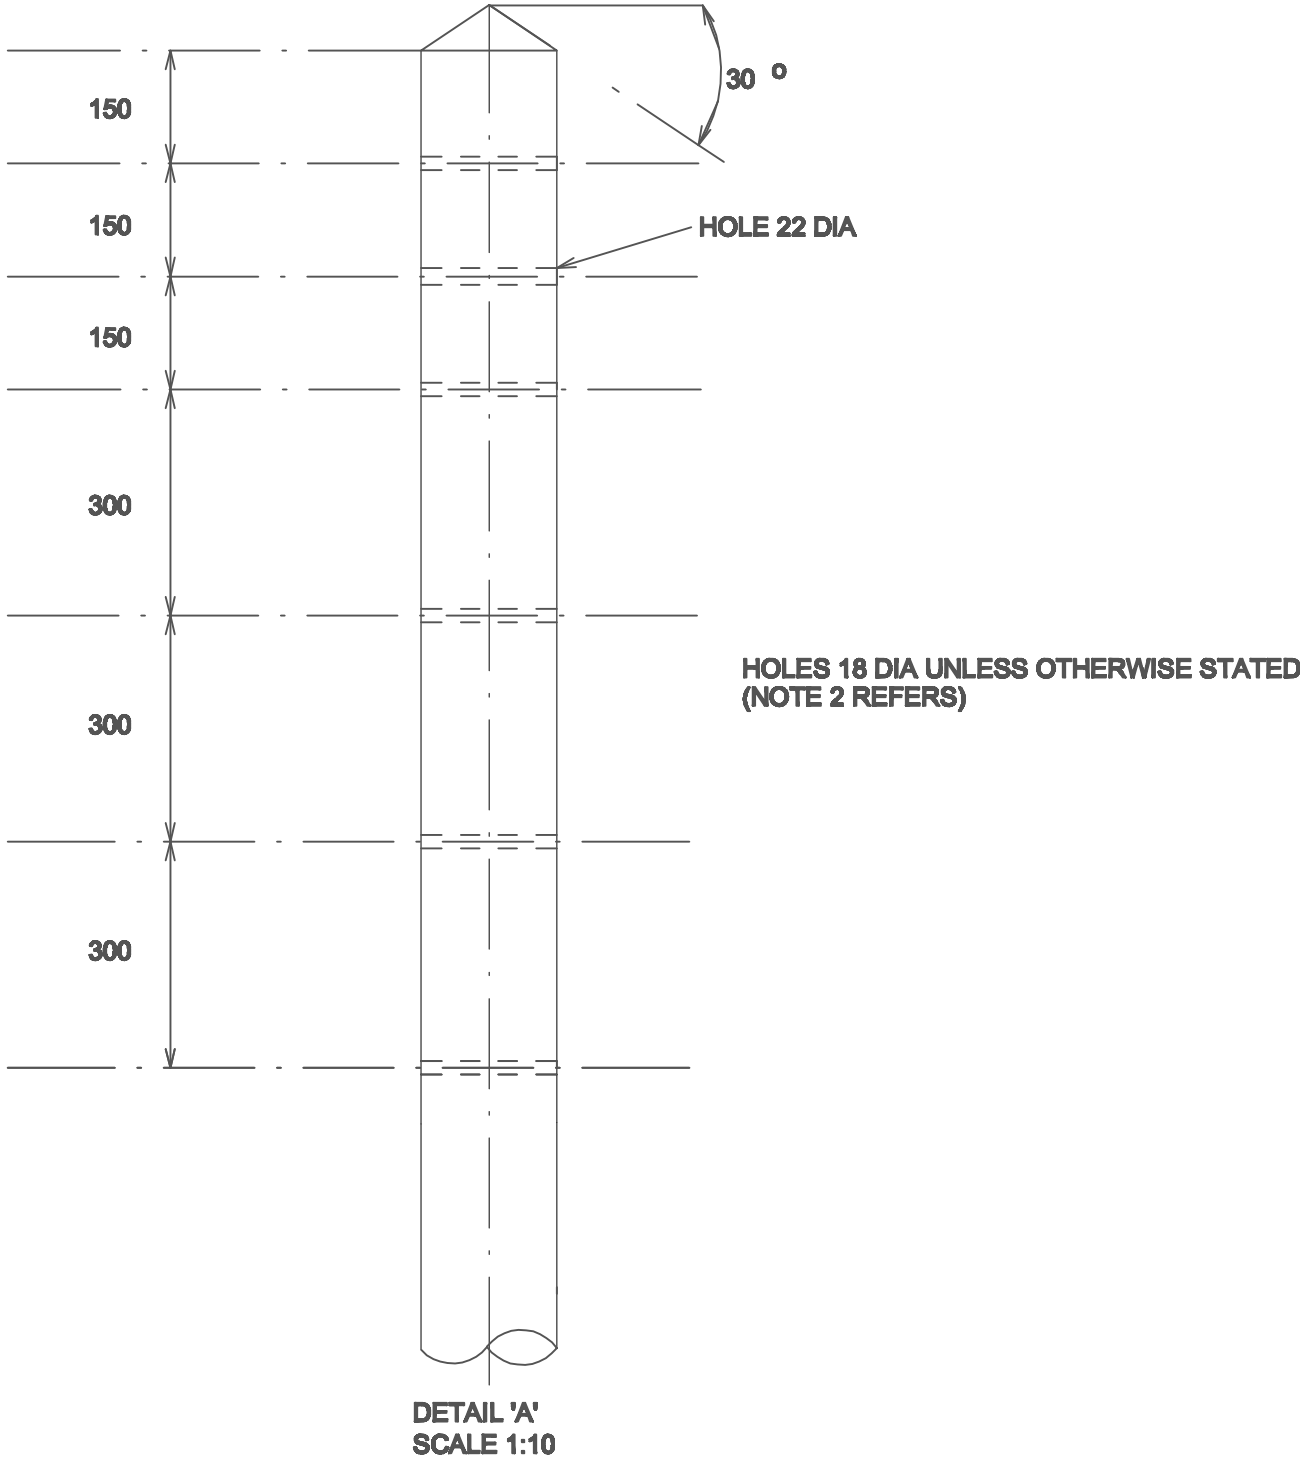


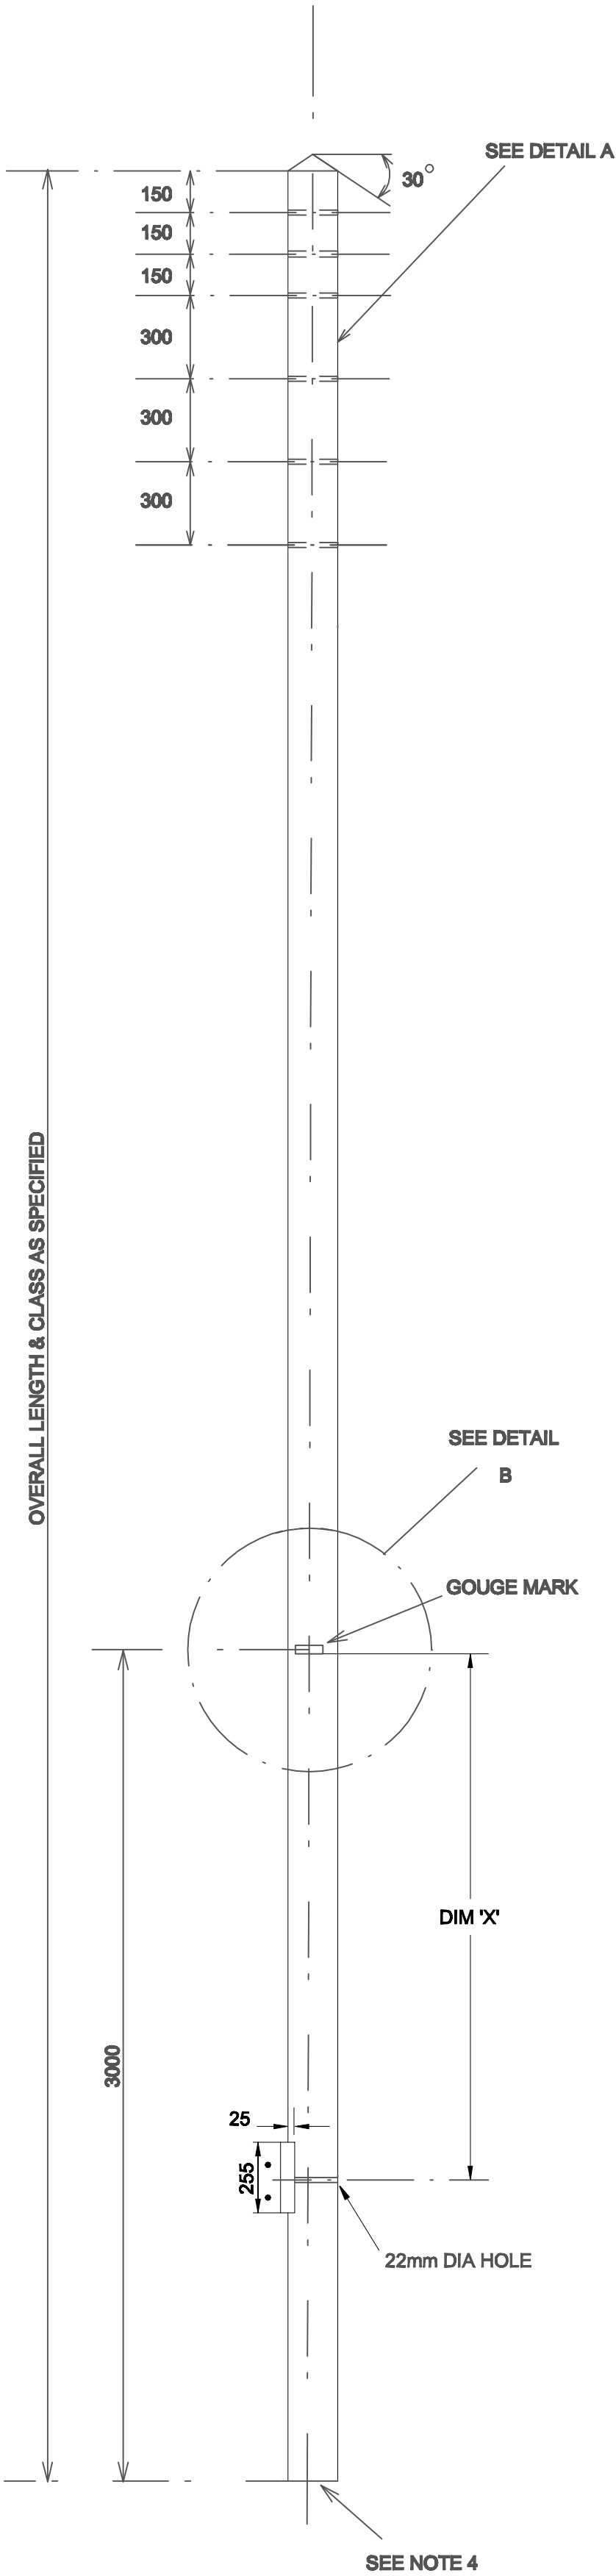

N.B.
CHARACTERS TO BE
50mm HIGH

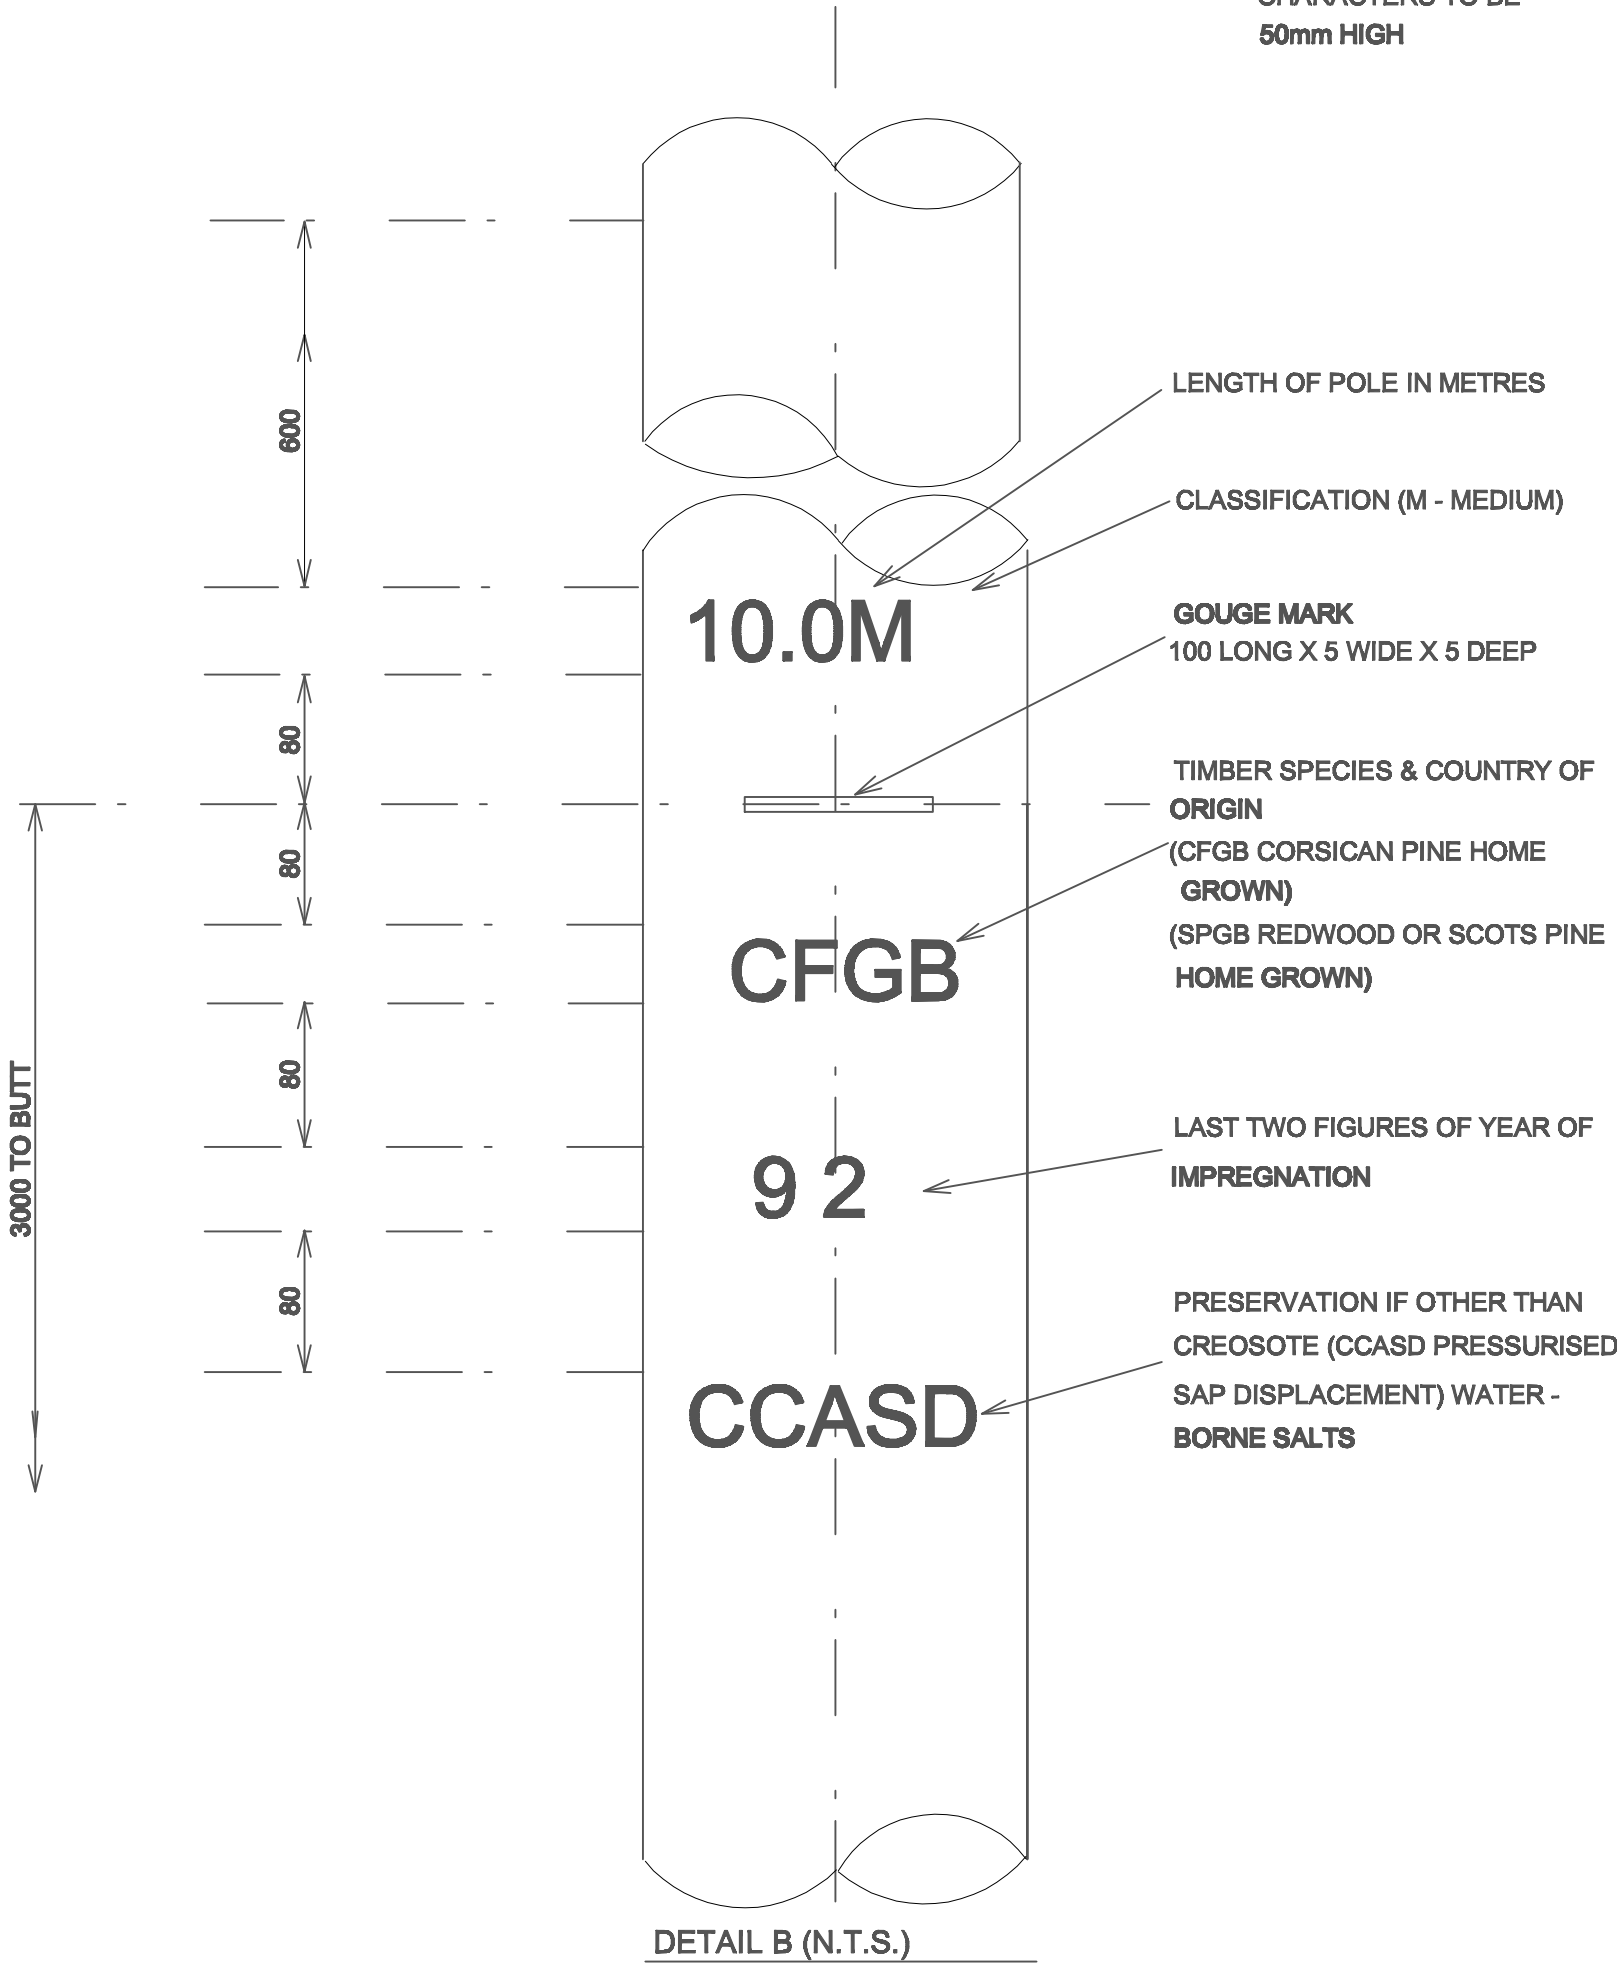

- NOTES
- POLES TO BE HOME GROWN SOFTWOOD TREATED BY PRESSURISED SAP DISPLACEMENT (SALT TREATMENT)
 - NUMBER AND SPACING OF HOLES TO BE SPECIFIED
 - POLE TO BE EVENLY QUARTERED. APEX - 120
 - POLE LENGTH, CLASSIFICATION AND FABRICATION DRG. No. MARKED ON BUTT USING METAL MARKER TAPE
 - BASED ON ESI STANDARD 43-88 APPENDIX N AND ESI DRG No 433001
 - HOLES TO BE 18mm DIA. UNLESS SPECIFIED OTHERWISE

POLE LENGTH (m)	DIMENSION 'X' (mm)	SINKING DEPTH (mm)
9.0 - 11.0	1900	1600
12.0	1700	1800
13.0 - 14.0	1400	1800

 CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF			
Manufacturer Details		LV OVERHEAD LINES DRILLING AND MARKING OF WOOD POLES FOR OPEN WIRE AND ABC CONSTRUCTION			
Sheet No. 3	Scale 1:20				
Prepared By Janis.Webb					
		Type OVERHEAD	LINES		
Revised 11/04/06	Grid Reference	Ref No.	C101820	Historic Drg.No.	1091193301
Date Issued 20/01/05	Checked By G HAMMEL	Revision	Notes		

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED