

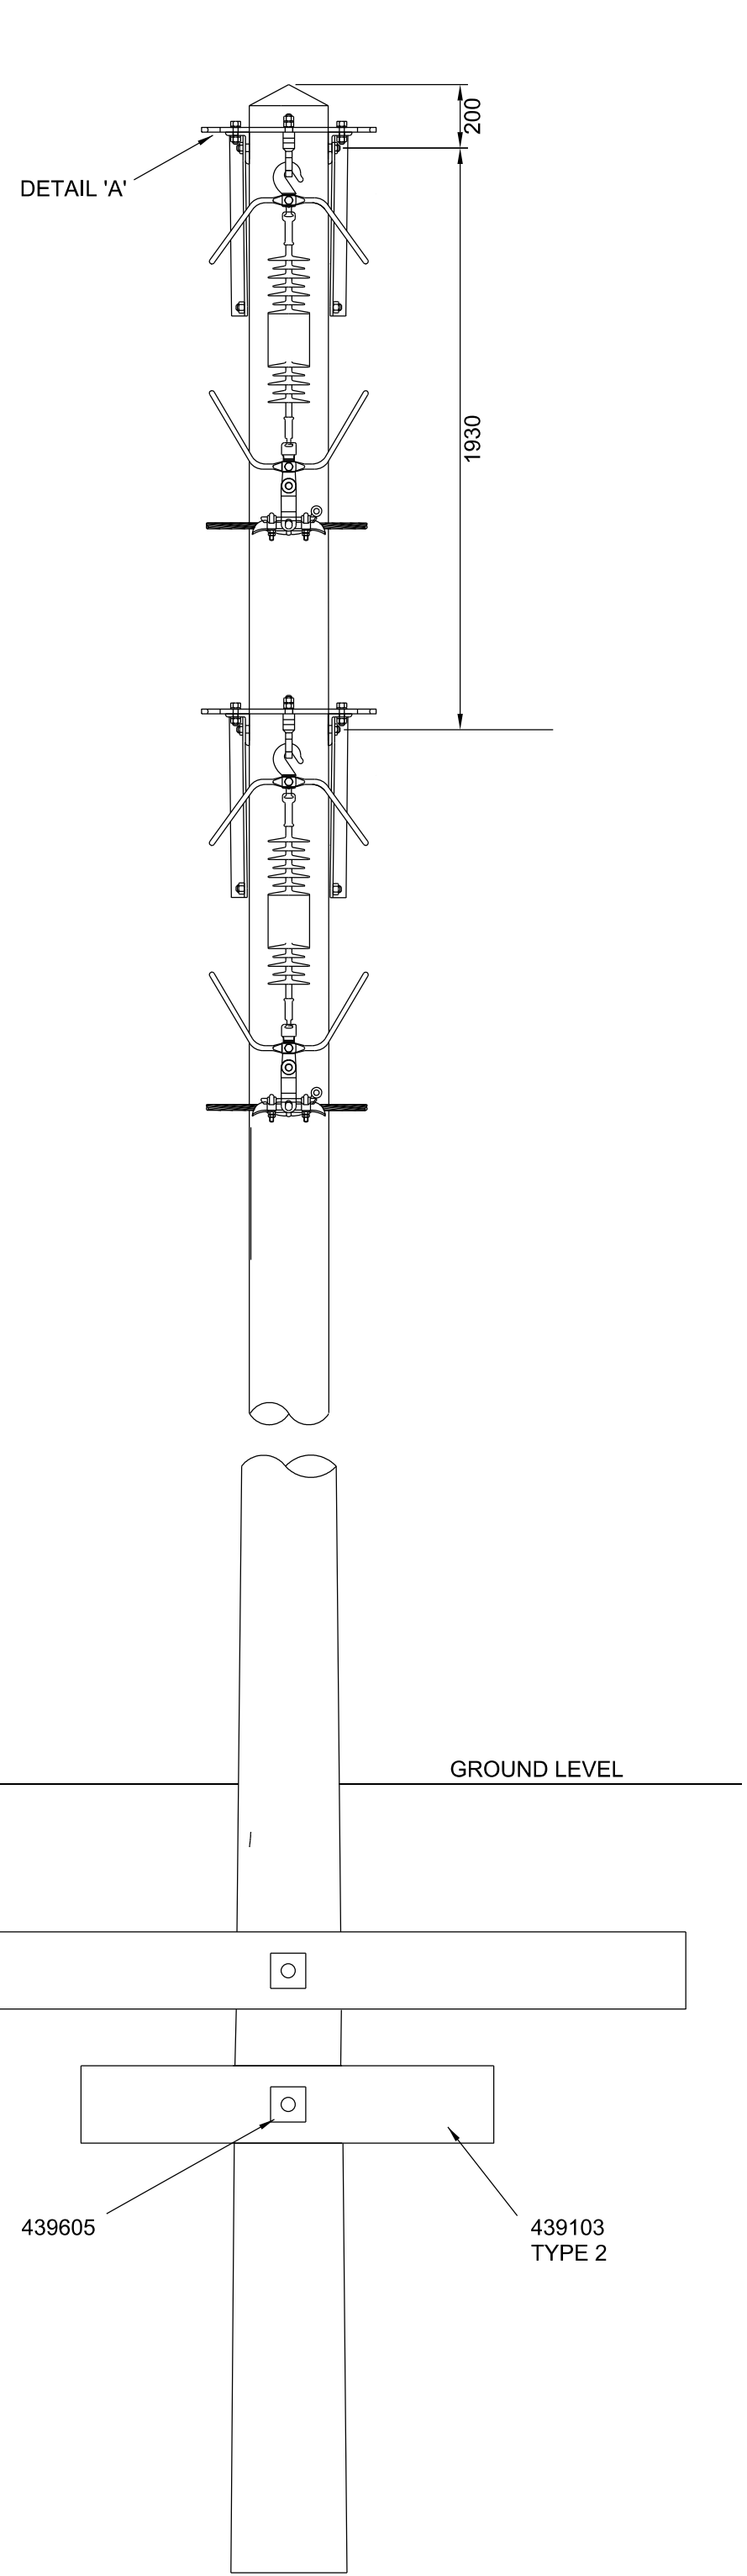


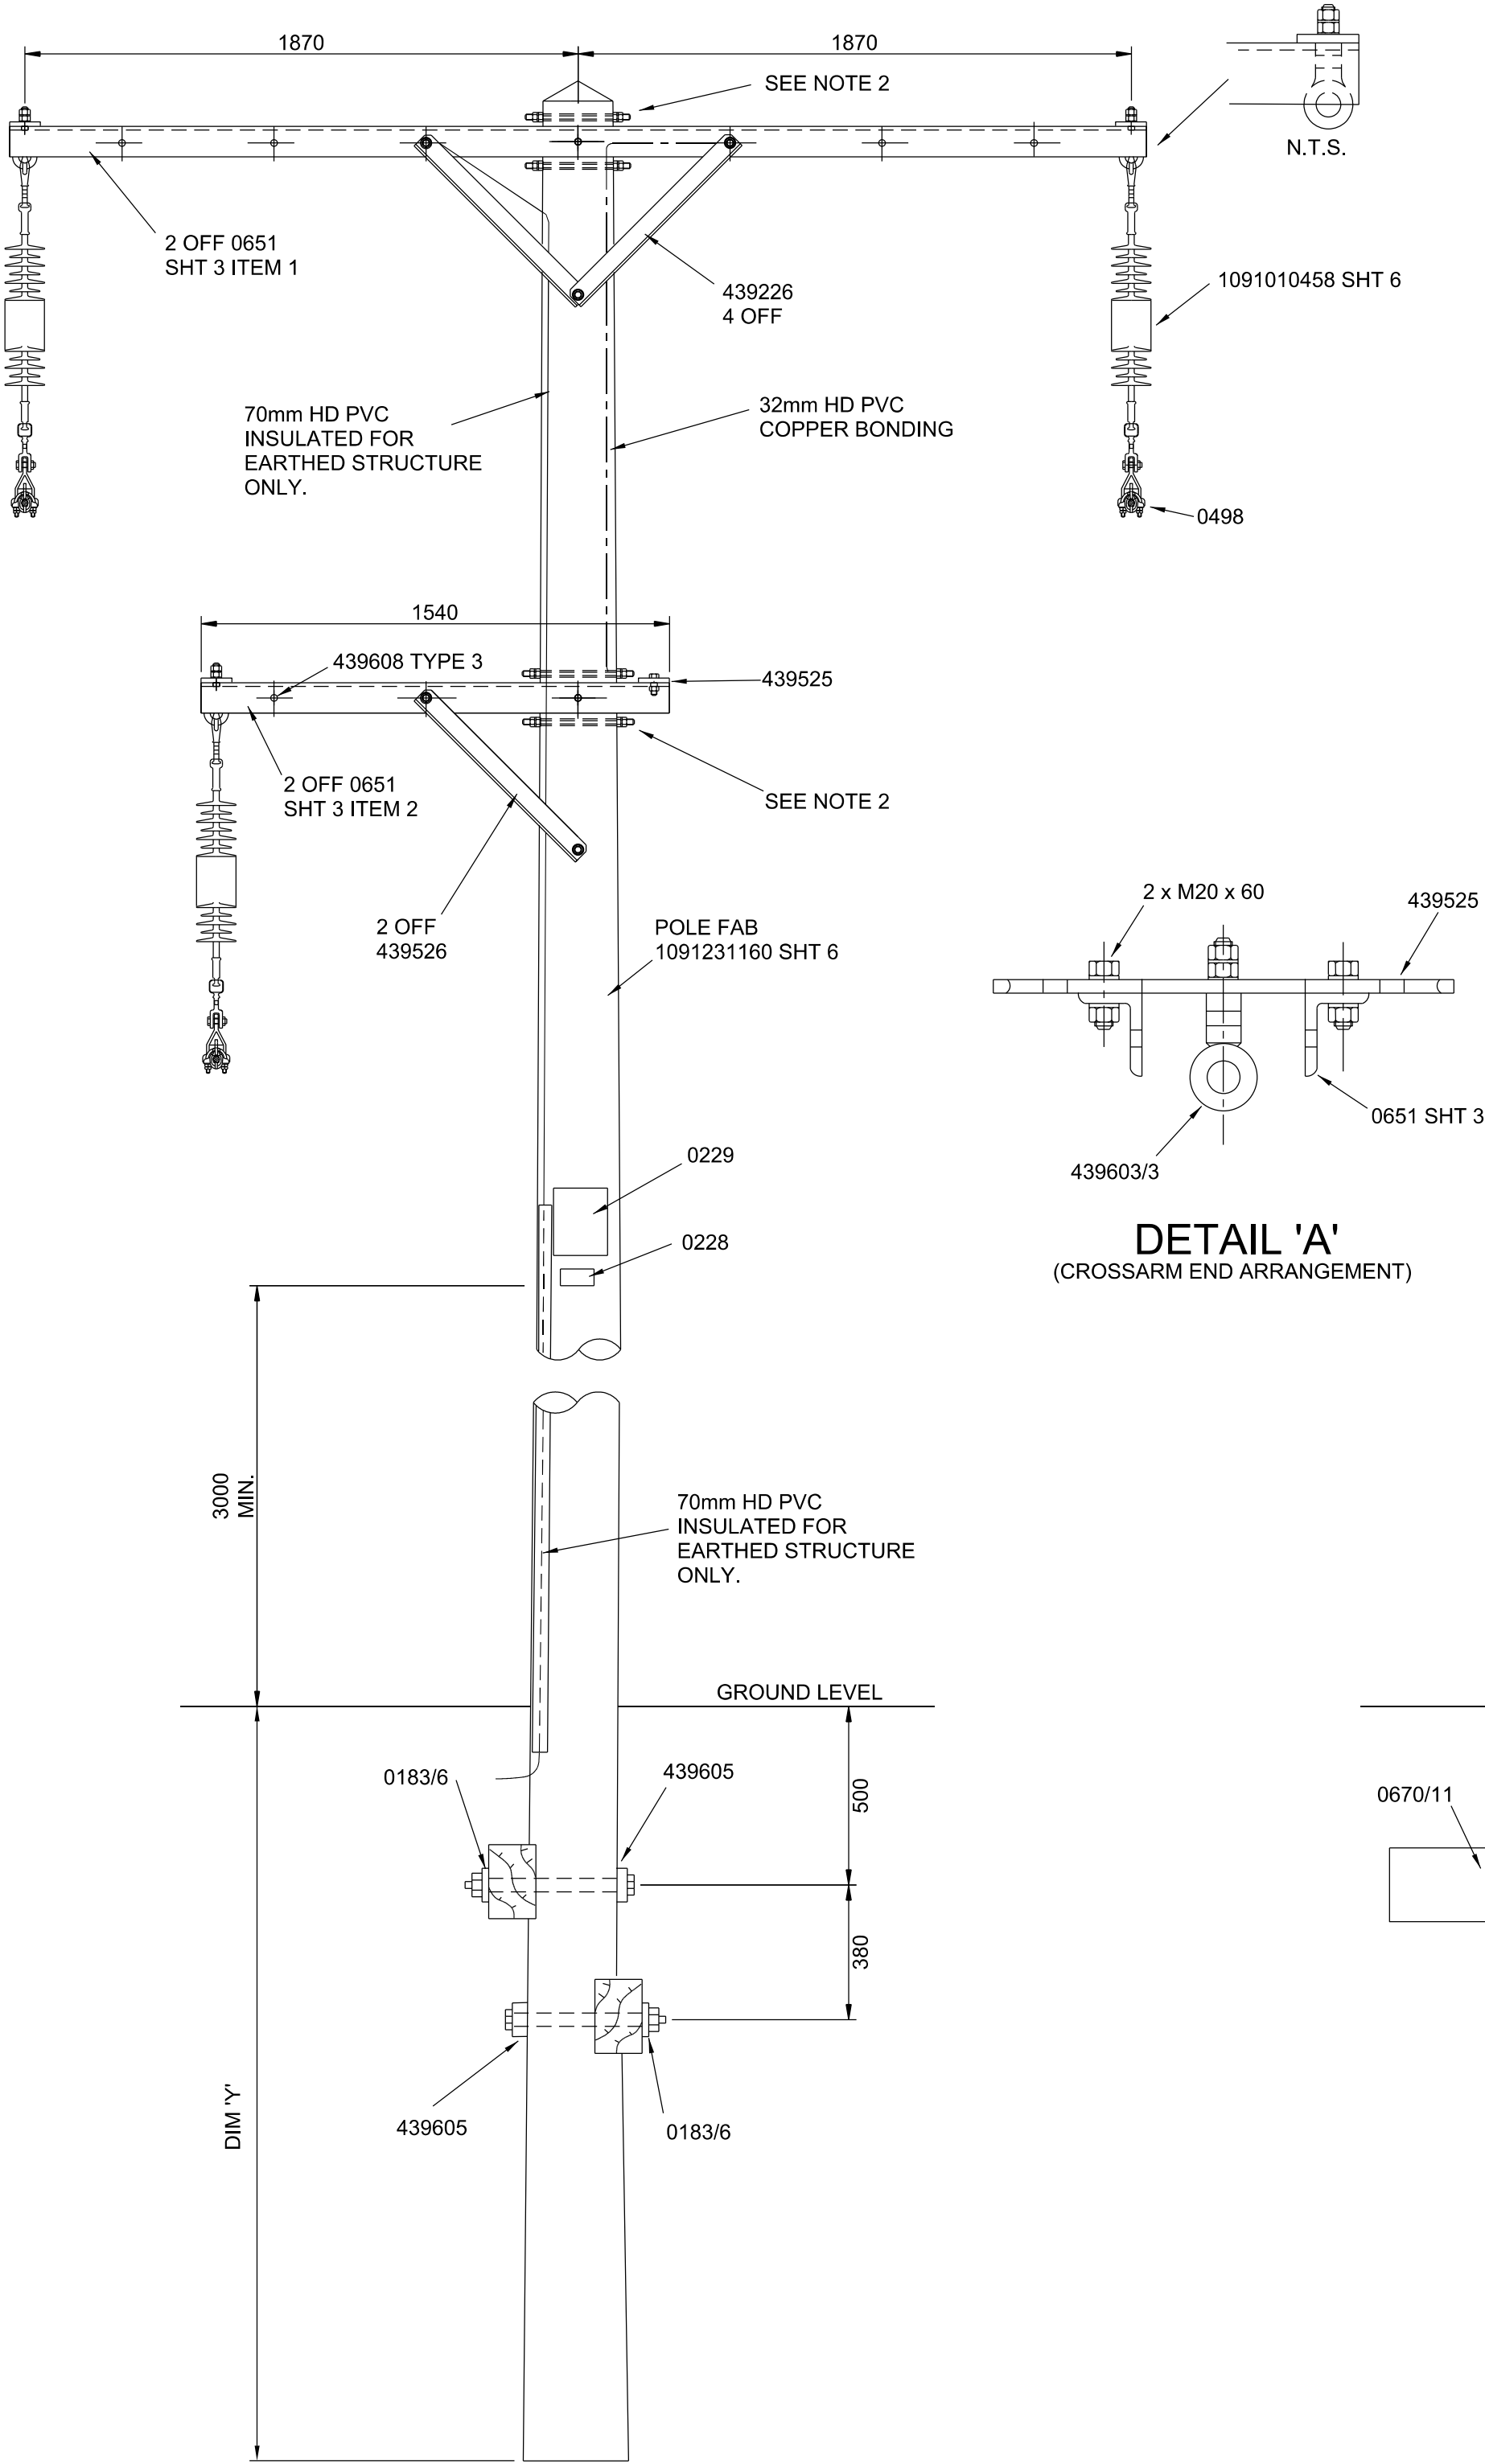

POLE LENGTH	DIM 'Y'
13.0 - 18.0	2.6
20.0 - 22.0	3.0

NOTE:-

1. MIN. POLE HEIGHT 13.0m. E/STOUT.
2. FIT 2 M20 POLE BOLTS WITH 2 WASHERS 439605 AT POLE TOP.
3. DETAIL DRAWINGS PREFIXED WITH 43 REFER TO ESI DRAWINGS, OTHER DETAIL DRAWINGS REFER TO 1.09.101 SERIES.
4. ARRANGEMENT TO REPLACE MEM 'A' POLES TO DRAWINGS
33.41/1.605
33.41/1.1160
33.41/1.606

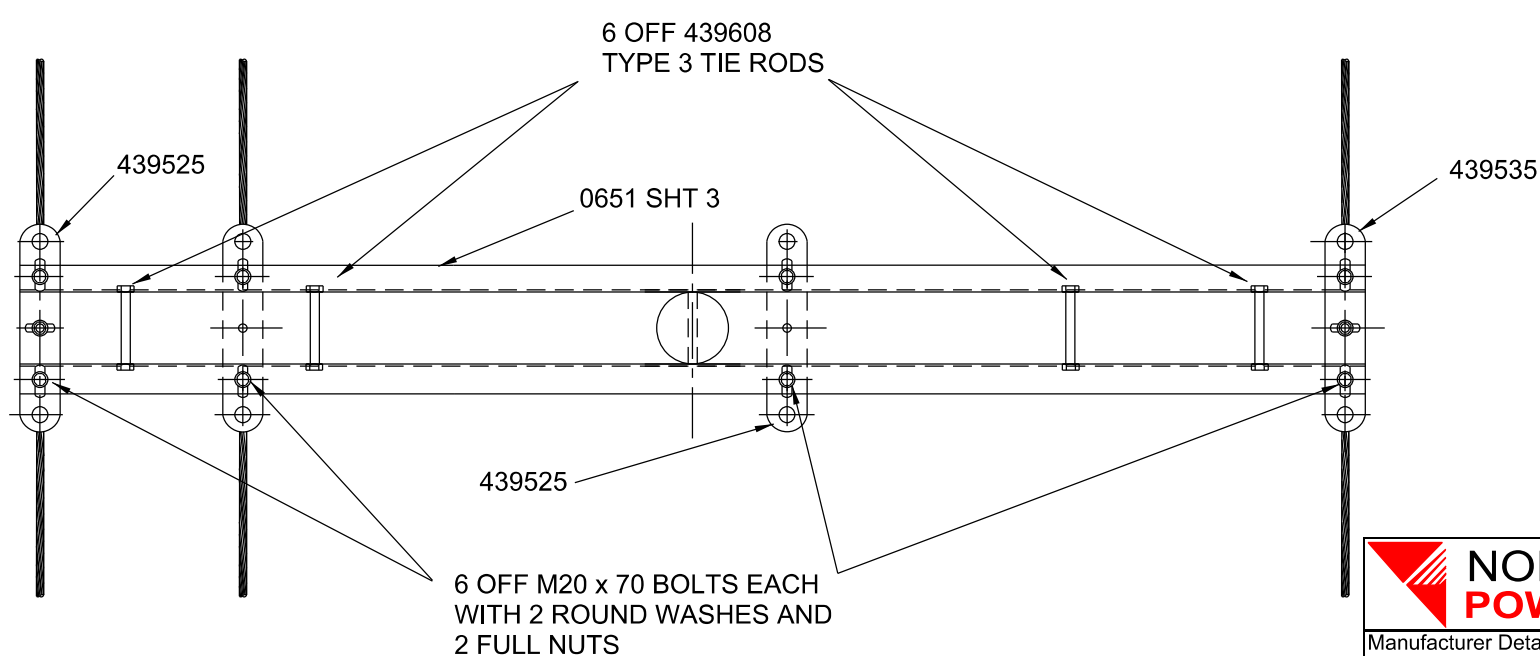

NORTHERN POWERGRID	
Manufacturer Details	
Sheet No. 5	Scale 1:20
Prepared By Arron.Turner	
Revised 05/03/15	Grid Reference
Date Issued 20/04/12	Checked By G HAMMEL

Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF			
66KV SINGLE CIRCUIT OVERHEAD LINES REPLACEMENT STRUCTURE FOR 1091231160 SHEET 1 AND RILEY & NEATE STEEL MASTS INTERMEDIATE			
Type OVERHEAD		STANDARDS	
Ref No.	C1008568	Historic Drg.No.	1091231160
Revision	C	Notes	