

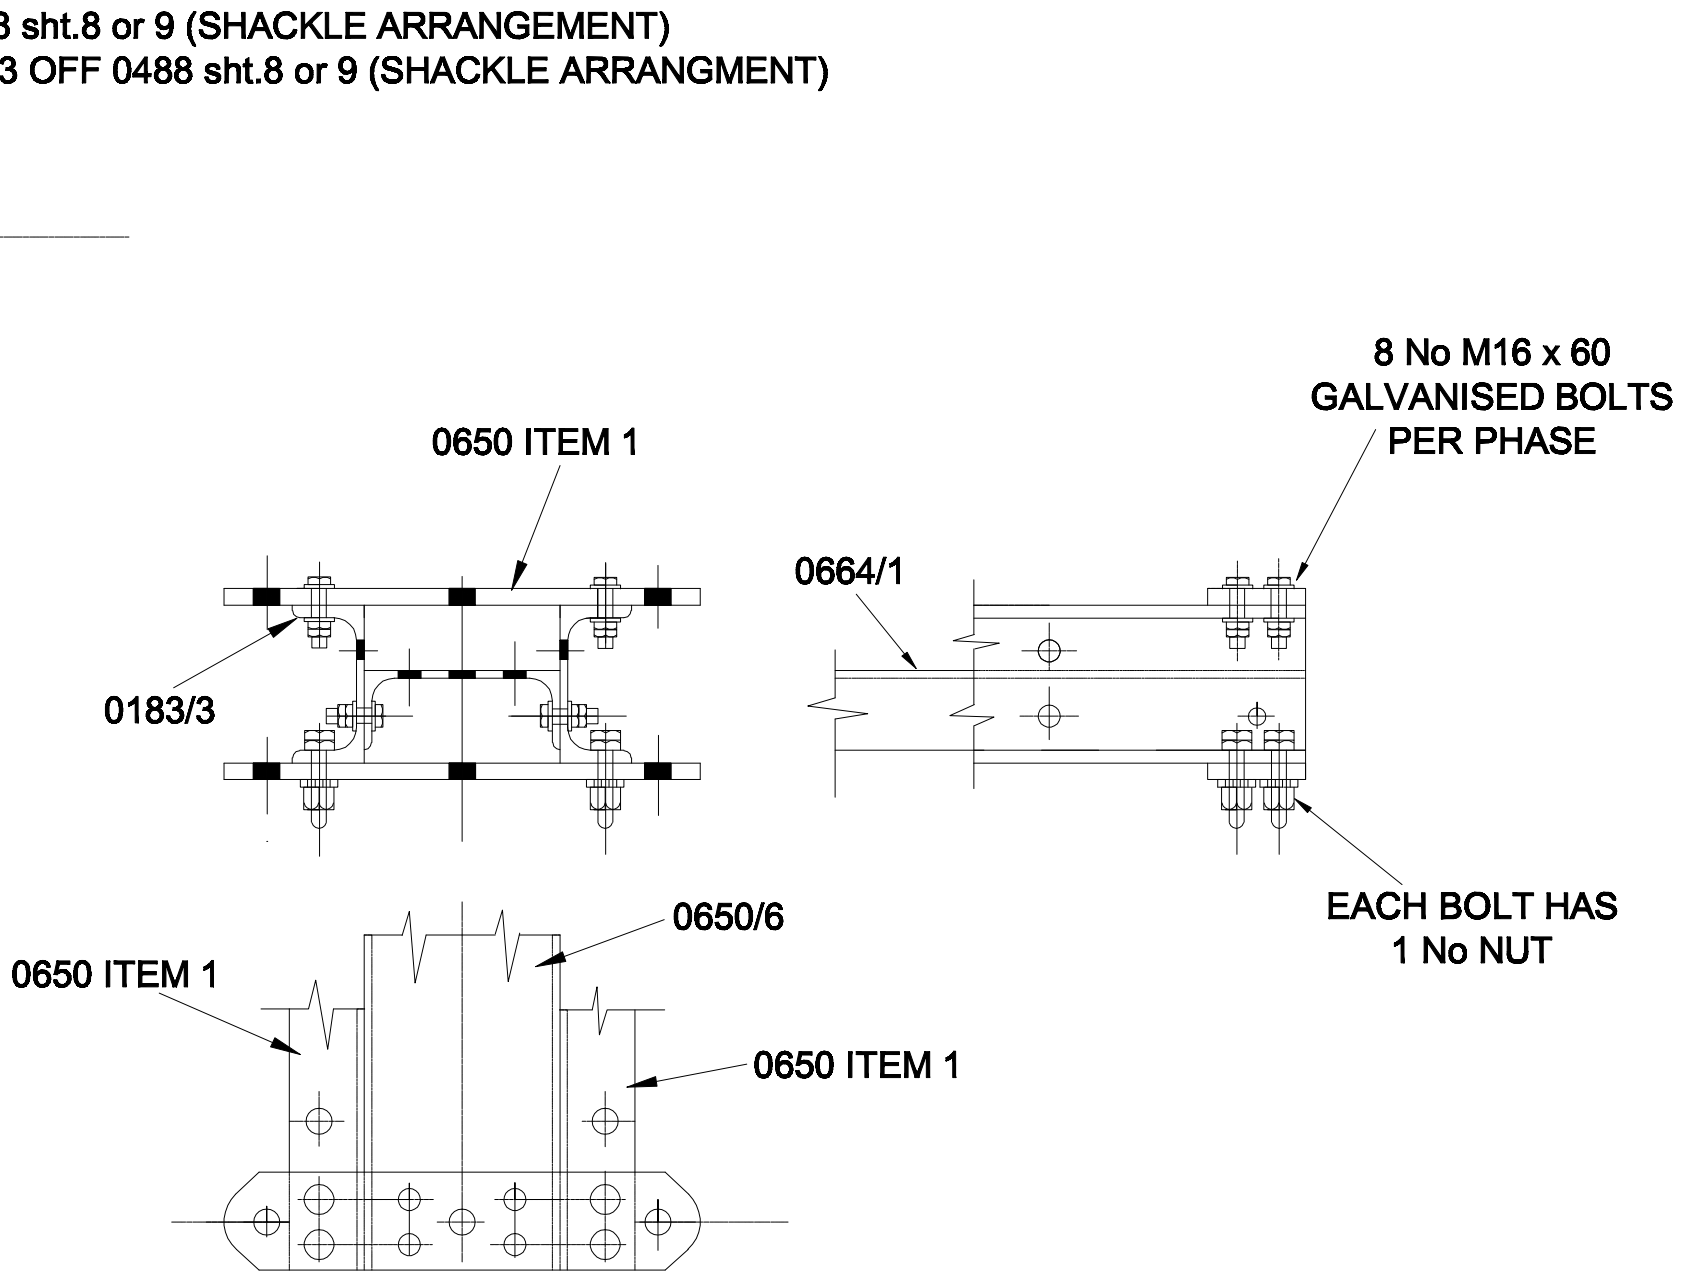


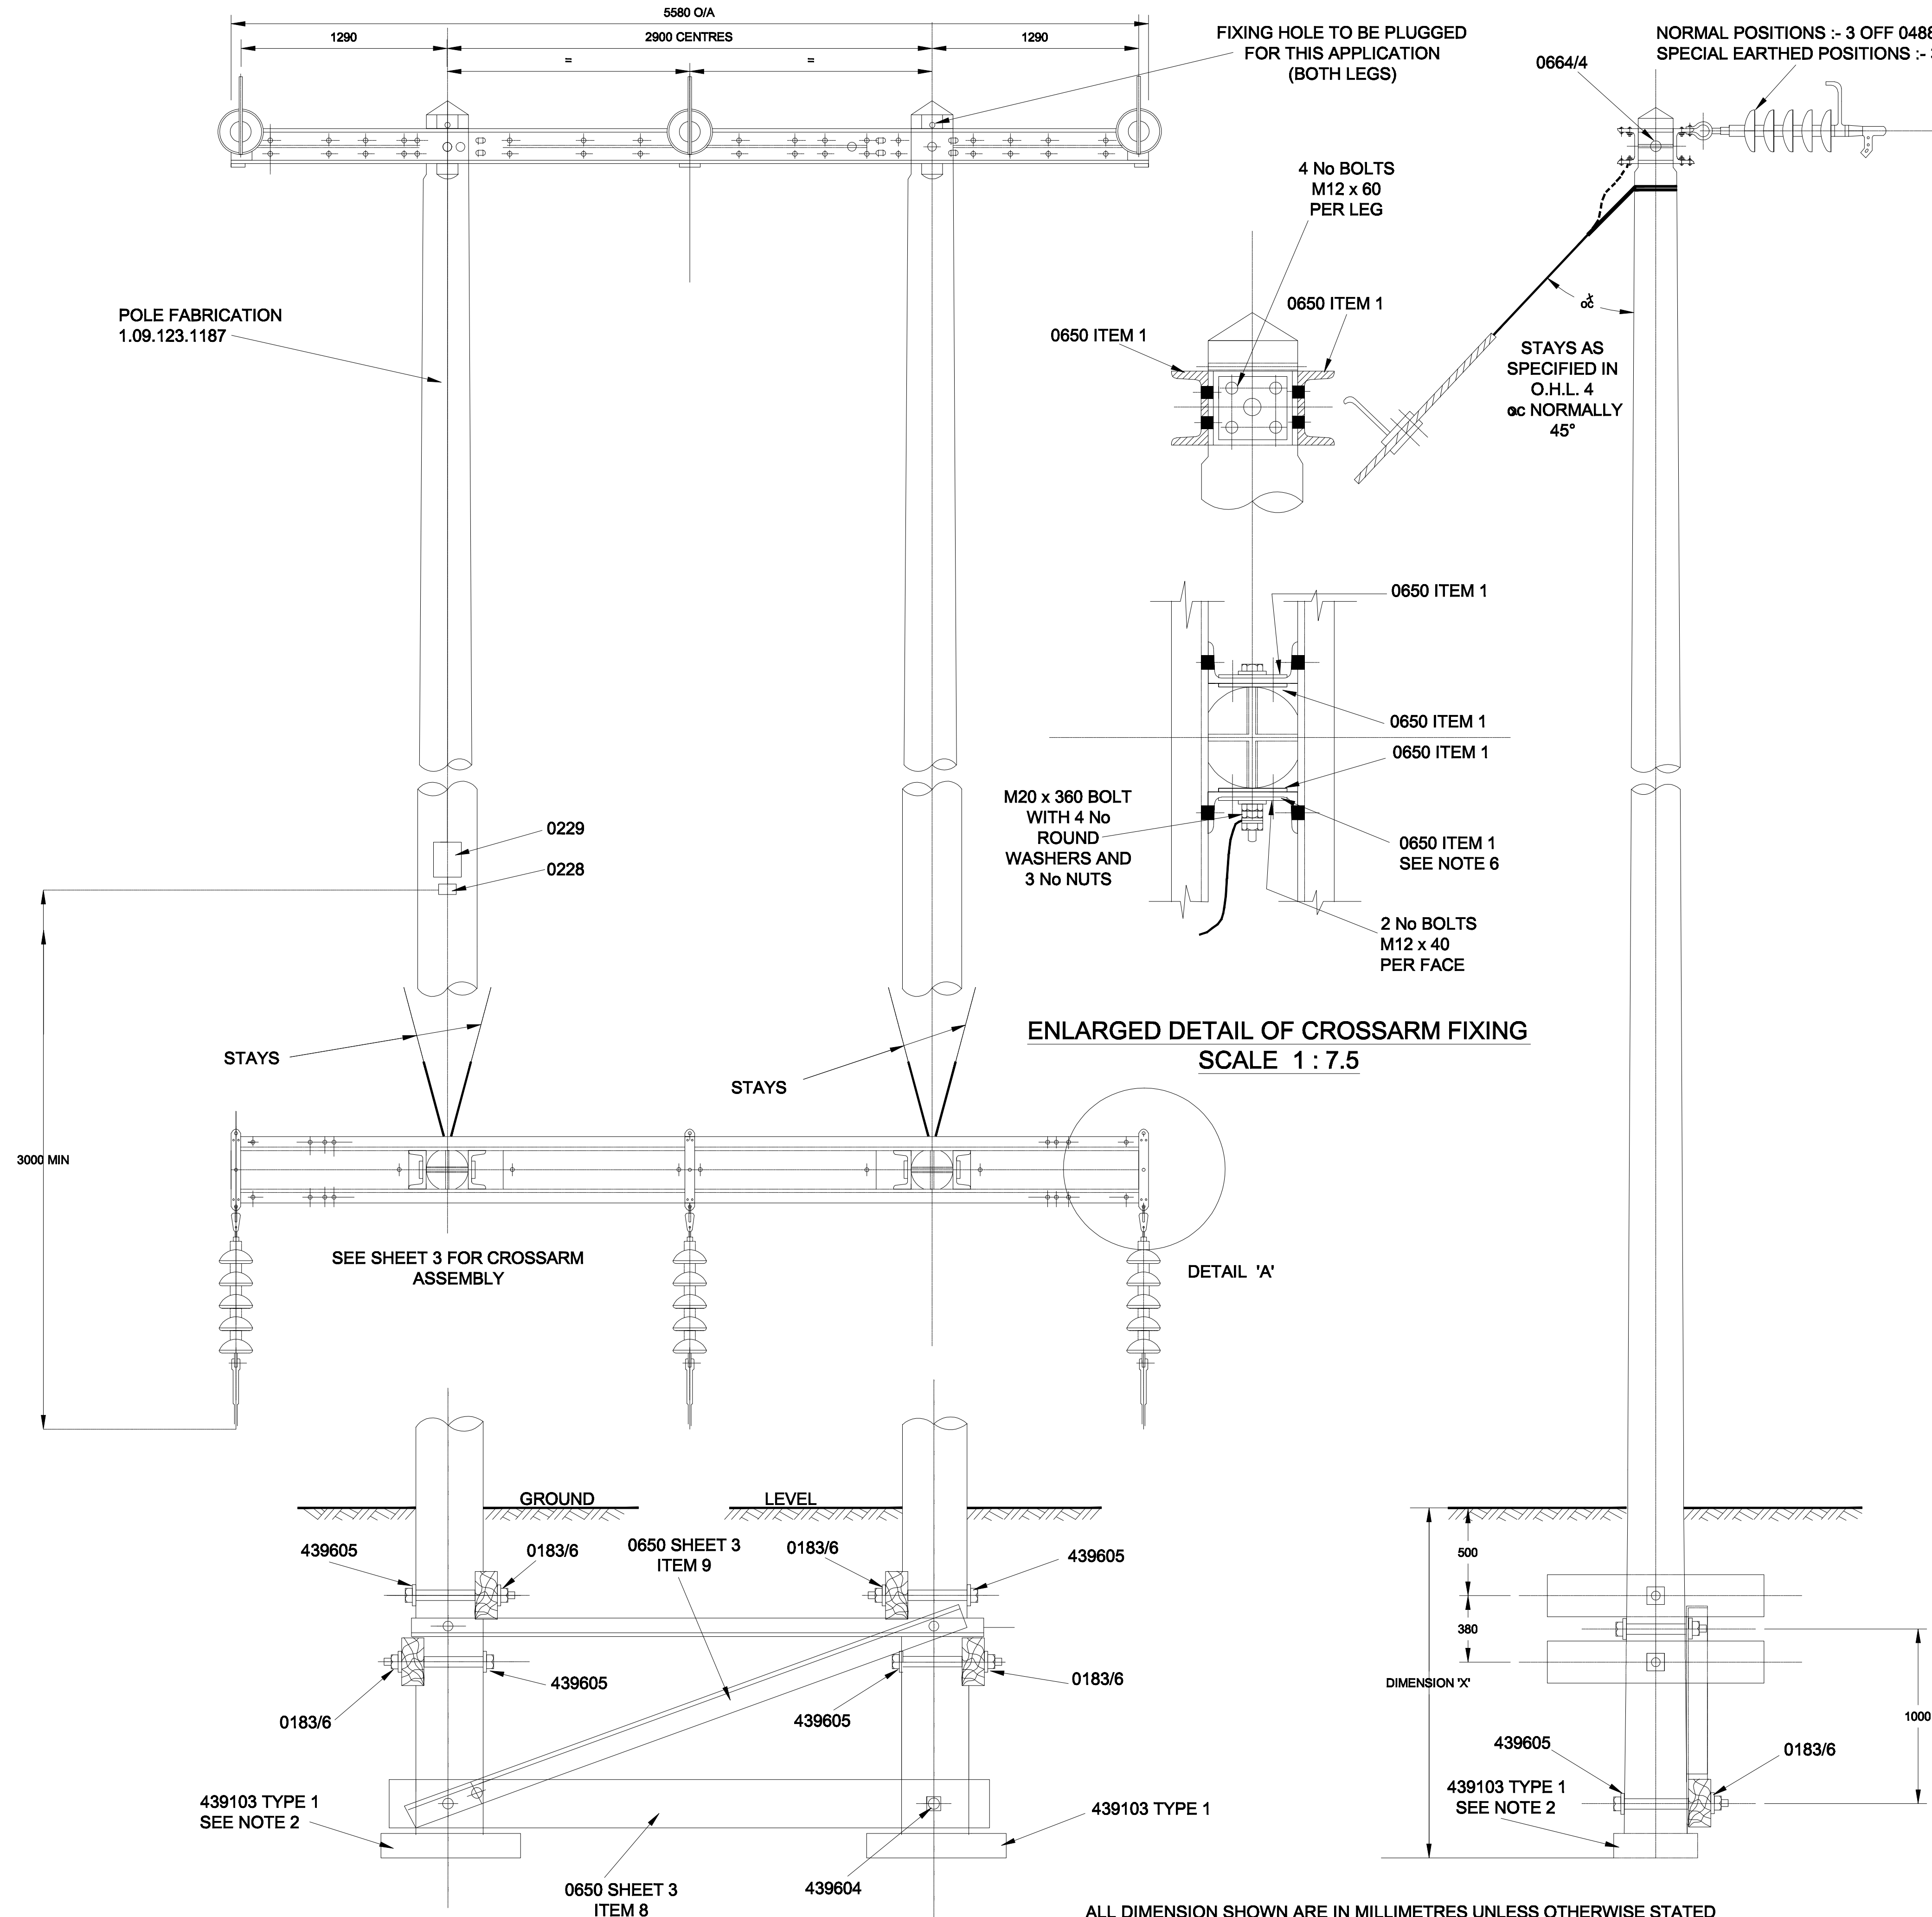

ENLARGED DETAIL ' A '
SCALE 1 : 7.5

- NOTES
1. ALL POLE BOLTS TO BE M20 UNLESS OTHERWISE STATED
 2. FOOTINGS, USED WHEN REQUIRED, TO CONSIST OF 2 No WOOD BAULKS LAID TOGETHER TO FORM 500 x 850 BASE AND INSTALLED AT EACH POLE LEG.
 3. DETAILED DRAWINGS PREFIXED 43..... REFER TO E.S.I. BASED DRAWINGS AND OTHER DETAILED DRAWINGS REFER TO 1.09.101. SERIES
 4. CLEARANCE BETWEEN PHASE AND STEELWORK OR TIMBER TO BE 700min
CLEARANCE BETWEEN DISSIMILAR PHASES TO BE 1500min
 5. ALL STEELWORK FIXING BOLTS TO BE COMPLETE WITH 1 No ROUND WASHER UNDER NUT AND 1 No ROUND WASHER UNDER BOLT HEAD UNLESS STATED OTHERWISE
 6. REFERENCE CROSSARM FIXING DETAIL INDICATES PLATES DEPLOYED UNDER NORMAL CONDITIONS
 7. ARRANGEMENT NOT NORMALLY USED FOR POLES OF GREATER THAN 17.0m LENGTH.

POLE LENGTH	DIM 'X'
UP TO AND INCLUDING 12.0m	2.0m
13.0m TO 15.0m INCLUSIVE	2.2m
16.0m TO 18.0m INCLUSIVE	2.4m

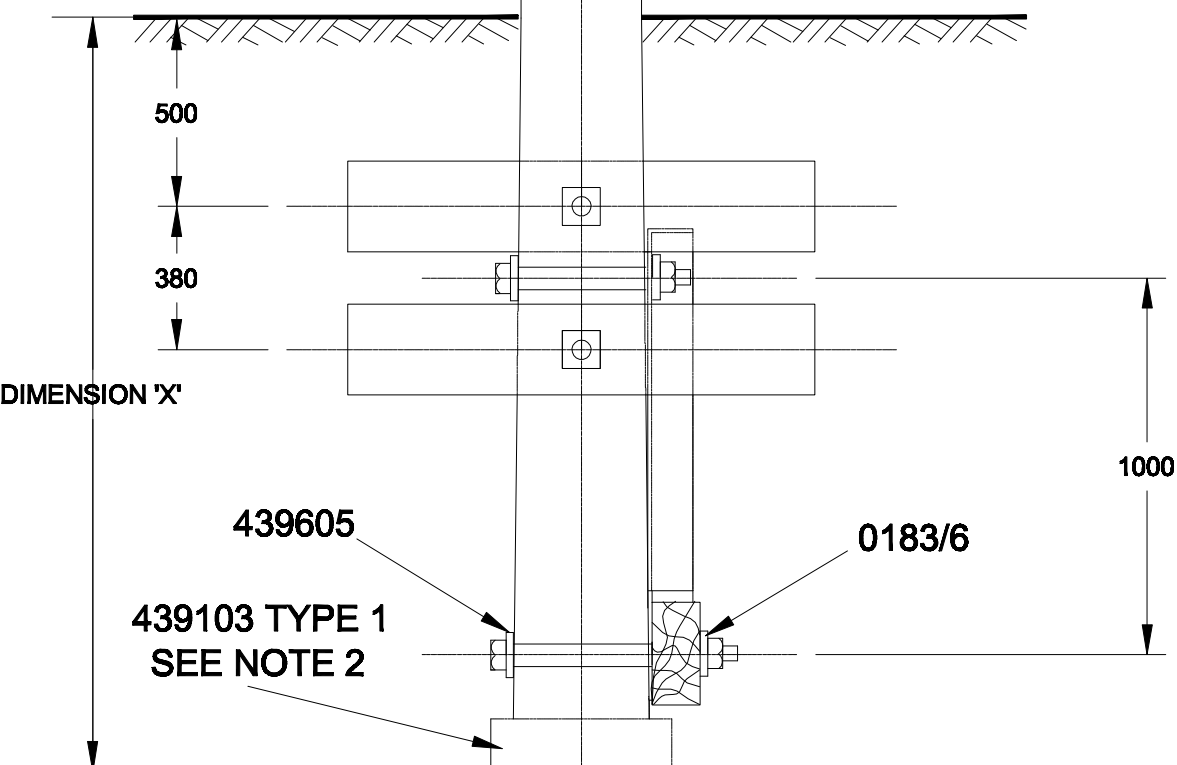

WORK SPEC No 04/226

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		66kV SINGLE CIRCUIT OVERHEAD LINES TERMINAL STRUCTURE 2.9M CENTRES NEW CONSTRUCTION	
Sheet No. 1	Scale 1:20	Type OVERHEAD	POLES
Prepared By Caralyn.Palmer	Revised 29/08/10	Ref No. C949354	Historic Drg.No. 1091231173
Date Issued 19/06/07	Checked By M WILSON	Revision Q	Notes