

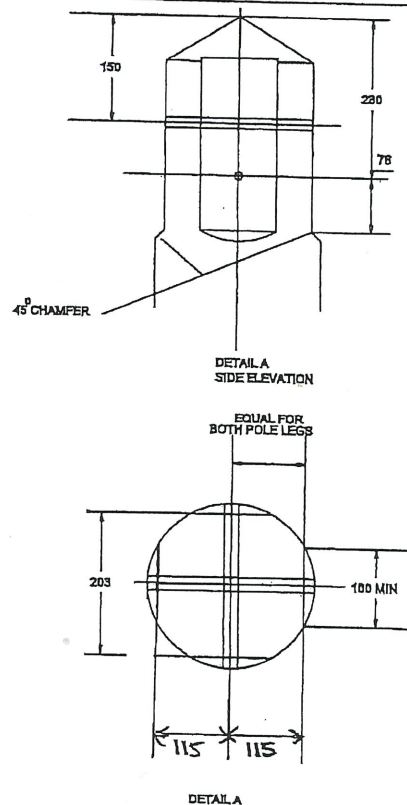
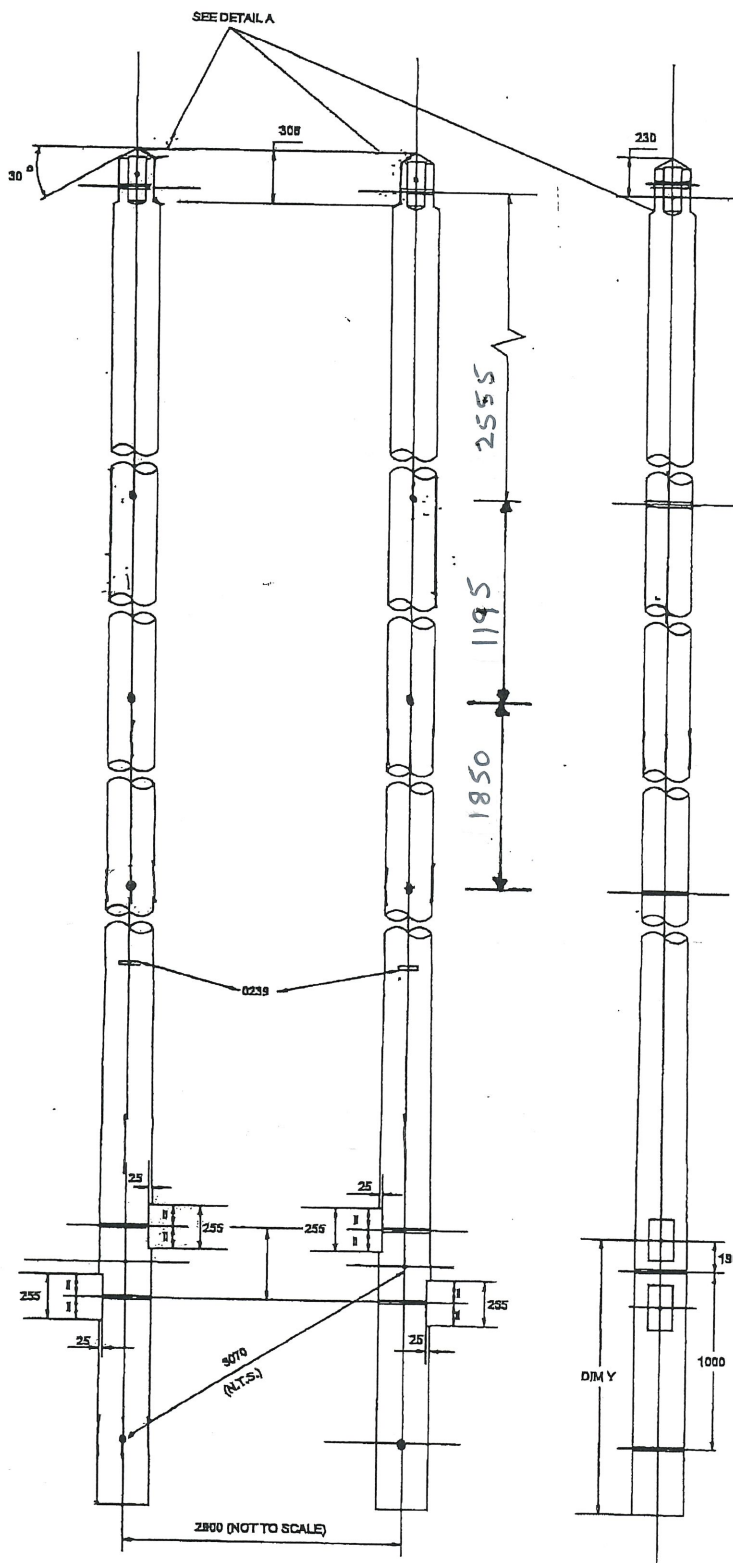


BIRDS EYE VIEW

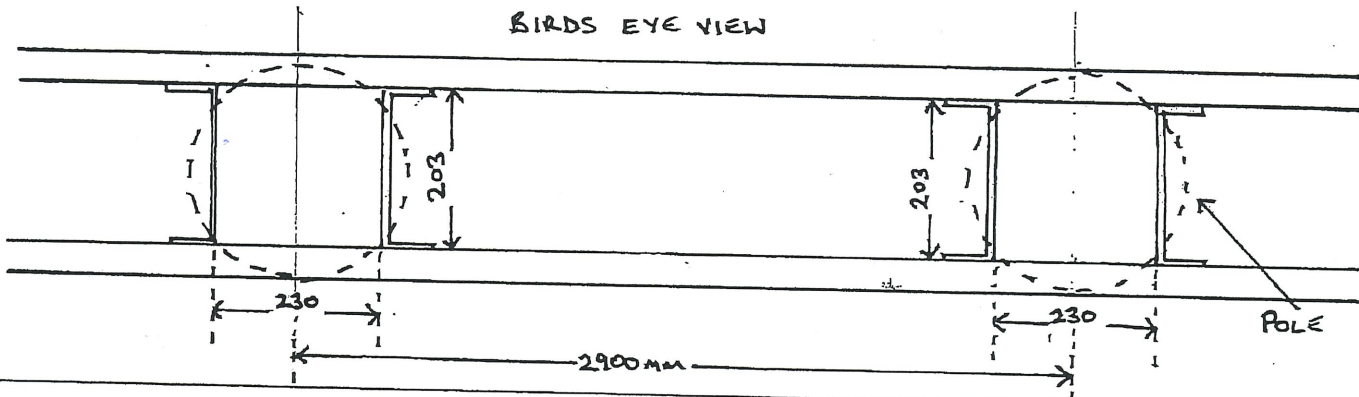

NOTES:

- POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION STOUT - 250mm
- ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREASOTING.
- POLE BUTTS TO CUT AT RIGHT ANGLES TO AXIS OF POLE.
- POLE LEGS TO BE NOTCHED AND DRILLED FOR 250 X 125 WOOD BALKS AS SHOWN
- POLE TO BE SUPPLIED WITH 4 - 1300 X 250 X 125 BALKS TO DRG NO 1 00 043 8130 TYPE 3 CUT FROM THE SQUARE AND 4 - M20 GALVANISED BOLTS EACH WITH 1 FLAT AND 1 CURVED GALVANISED WASHER TO DRG NOS 1 00 043 8104 AND 8105 RESPECTIVELY.
- HOLES NOT REQUIRED FOR PARTICULAR APPLICATIONS WILL BE PLUGGED ON SITE

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

POLE LENGTH	DIM Y
10.0m	1700
13.0m	1700
14.0m	1700
15.0m	1700
16.0m	1900

GE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturing Details		66KV SINGLE CIRCUIT LINES	
Sheet No. 10	Scale 1:20	DRILLING SCARFING AND MARKING FOR TERMINAL SUPPORT WITH SURGE ARRESTORS AND HEAT SHRINK TERMINATION AS SHOWN ON 1.09.123.1173 SHEET 9	
Prepared By: [Signature]	Checked By: [Signature]	Type: OVERHEAD	POLES
Revised: 01/07/03	Gold Reference	Ref No. C976718	Historic Drg. No. 1091231173
Date Issued: 24/08/08	Checked By: S. SALFIELD	Revision: [Blank]	Notes: [Blank]

MODIFIED 1.09.123.1173 SHEET 10

01.11.2023