
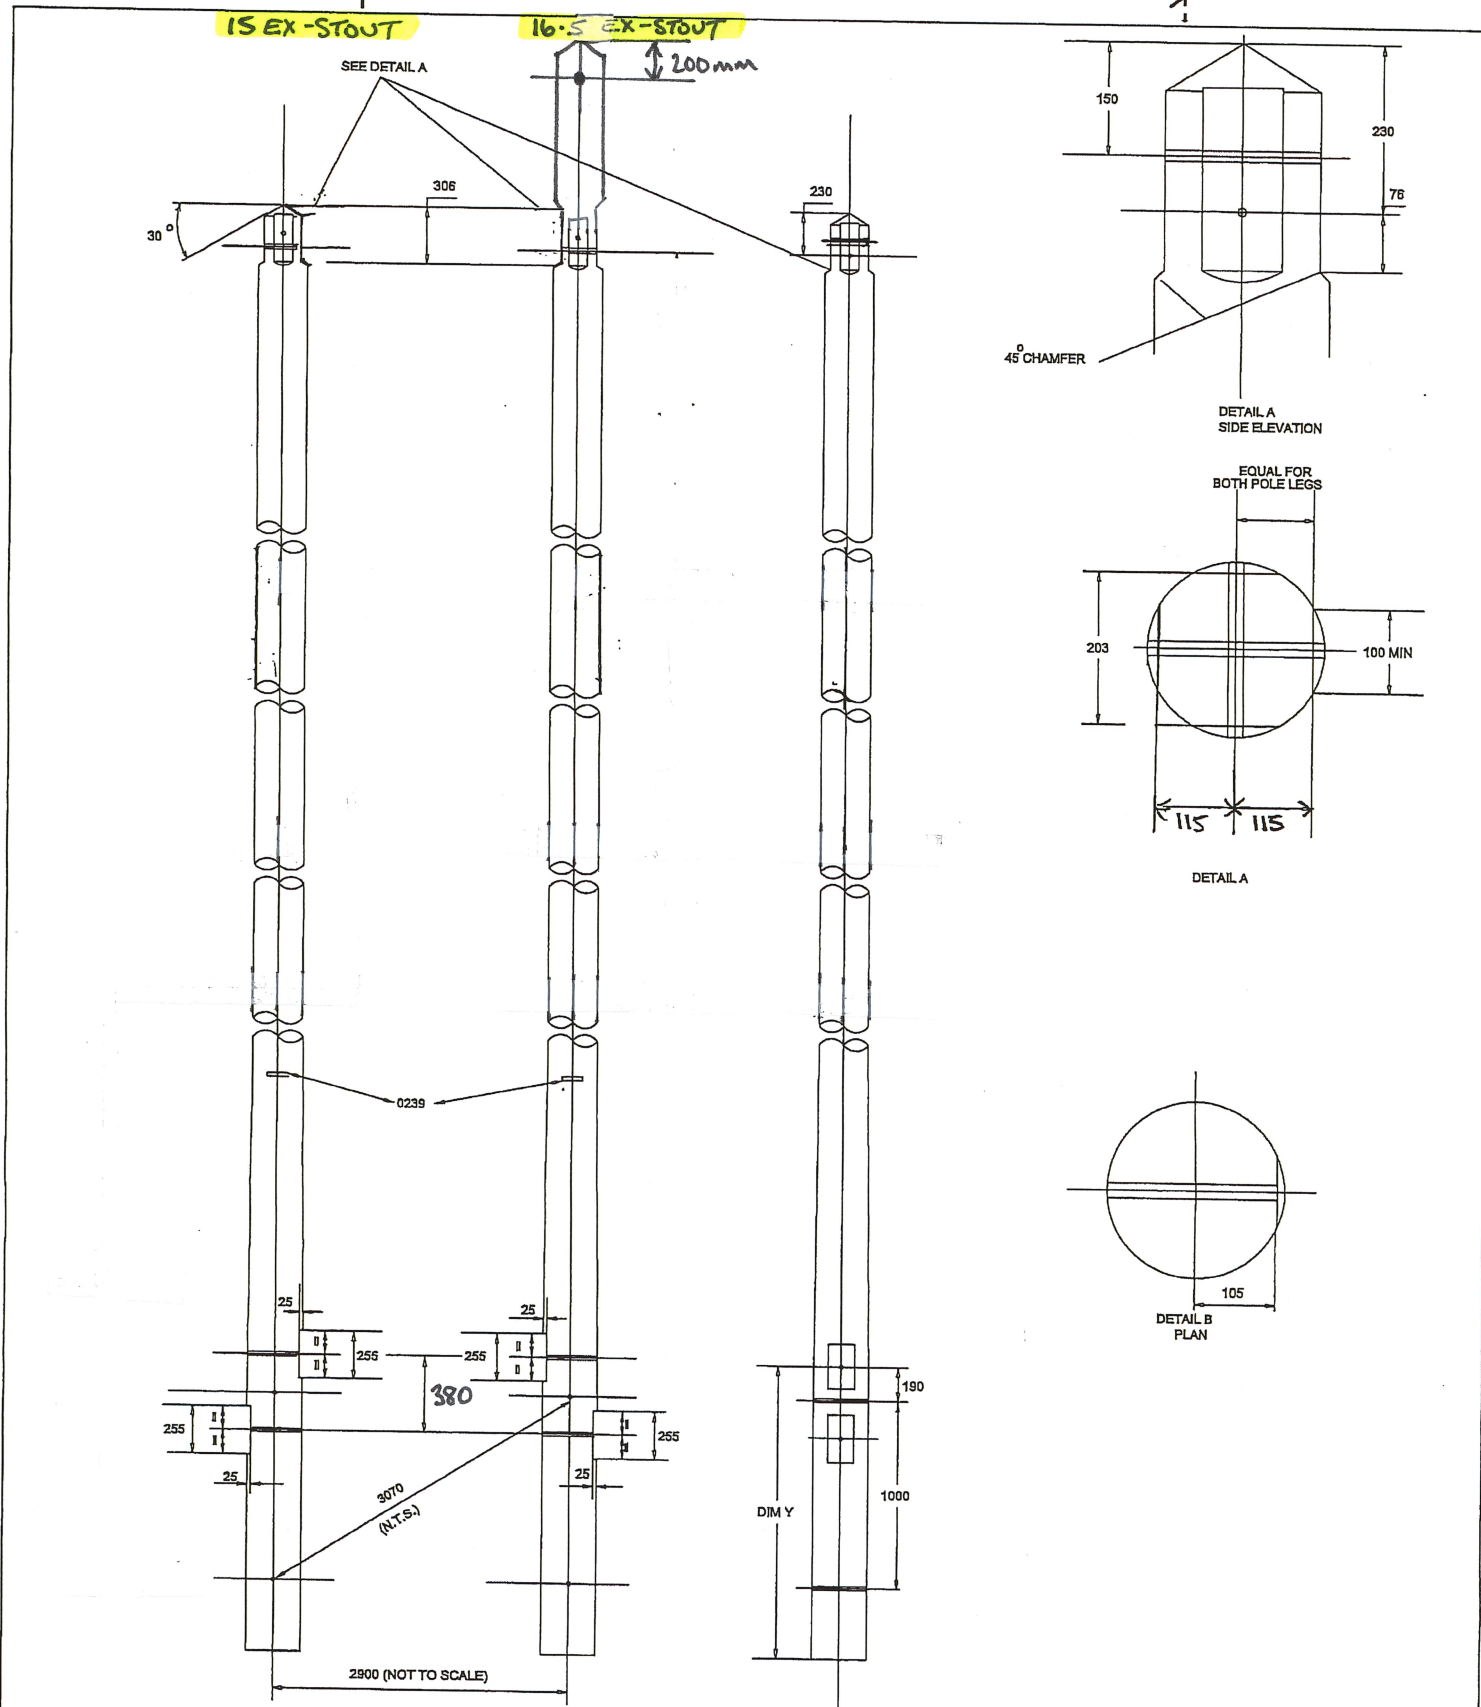


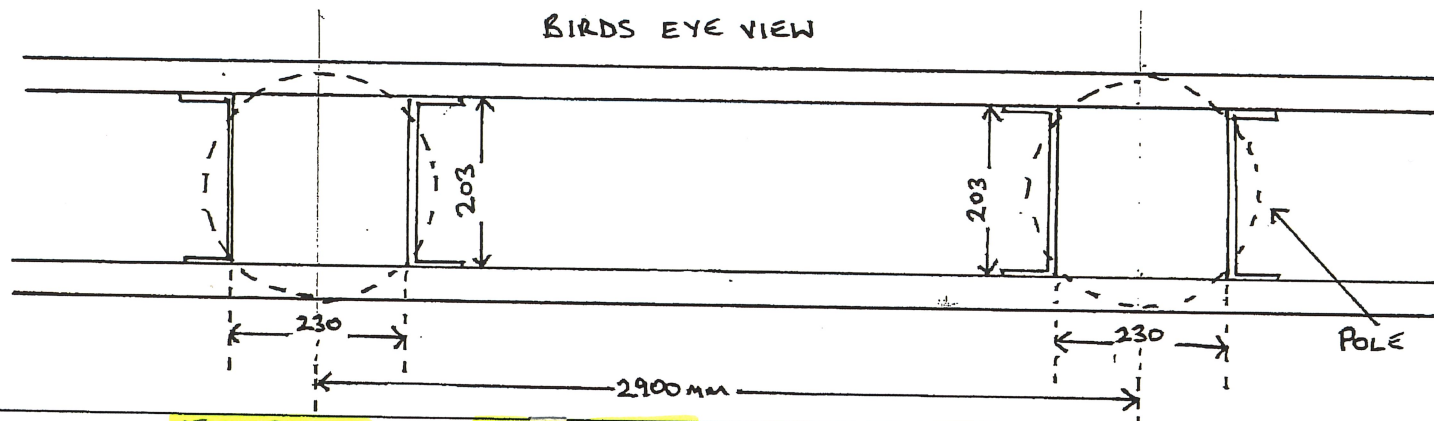

NOTES:

1. POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION STOUT - 250mm
2. ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREASOTING.
3. POLE BUTTS TO CUT AT RIGHT ANGLES TO AXIS OF POLE.
4. POLE LEGS TO BE NOTCHED AND DRILLED FOR 250 X 125 WOOD BAULKS AS SHOWN
5. POLE TO BE SUPPLIED WITH 4 - 1300 X 250 X 125 BAULKS TO DRG NO 1 00 043 9130 TYPE 2 CUT FROM THE SQUARE AND 4 - M20 GALVANISED BOLTS EACH WITH 1 FLAT AND 1 CURVED GALVANISED WASHER TO DRG NOS 1 00 043 9604 AND 9605 RESPECTIVELY.
6. HOLES NOT REQUIRED FOR PARTICULAR APPLICATIONS WILL BE PLUGGED ON SITE

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

POLE LENGTH	DIM X	DIM Y
12.0m	8855	1700
13.0m	8855	1700
14.0m	8855	1700
15.0m	8855	1700
16.0m	8855	1900

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		66KV SINGLE CIRCUIT LINES	
Sheet No. 10	Scale 1:20	DRILLING SCARFING AND MARKING FOR TERMINAL SUPPORT	
Prepared By Barbara Gordon	With Reference	WITH SURGE ARRESTORS AND HEAT SHRINK TERMINATION	
Revised 01/07/09	Ref No. C97671B	AS SHOWN ON 1.09.123.1173 SHEET 9	
Date issued 24/06/09	Checked By S SALKELD	Historic Drg.No.	1091231173
Revision		Notes	

MODIFIED 1.09.123.1173 SHEET 10

BY PETER BEARDSHAW 08.11.2018