
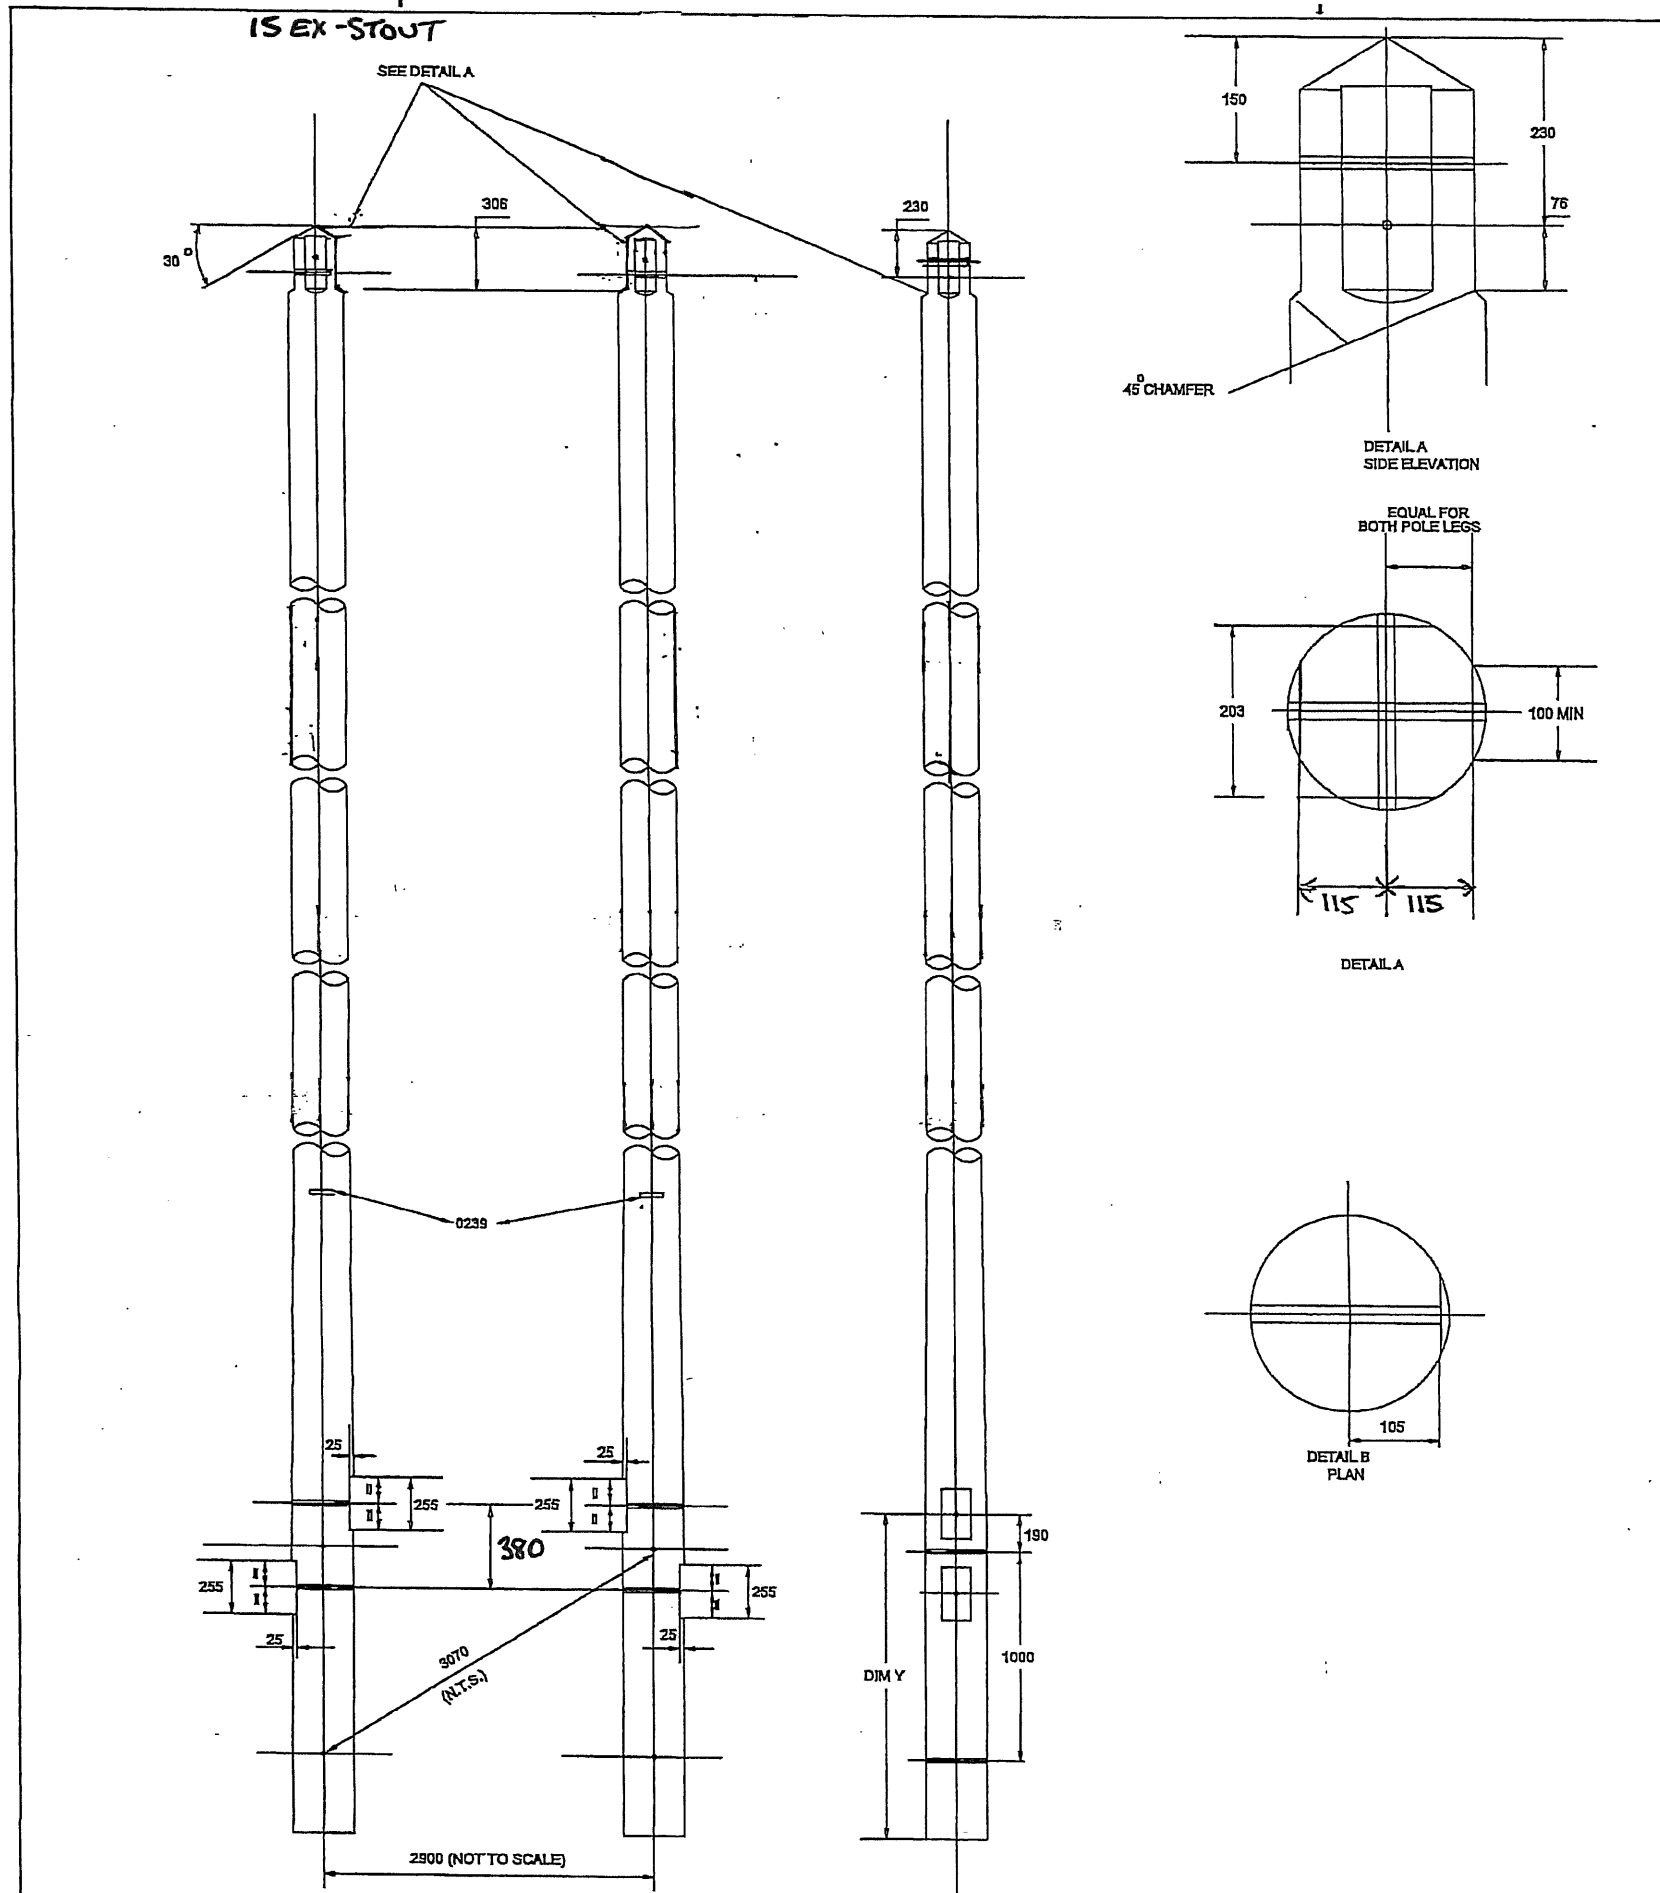


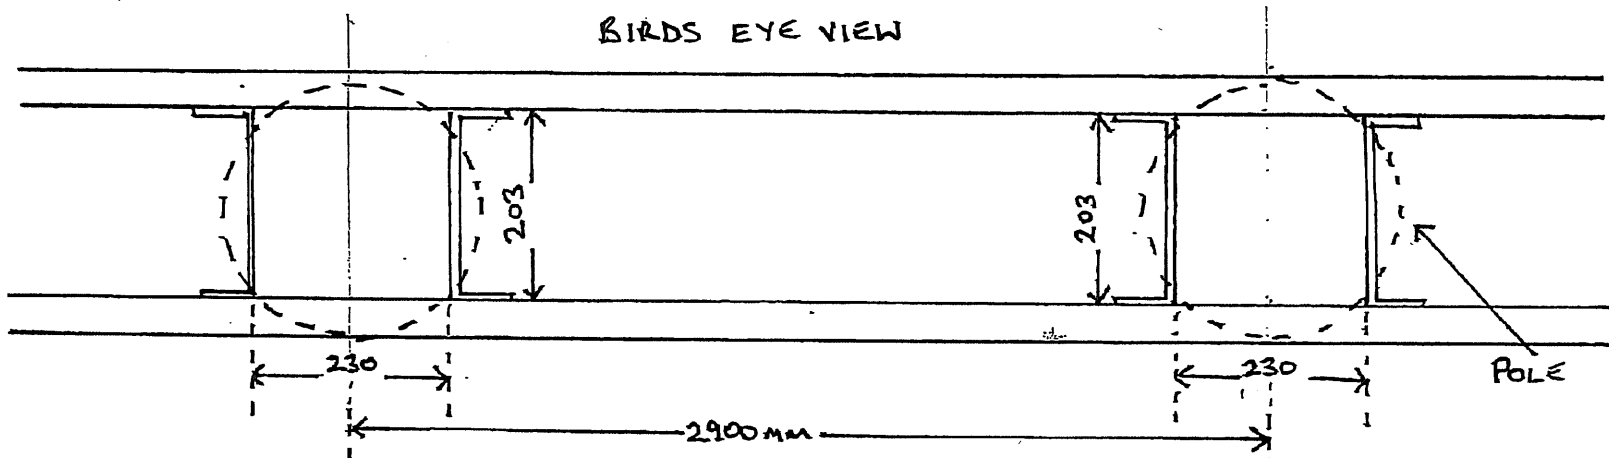

NOTES:

1. POLE LEGS TO BE MATCHED. POLE TOP MINIMUM DIAMETER BEFORE FABRICATION **STOUT - 250mm**
2. ALL HOLES TO BE 22mm DIA. DRILLED AT RIGHT ANGLES TO VERTICAL CENTRE LINE OF POLE. ALL DRILLING AND CUTTING TO BE DONE STRICTLY TO TEMPLATE PRIOR TO CREASOTING.
3. POLE BUTTS TO CUT AT RIGHT ANGLES TO AXIS OF POLE.
4. POLE LEGS TO BE NOTCHED AND DRILLED FOR 250 X 125 WOOD BAULKS AS SHOWN
5. POLE TO BE SUPPLIED WITH 4 - 1300 X 250 X 125 BAULKS TO DRG NO 1 00 043 9130 TYPE 2 CUT FROM THE SQUARE AND 4 - M20 GALVANISED BOLTS EACH WITH 1 FLAT AND 1 CURVED GALVANISED WASHER TO DRG NOS 1 00 043 9604 AND 9605 RESPECTIVELY.
6. HOLES NOT REQUIRED FOR PARTICULAR APPLICATIONS WILL BE PLUGGED ON SITE

ALL DIMENSIONS SHOWN ARE IN MILLIMETRES UNLESS OTHERWISE STATED

POLE LENGTH	DIM X	DIM Y
12.0m	1655	1700
13.0m	1655	1700
14.0m	1655	1700
15.0m	1655	1700
16.0m	1655	1900

CE Electric UK		Lloyds Court, 78 Grey Street, Newcastle Upon Tyne, NE1 6AF	
Manufacturer Details		66KV SINGLE CIRCUIT LINES	
Sheet No. 10	Scale 1:20	DRILLING SCARFING AND MARKING FOR TERMINAL SUPPORT WITH SURGE ARRESTORS AND HEAT SHRINK TERMINATION AS SHOWN ON 1.09.123.1173 SHEET 9	
Prepared By Barbara Gordon	Edt Reference	Type OVERHEAD	POLES
Revised 01/07/09	Checked By S SALKELD	Ref No. C975718	Historic Drg. No. 1091231173
Date Issued 24/06/09		Revision	Notes

MODIFIED 1.09-123-1173 SHEET 10
BY PETER BEARDSHAW 20.12.2018